

IAPMO ES

Cover Sheet

Evaluation Criteria of

Steel Roof Deck

EC 007-200X

Posted for public commenting on 10/16/2009 to 11/12/2009

**INTERNATIONAL ASSOCIATION OF PLUMBING
AND MECHANICAL OFFICIALS, EVALUATION SERVICES**

**EVALUATION CRITERIA
FOR**

STEEL ROOF DECK

EC 007-200X

1.0 INTRODUCTION

- 1.1 Purpose:** This criteria establishes the requirements for reorganization by IAPMO Evaluation Services (IAPMO ES) of steel roof deck construction evaluation report under the 2006 *International Building Code* (IBC), and the 2009 *International Building Code* (IBC). The basis of recognition is IBC Section 104.11.

The development of this criteria is to provide guidelines for calculating and testing the performance of steel roof deck for building and non-building structures, based on code provisions and the requirements in this evaluation criteria for conditions where the codes do not address the necessary requirements.

- 1.2 Scope:** This criterion provides a basis for calculating, testing and evaluating diaphragm shear capacity, diaphragm flexibility, section properties, and web crippling capacities for steel roof deck to meet the requirements section of Section 2209 of the IBC.

The development of capacities for steel decks with structural concrete fill including composite and non-composite steel deck assemblies exceed the scope of this criteria and shall not be evaluated under this criteria. In addition, the report shall state that topped diaphragms do not comply with the flexibility assumptions of ASCE 7-05 section 12.3.1.1 and IBC 1513.6 unless appropriate flexibility coefficients are developed and suitable deflection methodology is used to calculate the stiffness and deflection. The stiffness and deflection calculations are to be submitted to the building official.

- 1.2.2** The report shall indicate that use of the deck as a transfer diaphragm, categorized as an out-of-plane offset vertical irregularity, per ASCE 7-05 Table 12.3-1 (4), within a seismic force resisting system is beyond the scope of the report.

2.0 REFERENCED STANDARDS

- 2.1** Standards referenced in this criteria shall be applied consistently with the specific code(s) complied.

2009 IBC	International Building Code®
2006 IBC	International Building Code®
ANSI RD1.0-06	Standard for Steel Roof Deck (SDI)
ANSI/COS/NASPEC-01	AISI Standard North American Specification for the Design of

Copyright © 2009 by International Association of Plumbing and Mechanical Officials. All rights reserved. Printed in the United States of America. No part of this publication may be reproduced, stored in an electronic retrieval system, or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written permission of the publisher.

with '04 Supplement	Cold-Formed Steel Structural Members, American Iron and Steel Institute.
AISI S100-07	AISI Standard North American Specification for the Design of Cold-Formed Steel Structural Members, American Iron and Steel Institute.
AISC 360-05	Specification for Structural Steel Buildings, American Institute of Steel Construction.
AISI TS-5-02	Test Methods for Mechanically Fastened Cold-Formed Steel Connections, American Iron and Steel Institute.
AISI TS-7-02	Cantilever Test Method for Cold-Formed Steel Diaphragms, American Iron and Steel Institute.
AISITS-9-05	Standard Test Method for Determining the Web Crippling Strength of Cold-Formed Steel Beams, American Iron and Steel Institute.
ASTM A 370-09	Standard Test Methods and Definitions for Mechanical Testing of Steel Products
ASTM A 792-09	Standard Specification for Steel Sheet, 55% Aluminum-Zinc Alloy-Coated by the Hot-Dip Process
DDM03	Diaphragm Design Manual, 3 rd Edition, Steel Deck Institute
MOC02	SDI Manual of Construction with Steel Deck 2 nd Edition, Steel Deck Institute.

3.0 DEFINITIONS

- 3.1 Acoustical Deck:** A roof deck or cellular roof deck in which the panel or pan is perforated to allow for sound to pass through and be trapped in acoustical absorbing material on the top side of the steel deck or within the cavity of the cellular deck.
- 3.2 Cellular Roof Deck:** A cold-formed fluted sheet steel panel with a steel pan, flat sheet welded or mechanically attached to the top or bottom of the fluted member.
- 3.3 Roof Deck:** A cold-formed fluted sheet steel panel.

2.0 BASIC INFORMATION

- 2.1 General:** Each submittal shall include the following information for an evaluation report:
- 2.1.1** Steel Roof Deck shall meet the requirements of the NASPEC, AISI-S100, ANSI RD1.0 as referenced in this evaluation criteria. Roof deck designs that exceed the scope of standards shall meet the requirements of this evaluation criteria.
- 2.1.2** The steel roof deck shall be cold-formed fluted sheet steel panels. The panels shall be attached to supporting members with welds, screws, power driven pins/nails or other approved fastening systems. The fastening system to supports shall be compatible with the material type, thickness and grade of the supporting members. The panel side laps may be connected using welds, screws, friction connections (commonly referred to as button punches), penetrating mechanical interference punches or other approved fastening systems.

Copyright © 2009 by International Association of Plumbing and Mechanical Officials. All rights reserved. Printed in the United States of America. No part of this publication may be reproduced, stored in an electronic retrieval system, or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written permission of the publisher.

- 2.1.3 Steel Roof Deck Panels Materials:** The steel deck panels that comprise the diaphragm shall be manufactured from structural quality steel in accordance with the NASPEC and AISI-S100. Roof deck panel finishes shall comply with ANSI RD1.0-2006. In addition to the coating referenced in ANSI RD1.0, zinc-aluminum coated steel in accordance with ASTM A792 shall be an acceptable alternate coating to galvanized coatings.
- 2.1.4 Supporting Members Materials:** Supporting steel members shall be of materials meeting the requirements of ASIC 360, NASPEC or AISI-S100.
- 2.1.5 Fasteners:** The standards and specifications applicable to the fasteners shall be disclosed, and the minimum structural quality of the fasteners shall be specified. Fasteners shall be described in detail, including fastener type, size, length, location and edge distance(s). Where no values are recognized by the applicable code, the fasteners shall be recognized in a current evaluation report or a national product standard, or shall otherwise be justified to the satisfaction of IAPMO-ES. Where fasteners are exposed to weather, mechanical fasteners shall be galvanized and welds shall be painted to prevent corrosion. Other metallic coatings may be used on mechanical fasteners if justified to the satisfaction of IAPMO-ES.
- 2.2 Testing Laboratories:** Testing laboratories shall meet the requirements for compliance with the ISO/IEC Standards 17025 or an accredited independent agency, recognized by the International Laboratory Accreditation Cooperation Mutual Recognition Arrangement or ANSI. Testing at a non-accredited laboratory may be permitted by IAPMO ES, provided the testing is conducted under the supervision of an accredited laboratory and the supervising laboratory issues the test report.
- 2.3 Test Reports:** Test reports shall be submitted to IAPMO-ES for generation of evaluation reports.
- 2.4 Product Sampling:** Sampling of the cold-formed steel diaphragm components for tests under this criteria shall be approved by IAPMO-ES.

3.0 TESTING AND PERFORMANCE REQUIREMENTS

- 3.3 Openings, Holes or Penetrations through diaphragm:** The report shall incorporate the diaphragm penetration, hole, and opening guidelines in accordance with the SDI Manual for Construction with Steel Deck. Alternately for penetrations, holes, and openings that exceed the scope of the SDI Manual of Construction with Steel Deck the registered design professional may submit design calculations and opening details to the building official based on the principal of mechanics. Proprietary penetrations, hole, and openings may be permitted and listed in the report if testing or calculations are submitted to the satisfaction of IAPMO-ES.
- 3.4 Interpolation of Tables:** The report shall state that interpolation of shear and flexibility data for intermediate support spacing's is permissible, provided the higher tested value does not exceed the lower tested value by more than 50 per cent, unless justified otherwise to the satisfaction of IAPMO-ES. Interpolation and extrapolation beyond the above stated shall not be allowed unless justified to the satisfaction of IAPMO-ES.

Copyright © 2009 by International Association of Plumbing and Mechanical Officials. All rights reserved. Printed in the United States of America. No part of this publication may be reproduced, stored in an electronic retrieval system, or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written permission of the publisher.

- 3.5 Fatigue Loads:** The report shall indicate that the roof deck shall not be used in conditions subject to loads that are predominately cyclic in nature. The report can indicate that fatigue loading may be allowed provided a licensed design professional submits substantiating calculations to the Building Official in accordance with NASPEC and AISI-S100 Chapter G.
- 3.6 Fire Ratings:** Fire ratings shall be in accordance with Underwriters Laboratories, Factory Mutual or an approved agency recognized by IAPMO-ES. If no fire rating evidence is submitted, then the report shall indicate that the deck is not fire rated and use within fire-resistive assemblies is beyond the scope of the report.
- 3.6.1** If non-structural light weight insulating concrete is included in a fire-rated assembly, the report shall indicate that the insulating concrete shall be treated as dead load that the roof deck must support, and provide guidelines for classification as a restrained or unrestrained assembly.
- 3.7 Acoustical Performance:** Acoustical performance shall be submitted using a test method and laboratory approved by IAPMO-ES. If acoustical products are listed in the IAPMO-ES report and no acoustical performance evidence is submitted, then the report shall indicate that the acoustical performance is not rated by IAPMO-ES and acoustic performance is beyond the scope of the report.
- 3.8 Section Properties:** Section properties shall be calculated in accordance with the NASPEC and AISI-S100.
- 3.9 Diaphragm Shear and Flexibility:** Diaphragm shear and flexibility shall be determined by analytical calculations or by testing. Reference Section 4.2 for the testing methods.
- 3.9.1** Calculations for diaphragm shear and flexibility shall be done in accordance with the DDM03 including supplemental information intended to append or clarify the provisions of DDM03 as published by the Steel Deck Institute. Shear and flexibility tables, for general design of buildings, shall be based on a 3 span deck condition as recommended by SDI in DDM03.
- 3.9.2** Safety and resistance factors applied to the nominal diaphragm shear values calculated in accordance with DDM03 shall be as listed in Table D5 of the NASPEC and AISI-S100.
- 3.10 Web Crippling:** Web crippling for multi-web steel decks shall be determined in accordance with the provisions of the NASPEC. For panels that exceed the limitations of the methods in the NASPEC and AISI-S100, testing shall be used to determine web crippling capacities. Reference Section 4.3 for the testing methods.
- 3.11 Vertical Uniform Load Capacities:** Determination of capacities for vertical uniform loads from gravity and wind shall be based on equations of engineering mechanics, analyzing the steel deck as a beam. The license design professional shall provide calculations that justify the deck to the supporting members connection is capable of transferring the wind uplift loads, reference Section 3.13.2. The resisting capacities of the steel deck shall be based NASPEC. For uniformly distributed loads a combination of gross and effective moment of inertia may be used for determining deflection as follows:

$$I_{untransformed} = \frac{2I_{eff} + I_s}{2}$$

- 3.12 Vertical Line Load or Point load Capacities:** Determination of vertical line load or point load capacities shall be based on equations of engineering mechanics, analyzing the steel deck as a beam. The resisting capacities of the steel deck shall be based on NASPEC. Many point loads will require a load distribution device, such as a steel plate or bar that will distribute the load perpendicular to the deck flutes. The tributary width of the deck shall not be more than one flute beyond the length of the load distribution perpendicular to the deck. Web crippling at the line or point load shall be considered if applicable.
- 3.13 Fastener Capacities:** Fastener capacities shall be based on accepted standards. In the absence of accepted standards, capacities shall be based on testing. Reference Section 4.4 for the testing methods.
- 3.13.1** Shear capacities for fasteners used in steel diaphragms shall be calculated in accordance with DDM03. For fasteners not included in DDM03 provisions of the NASPEC and AISI-S100 may be used to calculate shear capacities. For fasteners that exceed the scope of the standard testing shall be run in accordance with Section 4.4.
- 3.13.2 Tension:** Tension of fasteners shall be calculated in accordance with the NASPEC and AISI-S100. For fasteners exceeding the scope of the standards, testing shall be performed in accordance with Section 4.4.

4.0 TEST METHODS

- 4.1 Material properties:** All steel used for testing shall have mill traceability certifications which clearly identify the grade designation, actual base metal thickness, yield strength, tensile strength, and elongation. In absence of any of the required information, testing for each coil of steel used for diaphragm panel samples shall be tested in accordance with ASTM A370.
- 4.2 Diaphragm:** Diaphragm testing shall comply with the requirements of the NASPEC, AISI-S100, and requirements in this criteria. The testing assembly shall represent the field condition unless sufficient evidence is submitted and approved by IAPMO-ES for a variance. IAPMO shall ensure that the boundary elements do not fail premature.
- 4.2.1 Full Scale Testing** shall be performed in accordance with the NASPEC and AISI-S100 using AISI TS-7-02 Cantilever Test Method for Cold-Formed Steel Diaphragms. Full scale testing shall be used to establish the shear and flexibility of a specific assembly, and when general analytic design equations for diaphragm shear and flexibility are outside the scope of DDM03.
- 4.2.2 Small Scale Testing** shall be used to develop shear and flexibility of fasteners with shear and stiffness of similar magnitude to those fasteners included in DDM03. The testing shall be performed in accordance with the requirements of section 4.4. The use of shear and stiffness for fasteners developed through small scale testing may be used in combination with the methods in DDM03 to develop shear and stiffness for steel roof decks.

4.2.3 Acceptance of testing for both full scale and small scale tests shall be as follows:

The provisions for analyzing the test data within the test standard shall be acceptable. As an alternate to the test standard criteria analytic design equations to describe a range of tested assemblies are permitted to be developed.

The provisions of Section F Tests for Special Cases in the NASPEC and AISI-S100, may be used to develop safety and resistance factors for the analytical method that describes the test results. Tests shall follow the requirements for the minimum number of tests and diversity of test in accordance with the test standard. The statistical data for determination of resistance factors shall be the most conservative for the connector type(s) used in the tested assembly. The target reliability index, β_o shall be in accordance with the commentary associated with the NASPEC and AISI-S100, 2.5 for wind and 3.5 for all other load effects. The professional factor, P_m , shall be the average of the ratio of the test results to the calculated design values predicted by the theoretical design equations. The resistance and safety factors developed from this analysis shall not be less conservative than those in Table D5 of the NASPEC and AISI-S100. If the resistance factors are more conservative than those in table D5 then the more conservative resistance factors must be used in conjunction with the products tested.

4.3 Web Crippling: Testing for web crippling shall be determined in accordance with NASPEC and AISI-S100 using AISI TS-9-05 Standard Test Method for Determining the Web Crippling Strength of Cold-Formed Steel Beams.

4.4 Mechanical Fasteners: Testing of mechanical fasteners shall be performed in accordance with the NASPEC and AISI-S100 using AISI TS-5-02 Test Methods for Mechanically Fastened cold-Formed Steel Connections.

5.0 EVALUATION REPORT RECOGNITION

5.1 A visible product identification label shall be on each bundle of diaphragm panels. The label shall include the manufacturer's name and address, the evaluation report number as required by IAPMO-ES. The label shall clearly identify the roof deck type and steel gauge as listed in the IAPMO-ES report. In addition the yield and tensile strength of the steel shall be printed on the label if the yield strength is above the 33ksi minimum for cold-formed steel.

5.2 In addition to those items that IAPMO-ES determined necessary for inclusion in the report, the mandatory items listed in Attachment A shall be included and the optional items may be included in the report. Other items may be included as determine appropriate by IAPMO-ES.

5.3 The report shall state the following:

The diaphragm length and width shall be limited by; 1) engineering mechanics 2) the applied loads, 3) shear capacity of the diaphragm, 4) the diaphragm shear deflection limited by the requirements of ASCE 7 in Sections 12.8.6 entitled, "Story Drift Determination" and Section 12.12 entitled, "Drift and Deformation". The shear deflection is based on the stiffness or flexibility factors for the diaphragm and equations of mechanics.

Copyright © 2009 by International Association of Plumbing and Mechanical Officials. All rights reserved. Printed in the United States of America. No part of this publication may be reproduced, stored in an electronic retrieval system, or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written permission of the publisher.

The shear deflection equations of mechanics, diagrams, notations, and symbols in Attachment B shall be included in the evaluation report as an aid to designers in determining the diaphragm deflection.

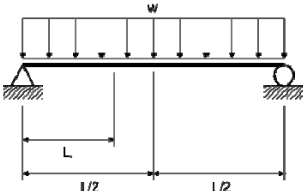
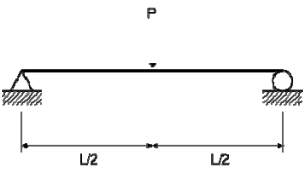
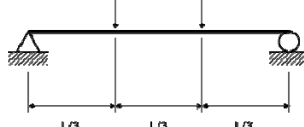
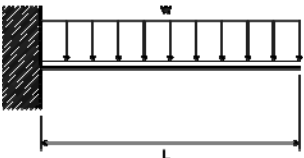


Adopted: Month & Year

ATTACHMENT A

Mandatory	Optional	Item
		Code Reference
X		Statement that Special Inspection is required in accordance chapter 1704.3 Steel Construction of the IBC
X		Statement that Structural Observations is required in accordance chapter 1710 of the IBC
X		If nominal strengths are given Table D5 of the NASPEC must be referenced for safety factors and resistance factors.
		Properties
X		Cross Section Diagram(s) of panels and Basic dimensions
X		Fastener attachment pattern diagram(s)
X		Perforation pattern(s), if applicable
		Fasteners
X		Nominal, allowable or factored shear capacities
	X	Nominal, allowable of factored withdrawal capacities
	X	Nominal, allowable of factored pull-over capacities
		Properties
X		Design base metal thickness per gauge callout
X		Grade(s) of steel, yield and tensile
X		Average weight per unit area
	X	Gross cross section area
	X	Gross moment of inertia
	X	Distance to neutral axis
	X	Gross positive section modulus
	X	Gross negative section Modulus
	X	Effective area
	X	Effective positive moment of inertia
	X	Distance to neutral axis for positive bending
X		Effective positive section modulus
	X	Effective negative moment of inertia
	X	Distance to neutral axis for negative bending
X		Effective negative section modulus
	X	Positive hybrid moment of inertia for uniform load deflection
	X	Negative hybrid moment of inertia for uniform load deflection
X		Lesser of hybrid moment of inertia for uniform load deflection
		Diaphragm
X		Nominal, allowable or factored diaphragm shear
X		Diaphragm flexibility factor or stiffness factor
		Web crippling
X		Web crippling for end and interior supports
	X	Web crippling for other conditions
		Out-Of-Plane Capacities
	X	Distributed load tables for strength and deflection
	X	Point load tables for strength and deflection

ATTACHMENT B

Diaphragm Shear Deflection Equations

Type of Loading	Loading Condition	Shear Deflection	
Simple Beam at Center	Uniform Load, w	$\Delta_w = \frac{wL^2}{8bG'}$	
Simple Beam at L ₁	Uniform Load, w	$\Delta_w = \frac{q_{ave}L_1}{G'}$	
Simple Beam at center	Point Load, P	$\Delta_w = \frac{PL}{4bG'}$	
Simple Beam at 1/3 points	Point Loads, P	$\Delta_w = \frac{PL}{3bG'}$	
Cantilever Beam at End	Uniform Load, w	$\Delta_w = \frac{PL^2}{2bG'}$	
Cantilever Beam at End	Point Load, P	$\Delta_w = \frac{PL}{bG'}$	
Relationship between flexibility factor and stiffness factor		$f = \frac{1000}{G'}$	

b = Depth of diaphragm (ft)

f = Flexibility factor (micro in/lbs)

G' = Stiffness factor (kips/in)

L = Diaphragm Length (ft)

L₁ = Distance to point where deflection is calculated (ft)

P = Concentrated load (lbs)

Copyright © 2009 by International Association of Plumbing and Mechanical Officials. All rights reserved. Printed in the United States of America. No part of this publication may be reproduced, stored in an electronic retrieval system, or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written permission of the publisher.

q_{ave} = Average diaphragm shear (lbs/ft)

w = Uniform load (lbs/ft)

Δ_w = Web deflection (in.)