



Originally Issued: 07/16/2015

Revised: 07/31/2018

Valid Through: 07/31/2019

## LISTING REPORT FOR SURFACE BURNING CHARACTERISTICS

### LISTING SUBJECT:

**FlowGuard Gold® or Corzan® CPVC Compounds Exclusively Licensed to Manufacturers**

### LISTEE:

**Lubrizol Advanced Materials, Inc.  
9911 Brecksville Road  
Cleveland, OH 44141  
(216) 447-7239  
[www.lubrizol.com](http://www.lubrizol.com)**

**CSI Division: 23 MECHANICAL  
CSI Section: 23 00 00 HVAC**

### 1.0 SCOPE OF LISTING

#### 1.1 Compliance to the following codes:

- 2015, 2012, 2009 and 2006 Uniform Mechanical Code® (UMC)
- 2015, 2012, 2009 and 2006 International Mechanical® Code (IMC)

#### 1.2 Compliance to the following Standards:

- ASTM E84-13a, Standard Test Method for Surface Burning Characteristics of Building Materials

#### 1.3 Properties assessed:

- Surface Burning Characteristics

### 2.0 FINDINGS

#### 2.1 Surface Burning Characteristics:

**2.1.1 Modified ASTM 84 Test.** For this test the Lubrizol material was formed into pipe and fittings, with the tunnel outfitted for one pipe. The specimens recognized in Sections 2.1.2, 2.1.3 and 2.1.4 of this report are not conductive to the 20 inch x 24 feet long full coverage specified by ASTM E84 and only provide a certain percent coverage of the total area of the surface exposed to the flame. The tested specimens are representative of the installed product.


**2.1.2 The FlowGuard Gold® CPVC Compound In SDR 11 Sizes ½ to 2 inch:** The FlowGuard Gold® CPVC compound when formed into pipe and fittings with wall thickness in accordance with SDR 11 as defined in ASTM D2846 and tested as a single row of pipe in a modified ASTM E84,, both dry and water-filled test specimens exhibited a flame-spread index of less than 25 and a smoke developed index less than 50,satisfying the requirements for installation in plenums spaces or within ducts in accordance with UMC and IMC Sections 602.2.

**2.1.3 The Corzan® CPVC Compound Sizes In Schedule 80 Sizes ½ to 6 inch:** The Corzan® CPVC compound when formed into pipe and fittings with wall thickness in accordance with Schedule 80 as defined in ASTM F441 and ASTM F439 and tested as a single row of pipe in accordance with modified ASTM E84, water-filled test specimens exhibited a flame-spread index of less than 25 and a smoke developed index less than 50, satisfying the requirements for installation in plenum spaces or within ducts in accordance with UMC and IMC Sections 602.2.

**2.1.4 The Corzan® CPVC Compound Sizes in Schedule 80 Sizes ½ to 2 inch:** The Corzan® CPVC compound when formed into pipe and fittings with wall thickness in accordance with Schedule 80 as defined in ASTM F441 and ASTM F439 and tested as a single row of pipe in accordance with modified ASTM E84, dry test specimens exhibited a flame-spread index of less than 25 and a smoke developed index less than 50, satisfying the requirements for installation in plenum spaces or within ducts in accordance with UMC and IMC Sections 602.2.

### 3.0 IDENTIFICATION

The FlowGuard Gold® and Corzan® CPVC Pipe and Fittings products are identified with a label on the carton or box identifying the company name (Lubrizol Advanced Materials, Inc.), the model number, the name of the inspection agency (IAPMO), the IAPMO UES Mark of Conformity and the Uniform Evaluation Listing Number (UEL-5002).

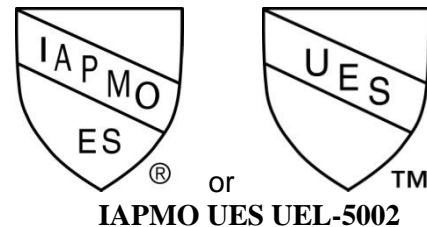

The products and systems described in this Uniform Evaluation Service (UES) Listing Report have been evaluated for conformance with the references described herein.

Copyright © 2018 by International Association of Plumbing and Mechanical Officials. All rights reserved. Printed in the United States. No part of this publication may be reproduced, stored in an electronic retrieval system, or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without the prior written permission of the publisher. Ph: 1-877-4IESRPT • Fax: 909.472.4171 • web: [www.uniform-es.org](http://www.uniform-es.org) • 4755 East Philadelphia Street, Ontario, California 91761-2816 – USA





# EVALUATION REPORT

Number:

**UEL-5002**

Originally Issued: 07/16/2015

Revised: 07/31/2018

Valid Through: 07/31/2019

**Brian Gerber, P.E., S.E.**  
Vice President, Technical Operations  
Uniform Evaluation Service

**Richard Beck, PE, CBO, MCP**  
Vice President, Uniform Evaluation Service

**GP Russ Chaney**  
CEO, The IAPMO Group

For additional information about this evaluation report please visit  
[www.uniform-es.org](http://www.uniform-es.org) or email at [info@uniform-es.org](mailto:info@uniform-es.org)