



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

BAILEY METAL PRODUCTS LIMITED
1 Caldari Road
Concord, ON L4K 3Z9
CANADA
(905) 738-9267
www.bmp-group.com

COMSLAB FLOOR SYSTEM

CSI Sections:

- 05 00 00 Metals
- 05 31 00 Steel Decking
- 05 31 13 Steel Floor Decking

1.0 RECOGNITION

The ComSlab Floor System has been evaluated as floor deck in compliance with IBC Section 2210.1.1. The floor system has been evaluated for composition and structural performance. The ComSlab Floor System evaluated in this report complies with or is a satisfactory alternative to the following codes and regulations:

- 2018, 2015, and 2012 International Building Code® (IBC)
- 2018, 2015, and 2012 International Residential Code® (IRC)
- 2019 California Building Code (CBC) Title 24 Part 2 – attached supplement
- 2020 Florida Building Code, Building (FBC, Building) – attached supplement
- 2014 New York City Building Code (NYCBC) – attached supplement
- 2019 Chicago Building Code (Title 14B) – attached supplement

2.0 LIMITATIONS

Use of the ComSlab Floor System recognized in this report is subject to the following:

2.1 The CS210 and CS120 ComSlab deck systems are manufactured, identified, and installed in accordance with this report, the IBC, and ComSlab's published installation instructions. If there is a conflict between manufacturers' published installation instructions and this report, the more restrictive shall take precedence.

2.2 Concrete-filled sections shall not be used to support loads that are predominantly vibratory except where vibration effects are considered in the structural analyses.

2.3 Use as part of the lateral force-resisting system is beyond the scope of this report.

2.4 Penetrations in the floor system shall be determined by the structural designer and approved by the building official.

2.5 Special inspections shall be provided in accordance with Section 3.4 of this report.

2.6 Calculations and details demonstrating that the loads applied to the decks comply with this report shall be submitted to the building official for approval. Calculations and drawings shall be prepared, signed, and sealed by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.

2.7 Bundles marked in accordance with Section 5.0 of this report provide the material traceability required to conform to the requirements of Section 2202.1 of the 2018 IBC (Section 2203.1 of the 2015 and 2012 IBC) and, for applications under the 2012 IBC, Table 1705.2.2, Item 1 of the 2012 IBC.

3.0 PRODUCT USE

3.1 General: The ComSlab Floor System provides an in-place steel forming system and is used in conjunction with structural concrete topping and reinforcing bars as floors to support the code-required floor loads.

3.2 Design

3.2.1 General: Design for deck-only capacities shall comply with IBC Section 2210 and AISI S100. Section Properties and design base-metal thicknesses are provided in Tables 1, 2, 3, and 4 of this report. The system may also be used where an engineering design is submitted in accordance with Section R301.1.3 of the IRC.

3.2.2 Web Crippling: The ComSlab deck panels shall bear a minimum of 2 inches onto the support structure and a minimum of 4 inches at shoring supports unless a registered professional engineer designs adequate support to prevent web crippling from occurring. Tables 1, 2, 3, and 4 of this report are based on this support condition.

3.2.3 Vertical Loads: The composite deck, concrete fill, and concrete reinforcing resist out-of-plane vertical load and resistance factor design (LRFD) superimposed design live loads as specified in Tables 1, 2, 3, and 4 of this report. The tabulated loads have been reduced by the Load Factor of 1.6. All LRFD superimposed load (dead, live, wind, earthquake, etc.) combinations shall be determined by the structural designer in accordance with IBC Section 1605.2. The results shall be less than the corresponding tabulated design live load.

The product described in this Uniform Evaluation Service (UES) Report has been evaluated as an alternative material, design or method of construction in order to satisfy and comply with the intent of the provision of the code, as noted in this report, and for at least equivalence to that prescribed in the code in quality, strength, effectiveness, fire resistance, durability and safety, as applicable, in accordance with IBC Section 104.11. This document shall only be reproduced in its entirety.

Copyright © 2023 by International Association of Plumbing and Mechanical Officials. All rights reserved. Printed in the United States. Ph: 1-877-4IESRPT • Fax: 909.472.4171
web: www.uniform-es.org • 4755 East Philadelphia Street, Ontario, California 91761-2816 – USA



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

EXAMPLE:

Steel deck CS120 - Design thickness = 0.0375 in.;
yield stress = 50 ksi
Reinforcing steel - Bar number = 8; yield stress = 60 ksi
Concrete - Normal weight = 145 lb/ft³
Overall slab depth = 10.5 in.
Single span length = 24.0 ft

Applied Loads

Superimposed dead load

$$\begin{aligned} \text{a) Floor finish} &= 8.5 \text{ psf} \\ \text{b) Partitions} &= \underline{14.5 \text{ psf}} \\ \text{DL} &= 23.0 \text{ psf} \end{aligned}$$

Live load LL = 100 psf

$$\text{Total applied load} = \{1.2/1.6(\text{DL}) + \text{LL}\} = \{0.75(23.0) + 100\} = \underline{117 \text{ psf}}$$

From the appropriate table on page 19 of this report, the maximum total load is 138 psf

When the load span exceeds the maximum unshored span in the tables, shoring shall be provided. The shoring shall be designed by the structural designer and shown at specified locations on the construction documents. Shoring removal shall comply with ACI 318-14 Section 26.11.2 or ACI 318-11 Section 6.2. Out-of-plane loads may include upward and downward vertical seismic effects, upward and downward loads due to wind, and downward loads due to transient effects and gravity. The deflections due to the dead weight of the concrete slab shall be determined in accordance with Eq.-1:

$$\Delta_{sw} = \frac{SWDP \times L^4}{10^6} \quad \text{Eq.-1}$$

Where:

Δ_{sw} = deflection due to slab weight, in.

SWDP = slab weight deflection parameter from load table.

L = load span, ft.

The maximum superimposed unfactored load that causes the concrete-filled deck to deflect to a specified limit shall be determined in accordance with Eq.-2:

$$w_d = \frac{\text{SLDP} \times 10^6}{\text{DC} \times (L)^3} \quad \text{Eq.-2}$$

Where:

w_d = Maximum deflection load, psf

SLDP = Deflection parameter from load table,

DC = Deflection constant such as 360

L = Span length, feet

EXAMPLE:

Base steel thickness - 0.0375 in.
Bar number - 9
Slab depth - 10.5 in.
Span length, L, - 24 feet
From the table on page 20, SLDP = 778
Assume DC = 360

Using Eq.-2:

$$w_d = \frac{778 \times 10^6}{360 \times (24)^3} = \underline{156 \text{ psf}}$$

For confirmation of values, the appropriate load tables shall be reviewed.

3.2.4 Support Connections: The connection of the deck and end closure to the structure shall be with welds, power-actuated fasteners, or self-drilling screws complying with Section 4.6 of this report and as designed and specified by the registered design professional based on requirements in ANSI/SDI NC. A minimum of one fastener per deck panel is required at each support. Fastener spacing shall be 24 inches on center maximum for supports parallel to the panels. Other fasteners suitable for the deck and supporting member shall be designed and specified by the registered design professional and approved by the building official.

3.3 Installation

3.3.1 Deck Panels: The deck panels shall be fastened to the structural supports with fasteners described in Sections 3.2.4 and 4.6 of this report. The ends of the deck shall bear a minimum of 2 inches onto the support structure. Supports shall be structural steel complying with IBC Chapter 22 and AISC 360; structural concrete complying with IBC Chapter 19 and ACI 318; or structural masonry complying with IBC Chapter 21 and TMS 402. The End Closure shall be fixed to the support structure prior to the decking being installed, using a minimum of one fastener per deck unit. In addition to the main structural fastening, the profile top flanges are fixed to the upper flange of the End Closure using power-actuated or self-drilling fasteners at one per profile. Fasteners shall be driven such that there is tight contact between the fastener head and the attached panels. The male trough flange shall overlap the female trough flange. The fasteners used to connect the side-laps of the panels to each other shall be minimum No. 14 1/4-14x1 self-drilling screws spaced 13.8 inches on center maximum. Every side-lap fastener shall include a ComSlab pre-punched side-lap washer.

3.3.2 Reinforcing: The reinforcing bars shall be placed in each rib profile, with a 1.57-inch clear space between the bottom flange and the underside of the bars. Shrinkage and temperature reinforcement shall be provided above the top of the deck for both directions in accordance with ACI 318-14 Section 24.4 or ACI 318-11 Section 7.12.



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

3.3.3 Concrete: Concrete placement shall comply with applicable provisions of the IBC and ACI 318. Before concrete placement, steel decking shall be clean and free of dirt, grease, and other debris. Shoring shall be in place before concrete placement at the locations as specified in the tables of this report. The bearing width for the shoring supports shall be 4 inches minimum. Care shall be taken to avoid heaping of concrete in any location. Tables 1, 2, 3, and 4 of this report include construction live loads of 20 psf or 150 plf.

3.4 Special Inspection

3.4.1 Concrete: Continuous and periodic special inspection for concrete and concrete reinforcement shall be in accordance with IBC Section 1705.3. The inspector's duties include sampling and testing, and verification of concrete mixes, reinforcement types and placement, concrete placement, observing sampling of concrete, field testing of fresh concrete, and the making of test specimens.

3.4.2 Steel Deck: Periodic special inspection for steel deck shall be in accordance with IBC Section 1705.2.2. The inspector's duties include verifying that the steel deck panels are of the type, size, grade, and condition specified on the approved plans and specifications and verifying the correct type, size, and location of fasteners, fastener holes, and installation for the type of connection are as specified on approved plans and specifications.

3.4.3 Statement of Special Inspections: A statement of special inspections shall be prepared by the registered design professional in charge and submitted to the building official as set forth in IBC Section 1704.3. The statement shall include the special inspector's duties noted in this section (Section 3.4 of this report).

4.0 PRODUCT DESCRIPTION

4.1 General: The ComSlab Floor System consists of cold-formed steel deck panels and end closures, concrete, reinforcing bars, welded wire reinforcement, and mechanical fasteners. The system complies with ANSI/SDI-NC.

4.2 ComSlab Deck Panels: The ComSlab deck panels are cold-formed from steel sheets into panels that resemble a fluted, flared, hat section with embossments in the webs and flange. The deck panels are available in three design thicknesses, 0.0375 inch, 0.0435 inch, and 0.0495 inch. The ends of the deck are provided with a separate end closure to provide additional web crippling strength and a permanent deck end closure to minimize grout loss during concrete placement. Steel sheets complying with ASTM A653 SS Grade 55 are cold-formed into deck shapes and closure elements having a minimum G90 galvanization coating (total on both surfaces). Panel dimensions and profiles are shown in the tables and figures of this report.

4.3 Concrete Fill: The deck panels are designed to be used with sand-lightweight or normal-weight concrete complying

with IBC Sections 1901 and 1904 and having a minimum 28-day compressive strength of 4,000 psi and proportioned in accordance with ACI 318. Normal-weight structural concrete [$w = 145$ to 150pcf] shall have aggregate conforming to ASTM C33. Sand lightweight structural concrete [$w = 110$ to 115pcf] shall have fine aggregate conforming to ASTM C33 and coarse aggregate conforming to ASTM C330. The concrete shall extend a minimum of 2.5 inches above the top surface of the steel deck panel and shall be reinforced with a single reinforcing bar in the bottom of each flute.

4.4 Reinforcing Bars: The reinforcing bars (rebar) shall comply with ASTM A615, A706, or A996, minimum Grade 60, and range in size from No. 3 to No. 11 ($\frac{3}{8}$ inch to $1\frac{1}{8}$ inch diameter).

4.5 Shrinkage and Temperature Control Reinforcement: The reinforcing in the top of the concrete is required for shrinkage and temperature control and shall be with a minimum area of 0.00075 times the area of concrete above the deck, and not less than $6 \times 6 \text{ W1.4} \times \text{W1.4}$ steel welded wire plain reinforcement complying with ASTM A1064, placed above the top of the steel deck and positioned towards the top of the slab with a minimum $\frac{3}{4}$ inch cover. In place of steel welded wire, fibers may be substituted. The fibers shall be specifically recognized for use in concrete-filled steel decks by an evaluation report issued by an approved evaluation service agency.

4.6 Fasteners: The fasteners used to connect the side-laps of the panels to each other and the end closures to the structure and the deck shall be self-drilling screws complying with Section J4 of AISI S100 (Section E4 of AISI S100 for the 2015 and 2012 IBC) or an evaluation report issued by an approved evaluation service agency. The fasteners used to connect the deck panels to the supporting structure shall be welds, self-drilling screws, or power-actuated fasteners complying with Sections J2, J4, or J5, respectively, of AISI S100 (Sections E2, E4, or E5, respectively, of AISI S100 for the 2015 and 2012 IBC); or an evaluation report issued by an approved evaluation service agency. The capacity of the screws and power-actuated fasteners to the supporting material (steel, concrete, or masonry) shall be documented in an evaluation report issued by an approved evaluation service agency.

4.7 Accessories: End Closures are fabricated using G90 galvanized steel sheet, 0.060 inch in thickness. Side-lap Washers are fabricated using G60 galvanized steel sheet, 0.048 inch in thickness.

5.0 IDENTIFICATION

Each bundle of decking is marked with labels with the Bailey Metal Products Limited name, the deck type, the minimum base-metal thickness (uncoated), the minimum specified yield strength, and the Evaluation Report number ER-277.



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

Either IAPMO UES Mark of Conformity may also be used as shown below:



or



IAPMO UES ER-277

6.0 SUBSTANTIATING DATA

6.1 Manufacturer's descriptive literature and installation instructions.

6.2 Test reports from laboratories in compliance with ISO/IEC 17025.

6.3 Data in accordance with IAPMO UES EC 007-2020, Evaluation Criteria for Steel Composite, Non-Composite, and Roof Deck Construction.

6.4 Quality Assurance Documentation.

7.0 STATEMENT OF RECOGNITION

This evaluation report describes the results of research completed by IAPMO Uniform Evaluation Service on the ComSlab Floor System to assess its conformance to the codes shown in Section 1.0 of this report and documents the product's certification.

For additional information about this evaluation report please visit
www.uniform-es.org or email us at info@uniform-es.org



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #3 REBAR


Base Steel Thickness = 0.0375"		IMPERIAL UNITS							
# 3 Rebar		Area of Steel Deck Included							
		Light Weight Concrete = 110 lb/ft³							
SLAB WEIGHT (psf)	40.2	44.8	49.3	53.9	58.5	63.1	67.7	72.3	
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	13.6	13.0	12.5	12.1	11.7	11.3	11.0	10.6	
MAX. UNSHORED TWO SPAN (ft)	11.0	10.2	9.5	8.9	8.3	7.8	7.4	7.0	
MAX. UNSHORED THREE SPAN (ft)	12.5	11.6	10.8	10.1	9.5	8.9	8.4	8.0	
I_u (in⁴)	47.2	54.0	61.2	69.0	77.5	86.6	97	108	
I_c (in⁴)	18.6	20.7	22.9	25.3	27.9	30.6	33.4	36.4	
DEFLECTION PARAMETER (SLDP)	518	588	662	742	829	922	1023	1132	
DEFLECTION PARAMETER (SWDP)	0.649	0.632	0.615	0.596	0.576	0.555	0.534	0.513	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	14.0	184	195	206	216	227	238	249	259
	14.5	170	179	189	199	209	218	228	238
	15.0	157	166	174	183	192	201	210	219
	15.5	145	153	161	169	177	185	193	202
	16.0	134	141	149	156	164	171	178	186
	16.5	124	131	138	144	151	158	165	171
	17.0	115	121	128	134	140	146	152	158
	17.5	107	113	118	124	130	135	141	146
	18.0	100	105	110	115	120	125	130	135
	18.5	93	97	102	107	111	116	121	125
	19.0	86	91	95	99	103	107	112	116
	19.5	80	84	88	92	96	100	104	107
	20.0	75	78	82	85	89	92	96	99
	20.5	70	73	76	79	83	86	89	92
	21.0	65	68	71	74	77	79	82	85
	21.5	61	63	66	68	71	74	76	79
	22.0	57	59	61	64	66	68	70	73
	22.5	53	55	57	59	61	63	65	67
	23.0	49	51	53	55	57	58	60	62
	23.5	46	48	49	51	52	54	55	57
	24.0	43	44	46	47	48	50	51	52
	24.5		41	42	43	45	46	47	48
	25.0			40	41	42	43	44	

TABLE 1: CS210 LWC - #3 REBAR

Base Steel Thickness = 0.0495"		IMPERIAL UNITS							
# 3 Rebar		Area of Steel Deck Included							
		Light Weight Concrete = 110 lb/ft³							
SLAB WEIGHT (psf)	41.0	45.6	50.1	54.7	59.3	63.9	68.5	73.1	
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	18.7	18.0	17.3	16.8	16.3	15.8	15.4	15.0	
MAX. UNSHORED TWO SPAN (ft)	18.6	17.2	16.0	15.0	14.1	13.3	12.6	11.9	
MAX. UNSHORED THREE SPAN (ft)	21.1	19.6	18.2	17.0	16.0	15.1	14.3	13.6	
I_u (in⁴)	49.2	56.2	63.7	71.8	80.6	90.1	101	112	
I_c (in⁴)	21.9	24.5	27.2	30.2	33.4	36.8	40.4	44.2	
DEFLECTION PARAMETER (SLDP)	559	635	716	803	897	998	1108	1226	
DEFLECTION PARAMETER (SWDP)	0.635	0.618	0.600	0.581	0.561	0.541	0.520	0.499	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	14.0	241	257	273	289	306	322	338	354
	14.5	223	237	252	267	282	297	312	326
	15.0	206	220	233	247	260	274	288	301
	15.5	191	203	216	229	241	254	266	279
	16.0	177	189	200	212	224	235	247	258
	16.5	165	176	186	197	208	218	229	240
	17.0	154	163	173	183	193	203	213	222
	17.5	143	152	161	170	180	189	198	207
	18.0	134	142	150	159	167	176	184	193
	18.5	125	133	140	148	156	164	172	179
	19.0	117	124	131	138	146	153	160	167
	19.5	109	116	123	129	136	143	149	156
	20.0	102	109	115	121	127	133	139	146
	20.5	96	102	107	113	119	124	130	136
	21.0	90	95	101	106	111	116	122	127
	21.5	84	89	94	99	104	109	114	119
	22.0	79	84	88	93	97	102	106	111
	22.5	74	79	83	87	91	95	99	104
	23.0	70	74	78	81	85	89	93	97
	23.5	66	69	73	76	80	83	87	90
	24.0	62	65	68	71	75	78	81	84
	24.5	58	61	64	67	70	73	76	79
	25.0	54	57	60	63	65	68	71	73

TABLE 1: CS210 LWC - #3 REBAR

Base Steel Thickness = 0.0435"		IMPERIAL UNITS							
# 3 Rebar		Area of Steel Deck Included							
		Light Weight Concrete = 110 lb/ft³							
SLAB WEIGHT (psf)	40.6	45.2	49.7	54.3	58.9	63.5	68.1	72.7	
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	16.5	15.9	15.3	14.8	14.3	13.8	13.4	13.0	
MAX. UNSHORED TWO SPAN (ft)	14.6	13.5	12.6	11.7	11.0	10.4	9.8	9.3	
MAX. UNSHORED THREE SPAN (ft)	16.5	15.3	14.3	13.3	12.5	11.8	11.2	10.6	
I_u (in⁴)	48.1	55.1	62.4	70.4	79.0	88.3	99	110	
I_c (in⁴)	20.2	22.6	25.1	27.8	30.6	33.7	36.9	40.3	
DEFLECTION PARAMETER (SLDP)	538	611	688	772	862	960	1065	1179	
DEFLECTION PARAMETER (SWDP)	0.643	0.625	0.608	0.589	0.569	0.548	0.527	0.506	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	14.0	213	227	240	253	267	280	294	307
	14.5	197	209	221	234	246	258	271	283
	15.0	182	193	204	216	227	238	249	261
	15.5	168	179	189	199	210	220	230	241
	16.0	156	165	175	184	194	204	213	223
	16.5	145	154	162	171	180	189	197	206
	17.0	135	143	151	159	167	175	183	191
	17.5	125	133	140	148	155	162	170	177
	18.0	117	124	130	137	144	151	158	164
	18.5	109	115	122	128	134	140	147	153
	19.0	102	108	113	119	125	131	136	142
	19.5	95	100	106	111	116	121	127	132
	20.0	89	94	99	103	108	113	118	123
	20.5	83	88	92	96	101	105	110	114
	21.0	78	82	86	90	94	98	102	106
	21.5	73	77	80	84	88	91	95	99
	22.0	68	72	75	78	82	85	89	92
	22.5	64	67	70	73	76	79	83	86
	23.0	60	63	65	68	71	74	77	80
	23.5	56	59	61	64	66	69	71	74
	24.0	52	55	57	59	62	64	66	69
	24.5	49	51	53	55	57	60	62	64
	25.0	46	48	50	52	53	55	57	59

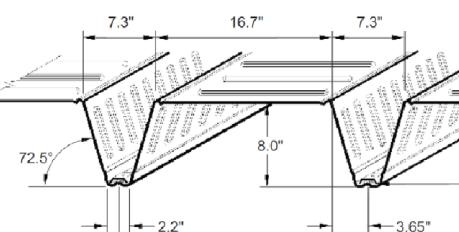



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #4 REBAR

Base Steel Thickness = 0.0375"						IMPERIAL UNITS					
# 4 Rebar						Area of Steel Deck Included					
SLAB WEIGHT (psf)						Light Weight Concrete = 110 lb/ft ³					
40.3	44.9	49.5	54.1	58.7	63.2	67.8	72.4				
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	13.6	13.0	12.5	12.1	11.6	11.3	10.9	10.6			
MAX. UNSHORED TWO SPAN (ft)	11.0	10.2	9.5	8.9	8.3	7.8	7.4	7.0			
MAX. UNSHORED THREE SPAN (ft)	12.5	11.6	10.8	10.1	9.4	8.9	8.4	8.0			
I _u (in ⁴)	48.3	55.2	62.6	70.6	79.2	88.6	99	110			
I _c (in ⁴)	20.4	22.8	25.3	27.9	30.8	33.8	37.0	40.3			
DEFLECTION PARAMETER (SLDP)	540	614	692	775	865	963	1067	1181			
DEFLECTION PARAMETER (SWDP)	0.637	0.620	0.603	0.584	0.565	0.545	0.524	0.503			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.	14.0	225	238	251	264	277	290	304	317		
	14.5	207	219	231	243	255	268	280	292		
	15.0	192	203	214	225	236	247	258	269		
	15.5	178	188	198	208	218	228	238	248		
	16.0	165	174	183	193	202	211	221	230		
	16.5	153	162	170	179	187	196	204	213		
	17.0	143	150	158	166	174	182	190	197		
	17.5	133	140	147	154	162	169	176	183		
	18.0	124	130	137	144	150	157	164	170		
	18.5	116	122	128	134	140	146	152	158		
	19.0	108	114	119	125	130	136	142	147		
	19.5	101	106	111	116	122	127	132	137		
	20.0	95	99	104	109	113	118	123	128		
	20.5	89	93	97	102	106	110	114	119		
	21.0	83	87	91	95	99	103	107	111		
	21.5	78	81	85	89	92	96	99	103		
	22.0	73	76	80	83	86	89	93	96		
	22.5	68	71	74	77	80	83	86	89		
	23.0	64	67	70	72	75	78	80	83		
	23.5	60	63	65	68	70	72	75	77		
	24.0	56	59	61	63	65	68	70	72		
	24.5	53	55	57	59	61	63	65	67		
	25.0	50	51	53	55	57	59	60	62		
	25.5	47	48	50	51	53	54	56	58		
	26.0	44	45	46	48	49	51	52	53		
	26.5	41	42	43	44	46	47	48	49		
	27.0			40	41	42	43	44	45		
	27.5					40	41	42			
	28.0										

TABLE 1: CS210 LWC - #4 REBAR

Base Steel Thickness = 0.0495"						IMPERIAL UNITS					
# 4 Rebar						Area of Steel Deck Included					
SLAB WEIGHT (psf)						Light Weight Concrete = 110 lb/ft ³					
41.1	45.7	50.3	54.9	59.4	64.0	68.6	73.2				
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	18.7	18.0	17.3	16.8	16.2	15.8	15.3	14.9			
MAX. UNSHORED TWO SPAN (ft)	18.5	17.2	16.0	15.0	14.1	13.3	12.6	11.9			
MAX. UNSHORED THREE SPAN (ft)	21.1	19.5	18.2	17.0	16.0	15.1	14.3	13.5			
I _u (in ⁴)	50.2	57.4	65.1	73.4	82.3	92.0	103	114			
I _c (in ⁴)	23.6	26.4	29.4	32.6	36.1	39.8	43.7	47.9			
DEFLECTION PARAMETER (SLDP)	581	659	744	834	932	1037	1150	1273			
DEFLECTION PARAMETER (SWDP)	0.625	0.607	0.589	0.570	0.551	0.531	0.510	0.490			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.	14.0	281	299	318	336	355	374	392	411		
	14.5	259	277	294	311	328	345	362	379		
	15.0	240	256	272	288	304	319	335	351		
	15.5	223	238	252	267	281	296	311	325		
	16.0	208	221	234	248	261	275	288	302		
	16.5	193	206	218	231	243	256	268	280		
	17.0	180	192	203	215	226	238	249	261		
	17.5	168	179	190	200	211	222	233	243		
	18.0	158	167	177	187	197	207	217	227		
	18.5	147	157	166	175	184	193	203	212		
	19.0	138	147	155	164	172	181	189	198		
	19.5	130	138	146	153	161	169	177	185		
	20.0	122	129	136	144	151	159	166	173		
	20.5	114	121	128	135	142	149	155	162		
	21.0	108	114	120	127	133	139	146	152		
	21.5	101	107	113	119	125	131	137	143		
	22.0	95	101	106	112	117	123	128	134		
	22.5	90	95	100	105	110	115	120	125		
	23.0	85	89	94	99	103	108	113	118		
	23.5	80	84	88	93	97	102	106	110		
	24.0	75	79	83	87	91	95	100	104		
	24.5	71	75	78	82	86	90	93	97		
	25.0	67	70	74	77	81	84	88	91		
	25.5	63	66	69	73	76	79	82	86		
	26.0	59	62	65	68	71	74	77	80		
	26.5	56	59	62	64	67	70	72	75		
	27.0	53	55	58	60	63	65	68	70		
	27.5	50	52	54	57	59	61	64	66		
	28.0	47	49	51	53	55	57	59	62		

TABLE 1: CS210 LWC - #4 REBAR

Base Steel Thickness = 0.0435"						IMPERIAL UNITS					
# 4 Rebar						Area of Steel Deck Included					
SLAB WEIGHT (psf)						Light Weight Concrete = 110 lb/ft ³					
40.7	45.3	49.9	54.5	59.0	63.6	68.2	72.8				
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	16.5	15.9	15.3	14.8	14.3	13.8	13.4	13.0			
MAX. UNSHORED TWO SPAN (ft)	14.5	13.5	12.5	11.7	11.0	10.4	9.8	9.3			
MAX. UNSHORED THREE SPAN (ft)	16.5	15.3	14.2	13.3	12.5	11.8	11.2	10.6			
I _u (in ⁴)	49.2	56.3	63.8	71.9	80.7	90.2	101	112			
I _c (in ⁴)	22.0	24.6	27.3	30.3	33.4	36.8	40.4	44.1			
DEFLECTION PARAMETER (SLDP)	560	636	717	804	898	999	1109	1227			
DEFLECTION PARAMETER (SWDP)	0.631	0.614	0.596	0.577	0.558	0.538	0.517	0.497			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.	14.0	253	269	285	301	317	333	349	365		
	14.5	234	248	263	278	292	307	322	336		
	15.0	216	230	243	257	270	284	297	311		
	15.5	201	213	225	238	250	263	275	287		
	16.0	187	198	209	221	232	244	255	266		
	16.5	174	184	195	205	216	226	237	247		
	17.0	1									



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #5 REBAR

Base Steel Thickness = 0.0375"		IMPERIAL UNITS									
# 5 Rebar		Area of Steel Deck Included									
		Light Weight Concrete = 110 lb/ft³									
SLAB WEIGHT (psf)	40.5	45.1	49.7	54.3	58.8	63.4	68.0	72.6			
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	14.1	13.5	12.9	12.4	12.0	11.6	11.3	11.0			
MAX. UNSHORED TWO SPAN (ft)	11.0	10.1	9.4	8.8	8.3	7.8	7.4	7.0			
MAX. UNSHORED THREE SPAN (ft)	12.5	11.5	10.7	10.0	9.4	8.9	8.4	8.0			
I_y (in⁴)	49.5	56.7	64.3	72.5	81.4	90.9	101	113			
I_c (in⁴)	22.6	25.3	28.1	31.1	34.3	37.7	41.3	45.1			
DEFLECTION PARAMETER (SLDP)	568	645	727	815	910	1012	1122	1241			
DEFLECTION PARAMETER (SWDP)	0.624	0.607	0.588	0.571	0.552	0.532	0.512	0.492			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.	14.0	285	302	319	336	353	370	387	404		
	14.5	263	279	294	310	326	341	357	373		
	15.0	244	258	273	287	301	316	330	345		
	15.5	227	240	253	266	280	293	306	319		
	16.0	211	223	235	247	260	272	284	296		
	16.5	196	208	219	230	241	253	264	275		
	17.0	183	194	204	215	225	235	246	256		
	17.5	171	181	190	200	210	219	229	239		
	18.0	160	169	178	187	196	205	214	223		
	18.5	150	158	167	175	183	191	200	208		
	19.0	141	148	156	164	171	179	187	194		
	19.5	132	139	146	153	160	167	175	182		
	20.0	124	131	137	144	150	157	163	170		
	20.5	117	123	129	135	141	147	153	159		
	21.0	110	115	121	127	132	138	143	149		
	21.5	103	108	114	119	124	129	135	140		
	22.0	97	102	107	112	117	121	126	131		
	22.5	92	96	101	105	109	114	118	123		
	23.0	86	90	95	99	103	107	111	115		
	23.5	81	85	89	93	97	100	104	108		
	24.0	77	80	84	87	91	94	98	101		
	24.5	72	76	79	82	85	89	92	95		
	25.0	68	71	74	77	80	83	86	89		
	25.5	65	67	70	73	75	78	81	84		
	26.0	61	63	66	68	71	73	76	78		
	26.5	58	60	62	64	67	69	71	73		
	27.0	54	56	58	60	63	65	67	69		
	27.5	51	53	55	57	59	61	62	64		
	28.0	48	50	52	53	55	57	58	60		

TABLE 1: CS210 LWC - #5 REBAR

Base Steel Thickness = 0.0495"		IMPERIAL UNITS									
# 5 Rebar		Area of Steel Deck Included									
		Light Weight Concrete = 110 lb/ft³									
SLAB WEIGHT (psf)	41.3	45.9	50.5	55.1	59.6	64.2	68.8	73.4			
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	19.1	18.5	17.8	17.2	16.7	16.2	15.8	15.4			
MAX. UNSHORED TWO SPAN (ft)	18.5	17.1	16.0	14.9	14.0	13.2	12.5	11.9			
MAX. UNSHORED THREE SPAN (ft)	21.0	19.5	18.1	17.0	16.0	15.1	14.2	13.5			
I_y (in⁴)	51.4	58.9	66.8	75.3	84.4	94.3	105	117			
I_c (in⁴)	25.7	28.8	32.1	35.6	39.4	43.5	47.8	52.3			
DEFLECTION PARAMETER (SLDP)	607	689	778	872	974	1084	1203	1330			
DEFLECTION PARAMETER (SWDP)	0.613	0.595	0.577	0.558	0.539	0.519	0.499	0.479			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.	14.0	343	366	389	411	434	457	480	502		
	14.5	318	339	360	381	402	423	444	465		
	15.0	295	314	334	353	372	392	411	431		
	15.5	274	292	310	328	346	364	382	400		
	16.0	255	272	289	305	322	338	355	372		
	16.5	238	254	269	285	300	315	331	346		
	17.0	223	237	251	266	280	294	309	323		
	17.5	208	222	235	248	262	275	288	302		
	18.0	195	208	220	233	245	257	270	282		
	18.5	183	195	206	218	229	241	253	264		
	19.0	172	183	194	204	215	226	237	248		
	19.5	162	172	182	192	202	212	222	232		
	20.0	152	162	171	181	190	199	209	218		
	20.5	143	152	161	170	179	187	196	205		
	21.0	135	143	152	160	168	176	184	193		
	21.5	128	135	143	151	158	166	174	181		
	22.0	121	128	135	142	149	156	164	171		
	22.5	114	121	127	134	141	147	154	161		
	23.0	108	114	120	126	133	139	145	151		
	23.5	102	108	113	119	125	131	137	143		
	24.0	96	102	107	113	118	124	129	135		
	24.5	91	96	101	107	112	117	122	127		
	25.0	86	91	96	101	105	110	115	120		
	25.5	82	86	91	95	100	104	109	113		
	26.0	77	82	86	90	94	98	102	107		
	26.5	73	77	81	85	89	93	97	101		
	27.0	70	73	77	80	84	88	91	95		
	27.5	66	69	73	76	79	83	86	89		
	28.0	63	66	69	72	75	78	81	84		

TABLE 1: CS210 LWC - #5 REBAR

Base Steel Thickness = 0.0435"		IMPERIAL UNITS									
# 5 Rebar		Area of Steel Deck Included									
		Light Weight Concrete = 110 lb/ft³									
SLAB WEIGHT (psf)	40.9	45.5	50.1	54.7	59.2	63.8	68.4	73.0			
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	16.9	16.3	15.7	15.2	14.7	14.2	13.8	13.4			
MAX. UNSHORED TWO SPAN (ft)	14.5	13.4	12.5	11.7	11.0	10.4	9.8	9.3			
MAX. UNSHORED THREE SPAN (ft)	16.5	15.3	14.2	13.3	12.5	11.8	11.1	10.6			
I_y (in⁴)	50.4	57.7	65.5	73.8	82.8	92.6	103	115			
I_c (in⁴)	24.1	27.0	30.1	33.4	36.9	40.6	44.6	48.7			
DEFLECTION PARAMETER (SLDP)	587	666	752	843	942	1048	1162	1285			
DEFLECTION PARAMETER (SWDP)	0.619	0.601	0.583	0.565	0.545	0.526	0.506	0.486			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.	14.0	314	334	354	374	394	414	434	454		
	14.5	291	309	328	346	364	383	401	419		
	15.0	270	287	304	321	337	354	371	388		
	15.5	251	266	282	298	313	329	344	360		
	16.0	233	248	262	277	291	306	320			



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #6 REBAR

Base Steel Thickness = 0.0375"		IMPERIAL UNITS							
# 6 Rebar		Area of Steel Deck Included							
		Light Weight Concrete = 110 lb/ft³							
SLAB WEIGHT (psf)	40.7	45.3	49.9	54.5	59.1	63.7	68.2	72.8	
CONCRETE VOLUME (yd³/100ft³)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	14.0	13.4	12.9	12.4	12.0	11.6	11.3	11.0	
MAX. UNSHORED TWO SPAN (ft)	10.9	10.1	9.4	8.8	8.3	7.8	7.4	7.0	
MAX. UNSHORED THREE SPAN (ft)	12.4	11.5	10.7	10.0	9.4	8.9	8.4	8.0	
I _y (in⁴)	51.0	58.4	66.3	74.7	83.9	93.7	104	116	
I _c (in⁴)	25.1	28.1	31.3	34.7	38.4	42.2	46.3	50.6	
DEFLECTION PARAMETER (SLDP)	599	681	768	861	962	1069	1185	1310	
DEFLECTION PARAMETER (SWDP)	0.610	0.592	0.574	0.556	0.537	0.518	0.499	0.479	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	14.0	345	366	387	408	429	449	470	491
	14.5	320	339	358	377	397	416	435	454
	15.0	297	314	332	350	368	385	403	421
	15.5	276	292	309	325	342	358	374	391
	16.0	257	272	287	303	318	333	348	363
	16.5	240	254	268	282	296	310	324	338
	17.0	224	237	250	263	276	289	303	316
	17.5	210	222	234	246	258	270	283	295
	18.0	197	208	219	231	242	253	264	276
	18.5	185	195	206	216	227	237	247	258
	19.0	173	183	193	203	212	222	232	242
	19.5	163	172	181	190	199	209	218	227
	20.0	154	162	170	179	187	196	204	213
	20.5	145	153	160	168	176	184	192	200
	21.0	136	144	151	159	166	173	181	188
	21.5	129	136	142	149	156	163	170	177
	22.0	122	128	134	141	147	154	160	166
	22.5	115	121	127	133	139	145	151	157
	23.0	109	114	120	125	131	136	142	148
	23.5	103	108	113	118	124	129	134	139
	24.0	97	102	107	112	117	121	126	131
	24.5	92	97	101	106	110	115	119	124
	25.0	87	91	96	100	104	108	112	117
	25.5	83	87	90	94	98	102	106	110
	26.0	78	82	86	89	93	96	100	104
	26.5	74	78	81	84	88	91	94	98
	27.0	70	74	77	80	83	86	89	92
	27.5	67	70	73	75	78	81	84	87
	28.0	63	66	69	71	74	77	79	82
	28.5	60	63	65	67	70	72	75	77
	29.0	57	59	61	64	66	68	70	73
	29.5	54	56	58	60	62	64	66	68
	30.0	51	53	55	57	59	61	62	64

TABLE 1: CS210 LWC - #6 REBAR

Base Steel Thickness = 0.0495"		IMPERIAL UNITS							
# 6 Rebar		Area of Steel Deck Included							
		Light Weight Concrete = 110 lb/ft³							
SLAB WEIGHT (psf)	41.5	46.1	50.7	55.3	59.9	64.4	69.0	73.6	
CONCRETE VOLUME (yd³/100ft³)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	19.0	18.4	17.8	17.2	16.7	16.2	15.8	15.4	
MAX. UNSHORED TWO SPAN (ft)	18.4	17.1	15.9	14.9	14.0	13.2	12.5	11.9	
MAX. UNSHORED THREE SPAN (ft)	21.0	19.4	18.1	16.9	15.9	15.0	14.2	13.5	
I _y (in⁴)	52.8	60.5	68.7	77.4	86.9	97.0	108	120	
I _c (in⁴)	28.0	31.4	35.1	39.1	43.3	47.7	52.5	57.5	
DEFLECTION PARAMETER (SLDP)	636	723	817	916	1024	1139	1263	1397	
DEFLECTION PARAMETER (SWDP)	0.600	0.581	0.563	0.545	0.526	0.507	0.487	0.468	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	14.0	402	429	456	482	509	536	562	589
	14.5	373	398	422	447	471	496	521	545
	15.0	347	369	392	415	438	460	483	506
	15.5	323	344	365	386	407	428	449	470
	16.0	301	320	340	360	379	399	418	438
	16.5	281	299	317	336	354	372	390	408
	17.0	263	280	297	314	331	348	365	382
	17.5	246	262	278	294	310	325	341	357
	18.0	231	246	261	275	290	305	320	334
	18.5	217	231	245	259	272	286	300	314
	19.0	204	217	230	243	256	269	282	294
	19.5	192	204	216	229	241	253	265	277
	20.0	181	193	204	215	227	238	249	260
	20.5	171	182	192	203	213	224	235	245
	21.0	162	171	181	191	201	211	221	231
	21.5	153	162	171	181	190	199	209	218
	22.0	144	153	162	171	179	188	197	206
	22.5	137	145	153	161	170	178	186	194
	23.0	130	137	145	153	160	168	176	183
	23.5	123	130	137	144	152	159	166	173
	24.0	116	123	130	137	144	150	157	164
	24.5	110	117	123	130	136	142	149	155
	25.0	105	111	117	123	129	135	141	147
	25.5	100	105	111	116	122	128	133	139
	26.0	95	100	105	110	116	121	126	132
	26.5	90	95	100	105	110	115	120	125
	27.0	85	90	95	99	104	109	113	118
	27.5	81	86	90	94	99	103	107	112
	28.0	77	81	85	89	94	98	102	106
	28.5	73	77	81	85	89	93	96	100
	29.0	70	73	77	81	84	88	91	95
	29.5	67	70	73	77	80	83	87	90
	30.0	63	66	70	73	76	79	82	85

TABLE 1: CS210 LWC - #6 REBAR

Base Steel Thickness = 0.0435"		IMPERIAL UNITS							
# 6 Rebar		Area of Steel Deck Included							
		Light Weight Concrete = 110 lb/ft³							
SLAB WEIGHT (psf)	41.1	45.7	50.3	54.9	59.5	64.1	68.6	73.2	
CONCRETE VOLUME (yd³/100ft³)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	16.9	16.3	15.7	15.2	14.7	14.2	13.8	13.4	
MAX. UNSHORED TWO SPAN (ft)	14.5	13.4	12.5	11.7	11.0	10.3	9.8	9.3	
MAX. UNSHORED THREE SPAN (ft)	16.4	15.2	14.2	13.3	12.5	11.8	11.1	10.6	
I _y (in⁴)	51.9	59.4	67.4	76.0	85.3	95.3	106	118	
I _c (in⁴)	26.6	29.8	33.2	36.9	40.8	45.0	49.4	54.1	
DEFLECTION PARAMETER (SLDP)	617	701	792	888	992	1104	1224	1353	
DEFLECTION PARAMETER (SWDP)	0.605	0.587	0.569	0.550	0.532	0.512	0.493	0.474	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	14.0	374	398	422	446	469	493	517	541
	14.5	347	369	391	413	435	457	479	500
	15.0	322	342	363	383	403	423	444	464
	15.5	300	318	337	356	375	394	412	431
	16.0	279	297	314	332	349	366	384	401
	16.5	261	277	293	309	325	342	358	374
	17.0	244	259	274	289	304	319	334	349
	17.5	228	242	256	270	284	298	312	326
	18.0	214	227	240	253	266			



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #7 REBAR

# 7 Rebar		IMPERIAL UNITS									
		Area of Steel Deck Included									
Base Steel Thickness = 0.0375"		Light Weight Concrete = 110 lb/ft ³									
SLAB WEIGHT (psf)		41.0	45.6	50.2	54.8	59.3	63.9	68.5	73.1		
CONCRETE VOLUME (yd ³ /100ft ²)		1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)		14.0	13.4	12.9	12.4	12.0	11.6	11.3	11.0		
MAX. UNSHORED TWO SPAN (ft)		10.9	10.1	9.4	8.8	8.3	7.8	7.4	7.0		
MAX. UNSHORED THREE SPAN (ft)		12.4	11.5	10.7	10.0	9.4	8.8	8.4	7.9		
I _u (in ⁴)		52.6	60.3	68.5	77.2	86.7	96.8	108	120		
I _c (in ⁴)		27.9	31.2	34.9	38.7	42.9	47.2	51.8	56.7		
DEFLECTION PARAMETER (SLDP)		633	720	813	912	1019	1133	1256	1388		
DEFLECTION PARAMETER (SWDP)		0.595	0.577	0.559	0.541	0.522	0.504	0.485	0.466		
SLAB THICKNESS (in.)		10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING		MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.		16.0	310	329	348	366	385	404	422	441	
		16.5	290	307	325	342	359	377	394	412	
		17.0	271	288	304	320	336	352	368	385	
		17.5	254	269	285	300	315	330	345	360	
		18.0	239	253	267	281	295	309	323	337	
		18.5	224	238	251	264	277	290	303	316	
		19.0	211	223	236	248	260	272	285	297	
		19.5	199	210	222	233	245	256	268	279	
		20.0	188	198	209	220	230	241	252	263	
		20.5	177	187	197	207	217	227	237	247	
		21.0	167	177	186	195	205	214	224	233	
		21.5	158	167	176	185	193	202	211	220	
		22.0	150	158	166	174	183	191	199	208	
		22.5	142	150	157	165	173	180	188	196	
		23.0	134	142	149	156	163	171	178	185	
		23.5	127	134	141	148	155	161	168	175	
		24.0	121	127	134	140	146	153	159	166	
		24.5	115	121	127	133	139	145	151	157	
		25.0	109	115	120	126	131	137	143	148	
		25.5	104	109	114	119	125	130	135	140	
		26.0	98	103	108	113	118	123	128	133	
		26.5	94	98	103	107	112	117	121	126	
		27.0	89	93	98	102	106	111	115	119	
		27.5	84.d	89	93	97	101	105	109	113	
		28.0	80.d	84	88	92	96	100	103	107	
		28.5	76.d	80	84	87	91	94	98	101	
		29.0	72.d	76	80	83	86	90	93	96	
		29.5	68.d	73	76	79	82	85	88	91	
		30.0	65.d	69	72	75	78	81	83	86	
		30.5	62.d	66	68	71	74	76	79	82	
		31.0	59.d	63	65	67	70	72	75	77	
		31.5	56.d	60	62	64	66	69	71	73	
		32.0	54.d	57	59	61	63	65	67	69	
		32.5	51.d	54	56	58	60	62	63	65	
		33.0	49.d	51	53	55	56	58	60	62	

TABLE 1: CS210 LWC - #7 REBAR

# 7 Rebar		IMPERIAL UNITS									
		Area of Steel Deck Included									
Base Steel Thickness = 0.0435"		Light Weight Concrete = 110 lb/ft ³									
SLAB WEIGHT (psf)		41.4	46.0	50.6	55.2	59.7	64.3	68.9	73.5		
CONCRETE VOLUME (yd ³ /100ft ²)		1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)		16.9	16.3	15.7	15.2	14.7	14.2	13.8	13.4		
MAX. UNSHORED TWO SPAN (ft)		14.4	13.3	12.4	11.6	10.9	10.3	9.8	9.3		
MAX. UNSHORED THREE SPAN (ft)		16.4	15.2	14.1	13.2	12.4	11.7	11.1	10.5		
I _u (in ⁴)		53.4	61.3	69.6	78.5	88.1	98.4	110	122		
I _c (in ⁴)		29.2	32.8	36.6	40.8	45.2	49.8	54.8	60.0		
DEFLECTION PARAMETER (SLDP)		650	740	836	938	1048	1166	1293	1429		
DEFLECTION PARAMETER (SWDP)		0.591	0.572	0.554	0.536	0.517	0.499	0.480	0.461		
SLAB THICKNESS (in.)		10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING		MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.		16.0	332	353	374	395	416	437	458	479	
		16.5	310	330	349	369	388	408	427	447	
		17.0	291	309	327	345	363	381	399	418	
		17.5	272	289	306	323	340	357	374	391	
		18.0	256	272	287	303	319	335	351	367	
		18.5	241	255	270	285	300	314	329	344	
		19.0	226	240	254	268	282	296	309	323	
		19.5	213	226	239	252	265	278	291	304	
		20.0	201	213	226	238	250	262	274	286	
		20.5	190	202	213	224	236	247	259	270	
		21.0	180	190	201	212	223	233	244	255	
		21.5	170	180	190	200	210	220	230	240	
		22.0	161	170	180	189	199	208	218	227	
		22.5	153	161	170	179	188	197	206	215	
		23.0	145	153	161	170	178	186	195	203	
		23.5	137	145	153	161	169	177	184	192	
		24.0	130	138	145	152	160	167	175	182	
		24.5	123.d	131	138	145	152	159	166	172	
		25.0	116.d	124	131	137	144	150	157	163	
		25.5	109.d	118	124	130	137	143	149	155	
		26.0	103.d	112	118	124	130	135	141	147	
		26.5	97.d	107	112	118	123	129	134	139	
		27.0	92.d	102	107	112	117	122	127	132	
		27.5	87.d	97	101	106	111	116	121	126	
		28.0	82.d	92	97	101	106	110	115	120	
		28.5	78.d	88	92	96	100	105	109	113	
		29.0	74.d	83	87	91	95	99	103	107	
		29.5	70.d	79	83	87	91	94	98	102	
		30.0	67.d	76	79	83	86	90	93	97	
		30.5	64.d	72	75	79	82	85	88	92	
		31.0	61.d	69	72	75	78	81	84	87	
		31.5	58.d	65	68	71	74	77	80	83	
		32.0	55.d	62	65	68	70	73	76	78	
		32.5	53.d	59	62	64	67	69	72	74	
		33.0	52.d	59.d	65	67	70	73	76	79	</



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #8 REBAR

# 8 Rebar		IMPERIAL UNITS					
Base Steel Thickness = 0.0375"		Area of Steel Deck Included					
		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	41.3	45.9	50.5	55.1	59.7	64.2	68.8
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18
MAX. UNSHORED ONE SPAN (ft)	14.0	13.4	12.9	12.4	12.0	11.6	11.3
MAX. UNSHORED TWO SPAN (ft)	10.8	10.0	9.4	8.8	8.2	7.8	7.3
MAX. UNSHORED THREE SPAN (ft)	12.3	11.4	10.6	10.0	9.4	8.8	8.4
I_u (in⁴)	54.2	62.3	70.8	79.9	89.7	100.2	112
I_c (in⁴)	30.7	34.5	38.6	43.0	47.6	52.6	57.8
DEFLECTION PARAMETER (SLDP)	668	762	861	967	1080	1202	1332
DEFLECTION PARAMETER (SWDP)	0.581	0.562	0.544	0.525	0.507	0.489	0.470
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)					
To be established by the designer.	16.0	370	393	416	438	461	484
	16.5	346	367	389	410	431	452
	17.0	324	344	364	384	403	423
	17.5	304	323	341	360	378	396
	18.0	286	303	320	338	355	372
	18.5	269	285	301	317	334	350
	19.0	253	269	284	299	314	329
	19.5	239	253	267	282	296	310
	20.0	226	239	252	266	279	292
	20.5	213	226	238	251	263	276
	21.0	200.d	214	225	237	249	261
	21.5	187.d	202	213	224	235	246
	22.0	174.d	192	202	212	223	233
	22.5	163.d	182	191	201	211	221
	23.0	153.d	172	182	191	200	209
	23.5	143.d	163.d	172	181	190	198
	24.0	134.d	153.d	164	172	180	188
	24.5	126.d	144.d	156	163	171	179
	25.0	119.d	135.d	148	155	162	170
	25.5	112.d	128.d	141	148	154	161
	26.0	106.d	120.d	134	140	147	153
	26.5	100.d	114.d	127	134	140	146
	27.0	94.d	108.d	121	127	133	139
	27.5	89.d	102.d	115.d	121	126	132
	28.0	85.d	96.d	109.d	115	120	126
	28.5	80.d	91.d	103.d	110	115	119
	29.0	76.d	87.d	98.d	105	109	114
	29.5	72.d	82.d	93.d	100	104	108
	30.0	69.d	78.d	89.d	95	99	103
	30.5	65.d	75.d	84.d	91	94	98
	31.0	62.d	71.d	80.d	86	90	94
	31.5	59.d	68.d	77.d	82	86	89
	32.0	57.d	65.d	73.d	79	82	85
	32.5	54.d	62.d	70.d	75	78	81
	33.0	52.d	59.d	67.d	71	74	77

TABLE 1: CS210 LWC - #8 REBAR

# 8 Rebar		IMPERIAL UNITS					
Base Steel Thickness = 0.0435"		Area of Steel Deck Included					
		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	41.7	46.3	50.9	55.5	60.1	64.6	69.2
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18
MAX. UNSHORED ONE SPAN (ft)	16.8	16.2	15.7	15.2	14.6	14.2	13.8
MAX. UNSHORED TWO SPAN (ft)	14.3	13.3	12.4	11.6	10.9	10.3	9.7
MAX. UNSHORED THREE SPAN (ft)	16.3	15.1	14.1	13.2	12.4	11.7	11.1
I_u (in⁴)	55.1	63.3	71.9	81.2	91.1	101.8	113
I_c (in⁴)	32.0	36.0	40.3	44.9	49.8	55.0	60.6
DEFLECTION PARAMETER (SLDP)	685	781	883	992	1108	1234	1366
DEFLECTION PARAMETER (SWDP)	0.578	0.585	0.540	0.521	0.503	0.484	0.466
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)					
To be established by the designer.	16.0	391	416	441	466	491	516
	16.5	366	389	413	436	459	482
	17.0	343	365	386	408	430	452
	17.5	322	342	362	383	403	423
	18.0	303	322	341	360	379	398
	18.5	285	303	320	338	356	374
	19.0	268	285	302	318	335	352
	19.5	253	269	285	300	316	332
	20.0	238.d	254	269	283	298	313
	20.5	221.d	240	254	268	282	295
	21.0	205.d	227	240	253	266	279
	21.5	191.d	215	227	240	252	264
	22.0	179.d	204.d	215	227	239	250
	22.5	167.d	190.d	204	215	226	237
	23.0	156.d	178.d	194	204	214	225
	23.5	147.d	167.d	184	194	203	213
	24.0	138.d	157.d	175	184	193	202
	24.5	129.d	147.d	166	175	184	192
	25.0	122.d	139.d	157.d	166	175	183
	25.5	115.d	131.d	148.d	158	166	174
	26.0	108.d	123.d	140.d	151	158	165
	26.5	102.d	117.d	132.d	143	150	157
	27.0	97.d	110.d	125.d	137	143	150
	27.5	92.d	104.d	118.d	130	136	143
	28.0	87.d	99.d	112.d	124	130	136
	28.5	82.d	94.d	106.d	118	124	135
	29.0	78.d	89.d	101.d	113	118	123
	29.5	74.d	84.d	96.d	107.d	113	123
	30.0	70.d	80.d	91.d	102.d	107	112
	30.5	67.d	76.d	86.d	97.d	102	111
	31.0	64.d	73.d	82.d	92.d	98	102
	31.5	61.d	69.d	78.d	88.d	93	97
	32.0	58.d	66.d	75.d	84.d	89	93
	32.5	55.d	63.d	71.d	80.d	85	88
	33.0	53.d	60.d	68.d	77.d	81	84

TABLE 1: CS210 LWC - #8 REBAR

# 8 Rebar		IMPERIAL UNITS					
Base Steel Thickness = 0.0495"		Area of Steel Deck Included					
		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	42.1	46.7	51.3	55.9	60.5	65.0	69.6
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18
MAX. UNSHORED ONE SPAN (ft)	19.0	18.4	17.7	17.2	16.6	16.2	15.3
MAX. UNSHORED TWO SPAN (ft)	18.3	17.0	15.8	14.8	13.9	13.1	12.4
MAX. UNSHORED THREE SPAN (ft)	20.8	19.3	18.0	16.8	15.8	14.9	13.4
I_u (in⁴)	56.0	64.3	73.1	82.5	92.6	103.4	115.2
I_c (in⁴)	33.4	37.5	42.0	46.9	52.0	57.5	63.4
DEFLECTION PARAMETER (SLDP)	703	801	906	1018	1138	1266	1404
DEFLECTION PARAMETER (SWDP)	0.573	0.581	0.535	0.517	0.498	0.480	0.463
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)					
To be established by the designer.	16.0	412	439	466	493	520	547
	16.5	385	411	436	461	486	512
	17.0	361	385	408	432	456	479
	17.5	339	361	383	405	427	450
	18.0	319	339	360	381	401	422
	18.5	300	319	339	358	378	397
	19.0	283	301	319	337	356	374
	19.5	263.d	284	301	318	335	353
	20.0	244.d	268	284	300	317	333
	20.5	227.d	254	269	284	299	314
	21.0	211.d	240	254	269	283	297
	21.5	197.d	224.d	241	254	268	281
	22.0	183.d	209.d	228	241	254	267
	22.5	171.d	195.d	217	229	241	253
	23.0	161.d	183.d	206	217	228	240
	23.5	151.d	171.d	194.d	206	217	228
	24.0	141.d	161.d	182.d	196	206	216
	24.5	133.d	151.d	171.d	186	196	205
	25.0	125.d	142.d	161.d	177	186	195
	25.5	118.d	134.d	152.d	169	177	186
	26.0	111.d	127.d	143.d	161	169	177
	26.5	105.d	120.d	135.d	152.d	161	169
	27.0	99.d	113.d	128.d	144.d	153	161
	27.5	94.d	107.d	121.d	136.d	146	153
	28.0	89.d	101.d	115.d	129.d	139	146
	28.5	84.d	96.d	109.d	122.d	133	139
	29.0	80.d	91.d	103.d	116.d	127	133
	29.5	76.d</					



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #9 REBAR

Base Steel Thickness = 0.0375"				IMPERIAL UNITS					
# 9 Rebar				Area of Steel Deck Included					
				Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	41.7	46.3	50.8	55.4	60.0	64.6	69.2	73.8	
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	13.9	13.3	12.8	12.4	11.9	11.6	11.2	10.9	
MAX. UNSHORED TWO SPAN (ft)	10.8	10.0	9.3	8.7	8.2	7.7	7.3	7.0	
MAX. UNSHORED THREE SPAN (ft)	12.3	11.4	10.6	9.9	9.3	8.8	8.3	7.9	
I _w (in⁴)	56.0	64.5	73.4	82.9	93.0	104.0	116	128	
I _c (in⁴)	33.8	38.0	42.6	47.5	52.8	58.3	64.2	70.4	
DEFLECTION PARAMETER (SLDP)	706	806	913	1026	1147	1277	1415	1564	
DEFLECTION PARAMETER (SWDP)	0.567	0.547	0.528	0.510	0.492	0.474	0.456	0.438	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	18.0	336.d	360	381	402	423	444	465	486
	18.5	310.d	339	358	378	398	417	437	457
	19.0	286.d	319	338	356	375	393	412	430
	19.5	265.d	302	319	336	354	371	388	406
	20.0	245.d	280.d	301	318	334	350	366	383
	20.5	228.d	260.d	285	300	316	331	346	362
	21.0	212.d	242.d	270	284	299	313	328	342
	21.5	197.d	225.d	255.d	269	283	296	310	324
	22.0	184.d	210.d	238.d	255	268	281	294	307
	22.5	172.d	197.d	223.d	242	254	267	279	291
	23.0	161.d	184.d	208.d	230	241	253	264	276
	23.5	151.d	173.d	195.d	219	229	240	251	262
	24.0	142.d	162.d	183.d	206.d	218	228	239	249
	24.5	133.d	152.d	172.d	194.d	207	217	227	237
	25.0	126.d	143.d	162.d	182.d	197	207	216	225
	25.5	118.d	135.d	153.d	172.d	188	197	205	214
	26.0	112.d	127.d	144.d	162.d	179	187	196	204
	26.5	105.d	120.d	136.d	153.d	171	179	186	194
	27.0	100.d	114.d	129.d	145.d	162.d	170	178	185
	27.5	94.d	108.d	122.d	137.d	153.d	162	169	176
	28.0	89.d	102.d	115.d	130.d	145.d	155	162	168
	28.5	85.d	97.d	110.d	123.d	138.d	148	154	160
	29.0	80.d	92.d	104.d	117.d	131.d	141	147	153
	29.5	76.d	87.d	99.d	111.d	124.d	135	140	146
	30.0	73.d	83.d	94.d	106.d	118.d	129	134	139
	30.5	69.d	79.d	89.d	100.d	112.d	123	128	133
	31.0	66.d	75.d	85.d	96.d	107.d	117	122	127
	31.5	63.d	72.d	81.d	91.d	102.d	112	117	121
	32.0	60.d	68.d	77.d	87.d	97.d	107	112	116
	32.5	57.d	65.d	74.d	83.d	93.d	103	107	111
	33.0	55.d	62.d	71.d	79.d	89.d	98	102	106
	33.5	52.d	60.d	67.d	76.d	85.d	94	97	101
	34.0	50.d	57.d	65.d	73.d	81.d	89	93	96
	34.5	48.d	55.d	62.d	69.d	78.d	86	89	92
	35.0	46.d	52.d	59.d	66.d	74.d	82	85	88

TABLE 1: CS210 LWC - #9 REBAR

Base Steel Thickness = 0.0495"				IMPERIAL UNITS					
# 9 Rebar				Area of Steel Deck Included					
				Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	42.5	47.1	51.6	56.2	60.8	65.4	70.0	74.6	
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	18.9	18.3	17.7	17.1	16.6	16.1	15.7	15.3	
MAX. UNSHORED TWO SPAN (ft)	18.2	16.9	15.8	14.8	13.9	13.1	12.4	11.8	
I _w (in⁴)	57.8	66.4	75.6	85.3	95.8	107.0	119	132	
I _c (in⁴)	36.3	40.9	45.9	51.2	56.9	63.0	69.5	76.3	
DEFLECTION PARAMETER (SLDP)	740	844	956	1074	1202	1338	1484	1640	
DEFLECTION PARAMETER (SWDP)	0.561	0.540	0.521	0.503	0.484	0.466	0.448	0.430	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	18.0	352.d	395	419	444	468	493	517	542
	18.5	325.d	370.d	395	418	441	464	487	510
	19.0	300.d	342.d	372	394	416	437	459	480
	19.5	277.d	316.d	352	372	392	413	433	453
	20.0	257.d	293.d	332.d	351	371	390	409	428
	20.5	239.d	272.d	308.d	333	351	369	387	405
	21.0	222.d	253.d	287.d	315	332	349	366	383
	21.5	207.d	236.d	267.d	298	315	331	347	363
	22.0	193.d	220.d	249.d	280.d	298	314	329	344
	22.5	180.d	206.d	233.d	262.d	283	298	312	326
	23.0	169.d	193.d	218.d	245.d	269	283	296	310
	23.5	158.d	181.d	205.d	230.d	256	269	282	295
	24.0	149.d	170.d	192.d	216.d	241.d	256	268	280
	24.5	140.d	159.d	180.d	203.d	227.d	243	255	267
	25.0	132.d	150.d	170.d	191.d	214.d	232	243	254
	25.5	124.d	141.d	160.d	180.d	201.d	221	231	242
	26.0	117.d	133.d	151.d	170.d	190.d	211	221	230
	26.5	110.d	126.d	143.d	160.d	179.d	200.d	210	220
	27.0	104.d	119.d	135.d	152.d	170.d	189.d	201	210
	27.5	99.d	113.d	128.d	143.d	160.d	179.d	192	200
	28.0	94.d	107.d	121.d	136.d	152.d	169.d	183	191
	28.5	89.d	101.d	115.d	129.d	144.d	161.d	175	182
	29.0	84.d	96.d	109.d	122.d	137.d	152.d	167	174
	29.5	80.d	91.d	103.d	116.d	130.d	145.d	160	167
	30.0	76.d	87.d	98.d	111.d	124.d	138.d	153	159
	30.5	72.d	83.d	94.d	105.d	118.d	131.d	145.d	152
	31.0	69.d	79.d	89.d	100.d	112.d	125.d	138.d	146
	31.5	66.d	75.d	85.d	95.d	107.d	119.d	132.d	139
	32.0	63.d	72.d	81.d	91.d	102.d	113.d	126.d	133
	32.5	60.d	68.d	77.d	87.d	97.d	108.d	120.d	127
	33.0	57.d	65.d	74.d	83.d	93.d	103.d	115.d	122
	33.5	55.d	62.d	71.d	79.d	89.d	99.d	110.d	117
	34.0	52.d	60.d	68.d	76.d	85.d	95.d	105.d	112
	34.5	50.d	57.d	65.d	73.d	81.d	91.d	100.d	107
	35.0	48.d	55.d	62.d	70.d	78.d	87.d	96.d	102

TABLE 1: CS210 LWC - #9 REBAR

Base Steel Thickness = 0.0435"				IMPERIAL UNITS					
# 9 Rebar				Area of Steel Deck Included					
				Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	42.1	46.7	51.2	55.8	60.4	65.0	69.6	74.2	
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	16.8	16.2	15.6	15.1	14.6	14.2	13.7	13.3	
MAX. UNSHORED TWO SPAN (ft)	14.3	13.2	12.3	11.6	10.9	10.3	9.7	9.2	
I _w (in⁴)	56.9	65.4	74.4	84.1	94.4	105.5	117	130	
I _c (in⁴)	35.0	39.4	44.2	49.3	54.8	60.7	66.8	73.4	
DEFLECTION PARAMETER (SLDP)	722	825	933	1049	1174	1307	1449	1602	
DEFLECTION PARAMETER (SWDP)	0.564	0.540	0.525	0.507	0.488	0.470	0.452	0.434	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	18.0	344.d	378	400	423	446	469	491	514
	18.5	317.d	356	377	398	420	441	462	484
	19.0	293.d	334.d	355	375</td				



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #10 REBAR

Base Steel Thickness = 0.0375"

# 10 Rebar	IMPERIAL UNITS									
	Area of Steel Deck Included									
	Light Weight Concrete = 110 lb/ft³									
SLAB WEIGHT (psf)	42.1	46.7	51.3	55.9	60.5	65.1	69.6	74.2		
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)	13.9	13.3	12.8	12.3	11.9	11.5	11.2	10.9		
MAX. UNSHORED TWO SPAN (ft)	10.7	9.9	9.3	8.7	8.2	7.7	7.3	6.9		
MAX. UNSHORED THREE SPAN (ft)	12.2	11.3	10.5	9.9	9.3	8.8	8.3	7.9		
I _u (in⁴)	58.1	67.0	76.3	86.3	96.9	108.3	121	134		
I _c (in⁴)	37.2	42.0	47.2	52.7	58.6	64.9	71.6	78.6		
DEFLECTION PARAMETER (SLDP)	749	857	972	1093	1224	1363	1512	1671		
DEFLECTION PARAMETER (SWDP)	0.553	0.532	0.513	0.494	0.476	0.458	0.441	0.423		
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)								
To be established by the designer.		18.0	357.d	408.d	454	479	505	531	556	582
		18.5	329.d	376.d	426.d	452	476	500	524	548
		19.0	303.d	347.d	393.d	426	449	471	494	516
		19.5	281.d	321.d	364.d	402	424	445	466	487
		20.0	260.d	298.d	337.d	380.d	400	420	441	461
		20.5	242.d	276.d	313.d	353.d	379	398	417	436
		21.0	225.d	257.d	291.d	328.d	359	377	395	413
		21.5	209.d	240.d	272.d	306.d	340	357	374	391
		22.0	195.d	224.d	253.d	285.d	319.d	339	355	371
		22.5	183.d	209.d	237.d	267.d	298.d	322	337	352
		23.0	171.d	196.d	222.d	250.d	279.d	306	320	335
		23.5	160.d	183.d	208.d	234.d	262.d	291	305	318
		24.0	151.d	172.d	195.d	220.d	246.d	274.d	290	303
		24.5	142.d	162.d	184.d	207.d	231.d	257.d	276	288
		25.0	133.d	152.d	173.d	194.d	218.d	242.d	263	275
		25.5	126.d	144.d	163.d	183.d	205.d	228.d	251	262
		26.0	118.d	135.d	154.d	173.d	193.d	215.d	239.d	250
		26.5	112.d	128.d	145.d	163.d	183.d	203.d	226.d	238
		27.0	106.d	121.d	137.d	154.d	173.d	192.d	213.d	228
		27.5	100.d	114.d	130.d	146.d	163.d	182.d	202.d	217
		28.0	95.d	108.d	123.d	138.d	155.d	172.d	191.d	208
		28.5	90.d	103.d	117.d	131.d	147.d	164.d	181.d	199
		29.0	85.d	98.d	111.d	125.d	139.d	155.d	172.d	190
		29.5	81.d	93.d	105.d	118.d	132.d	147.d	164.d	181.d
		30.0	77.d	88.d	100.d	112.d	126.d	140.d	156.d	172.d
		30.5	73.d	84.d	95.d	107.d	120.d	133.d	148.d	164.d
		31.0	70.d	80.d	91.d	102.d	114.d	127.d	141.d	156.d
		31.5	67.d	76.d	86.d	97.d	109.d	121.d	134.d	148.d
		32.0	64.d	73.d	82.d	93.d	104.d	116.d	128.d	142.d
		32.5	61.d	69.d	79.d	88.d	99.d	110.d	122.d	135.d
		33.0	58.d	66.d	75.d	85.d	95.d	105.d	117.d	129.d
		33.5	55.d	63.d	72.d	81.d	90.d	101.d	112.d	123.d
		34.0	53.d	61.d	69.d	77.d	86.d	96.d	107.d	118.d
		34.5	51.d	58.d	66.d	74.d	83.d	92.d	102.d	113.d
		35.0	49.d	56.d	63.d	71.d	79.d	88.d	98.d	108.d
		35.5	47.d	53.d	60.d	68.d	76.d	85.d	94.d	104.d
		36.0	45.d	51.d	58.d	65.d	73.d	81.d	90.d	99.d
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)								
To be established by the designer.		18.0	372.d	425.d	482.d	520	549	578	607	636
		18.5	343.d	392.d	444.d	490	517	545	572	599
		19.0	316.d	362.d	410.d	461.d	488	514	540	565
		19.5	293.d	335.d	379.d	427.d	461	485	510	534
		20.0	271.d	310.d	351.d	396.d	436	459	482	505
		20.5	252.d	288.d	326.d	367.d	411.d	434	456	478
		21.0	234.d	268.d	304.d	342.d	383.d	412	432	453
		21.5	218.d	250.d	283.d	318.d	357.d	391	410	429
		22.0	204.d	233.d	264.d	297.d	333.d	371.d	389	407
		22.5	191.d	218.d	247.d	278.d	311.d	347.d	370	387
		23.0	178.d	204.d	231.d	260.d	291.d	324.d	351	368
		23.5	167.d	191.d	217.d	244.d	273.d	304.d	334	350
		24.0	157.d	179.d	203.d	229.d	256.d	286.d	317.d	333
		24.5	148.d	169.d	191.d	215.d	241.d	268.d	298.d	318
		25.0	139.d	159.d	180.d	203.d	227.d	253.d	280.d	303
		25.5	131.d	150.d	170.d	191.d	214.d	238.d	264.d	289
		26.0	123.d	141.d	160.d	180.d	202.d	225.d	249.d	276.d
		26.5	117.d	133.d	151.d	170.d	190.d	212.d	235.d	260.d
		27.0	110.d	126.d	143.d	161.d	180.d	201.d	223.d	246.d
		27.5	104.d	119.d	135.d	152.d	170.d	190.d	211.d	233.d
		28.0	99.d	113.d	128.d	144.d	161.d	180.d	200.d	221.d
		28.5	94.d	107.d	121.d	137.d	153.d	171.d	189	209.d
		29.0	89.d	102.d	115.d	130.d	145.d	162.d	180.d	199.d
		29.5	85.d	97.d	110.d	123.d	138.d	154.d	171.d	189.d
		30.0	80.d	92.d	104.d	117.d	131.d	146.d	162.d	179.d
		30.5	76.d	87.d	99.d	112.d	125.d	139.d	154.d	171.d
		31.0	73.d	83.d	94.d	106.d	119.d	133.d	147.d	163.d
		31.5	69.d	79.d	90.d	101.d	113.d	126.d	140.d	155.d
		32.0	66.d	76.d	86.d	97.d	108.d	120.d	134.d	148.d
		32.5	63.d	72.d	82.d	92.d	103.d	115.d	128.d	141.d
		33.0	60.d	69.d	78.d	88.d	99.d	110.d	122.d	135.d
		33.5	58.d	66.d	75.d	84.d	94.d	105.d	117.d	129.d
		34.0	55.d	63.d	72.d	81.d	90.d	100.d	111.d	123.d
		34.5	53.d	60.d	68.d	77.d	86.d	96.d	107.d	118.d
		35.0	51.d	58.d	66.d	74.d	83.d	92.d	102.d	113.d
		35.5	49.d	55.d	63.d	71.d	79.d	88.d	98.d	108.d
		36.0	47.d	53.d	60.d	68.d	76.d	85.d	94.d	104.d
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)								
To be established by the designer.		18.0	372.d	425.d	482.d	520	549	578	607	636
		18.5	343.d	392.d	444.d	490	517	545	572	599
		19.0	316.d	362.d	410.d	461.d	488	514	540	565
		19.5	293.d	335.d	379.d	427.d	461	485	510	534
		20.0	271.d	310.d	351.d	396.d	436	459	482	505
		20.5	252.d	288.d	326.d	367.d	411.d	434	456	478
		21.0	234.d	268.d	304.d	342.d	383.d	412	432	453
		21.5	218.d	250.d	283.d	318.d	357.d	391	410	429
		22.0	204.d	233.d	264.d	297.d	333.d	371.d	389	407
		22.5	191.d	218.d	247.d	278.d	311.d	347.d	370	387
		23.0	178.d	204.d	231.d	260.d	291.d	324.d	351	368
		23.5	167.d	191.d	217.d	244.d	273.d	304.d	334	350
		24.0	157.d	179.d	203.d	229.d	256.d	286.d	317.d	333
		24.5	148.d	169.d	191.d	215.d	241.d	268.d	298.d	318
		25.0	139.d	159.d	180.d	203.d	227.d	253.d	280.d	303
		25.5	131.d	150.d	170.d	191.d	214.d	238.d	264.d	289
		26.0	123.d	141.d	160.d	180.d	202.d	225.d	249.d	276.d
		26.5	117.d	133.d	151.d	170.d	190.d	212.d	235.d	260.d
		27.0	110.d	126.d	143.d	161.d	180.d	201.d	223.d	246.d
		27.5	104.d	119.d	135.d	152.d	170.d	190.d	211.d	233.d
		28.0	99.d	113.d	128.d	144.d	161.d	180.d	200.d	221.d
		28.5	94.d	107.d	121.d	137.d	153.d	171.d	189	209.d
		29.0	89.d	102.d	115.d	130.d	145.d	162.d	180.d	199.d
		29.5	85.d	97.d	110.d	123.d	138.d	154.d	171.d	189.d
		30.0	80.d	92.d	104.d	117.d	131.d	146.d	162.d	179.d
		30.5	76.d	87.d	99.d	112.d	125.d	139.d	154.d	171.d
		31.0	73.d	83.d	94.d	106.d	119.d	133.d	147.d	163.d
		31.5	69.d	79.d	90.d	101.d	113.d	126.d	140.d	155.d
		32.0	66.d	76.d	86.d	97.d	108.d	120.d	134.d	148.d
		32.5	63.d	72.d	82.d	92.d	103			



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 1: CS210 LWC - #11 REBAR

Base Steel Thickness = 0.0375"										IMPERIAL UNITS										
# 11 Rebar										Area of Steel Deck Included										
										Light Weight Concrete = 110 lb/ft³										
SLAB WEIGHT (psf)	42.6	47.2	51.8	56.4	61.0	65.6	70.1	74.7		SLAB WEIGHT (psf)	43.0	47.6	52.2	56.8	61.4	66.0	70.5	75.1		
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)	13.8	13.3	12.7	12.3	11.9	11.5	11.2	10.9		MAX. UNSHORED ONE SPAN (ft)	16.7	16.1	15.5	15.0	14.5	14.1	13.7	13.3		
MAX. UNSHORED TWO SPAN (ft)	10.7	9.9	9.2	8.6	8.1	7.7	7.3	6.9		MAX. UNSHORED TWO SPAN (ft)	14.1	13.1	12.2	11.4	10.8	10.2	9.6	9.1		
MAX. UNSHORED THREE SPAN (ft)	12.1	11.2	10.5	9.8	9.2	8.7	8.3	7.8		MAX. UNSHORED THREE SPAN (ft)	16.0	14.9	13.9	13.0	12.2	11.6	10.9	10.4		
I _u (in⁴)	60.1	69.4	79.2	89.7	100.8	112.7	126	139		I _u (in⁴)	60.9	70.3	80.2	90.8	102.1	114.1	127	141		
I _c (in⁴)	40.5	45.9	51.7	57.9	64.5	71.6	79.0	86.9		I _c (in⁴)	41.6	47.1	53.1	59.5	66.3	73.6	81.3	89.5		
DEFLECTION PARAMETER (SLDP)	791	907	1080	1161	1301	1450	1609	1779		DEFLECTION PARAMETER (SLDP)	806	924	1049	1182	1325	1477	1640	1813		
DEFLECTION PARAMETER (SWDP)	0.541	0.519	0.499	0.480	0.461	0.443	0.426	0.409		DEFLECTION PARAMETER (SWDP)	0.539	0.517	0.496	0.477	0.459	0.441	0.423	0.406		
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)																		
18.0	377.0	432.0	491.0	553.0	592	623	654	685		18.0	384.0	440.0	500.0	563.0	614	647	679	711		
To be established by the designer.		18.5	347.0	398.0	452.0	509.0	558	587	616	645	18.5	354.0	405.0	460.0	519.0	579	609	640	671	
19.0	321.0	367.0	417.0	470.0	527.0	554	581	609		19.0	326.0	374.0	425.0	479.0	536.0	575	604	633		
19.5	296.0	340.0	386.0	435.0	487.0	524	549	575		19.5	302.0	346.0	393.0	443.0	496.0	544	571	598		
20.0	275.0	315.0	358.0	403.0	452.0	495	520	544		20.0	280.0	321.0	364.0	410.0	460.0	513.0	540	566		
20.5	255.0	293.0	332.0	374.0	419.0	467.0	492	515		20.5	260.0	298.0	338.0	381.0	427.0	476.0	511	536		
21.0	237.0	272.0	309.0	348.0	390.0	435.0	466	488		21.0	242.0	277.0	315.0	355.0	397.0	443.0	485	508		
21.5	221.0	254.0	288.0	325.0	364.0	405.0	443	463		21.5	225.0	258.0	293.0	330.0	370.0	413.0	458.0	482		
22.0	206.0	237.0	269.0	303.0	339.0	378.0	420.0	440		22.0	210.0	241.0	274.0	308.0	346.0	385.0	428.0	458		
22.5	193.0	221.0	251.0	283.0	317.0	354.0	392.0	418		22.5	197.0	225.0	256.0	288.0	323.0	360.0	400.0	435		
23.0	181.0	207.0	235.0	265.0	297.0	331.0	367.0	398		23.0	184.0	211.0	239.0	270.0	302.0	337.0	374.0	414		
23.5	169.0	194.0	220.0	249.0	278.0	310.0	344.0	378		23.5	173.0	198.0	224.0	253.0	284.0	316.0	351.0	388.0		
24.0	159.0	182.0	207.0	233.0	261.0	291.0	323.0	358.0		24.0	162.0	186.0	211.0	238.0	266.0	297.0	329.0	364.0		
24.5	149.0	171.0	195.0	219.0	246.0	274.0	304.0	336.0		24.5	152.0	174.0	198.0	223.0	250.0	279.0	310.0	343.0		
25.0	141.0	161.0	183.0	206.0	231.0	258.0	286.0	316.0		25.0	143.0	164.0	186.0	210.0	236.0	263.0	291.0	322.0		
25.5	133.0	152.0	173.0	195.0	218.0	243.0	270.0	298.0		25.5	135.0	155.0	176.0	198.0	222.0	247.0	275.0	304.0		
26.0	125.0	143.0	163.0	183.0	206.0	229.0	254.0	281.0		26.0	127.0	146.0	166.0	187.0	209.0	233.0	259.0	287.0		
26.5	118.0	135.0	154.0	173.0	194.0	216.0	240.0	266.0		26.5	120.0	138.0	157.0	176.0	198.0	220.0	245.0	271.0		
27.0	112.0	128.0	145.0	164.0	184.0	205.0	227.0	251.0		27.0	114.0	130.0	148.0	167.0	187.0	208.0	231.0	256.0		
27.5	106.0	121.0	138.0	155.0	174.0	194.0	215.0	238.0		27.5	108.0	123.0	140.0	158.0	177.0	197.0	219.0	242.0		
28.0	100.0	115.0	130.0	147.0	165.0	183.0	204.0	225.0		28.0	102.0	117.0	133.0	150.0	168.0	187.0	207.0	229.0		
28.5	95.0	109.0	124.0	139.0	156.0	174.0	193.0	214.0		28.5	97.0	111.0	126.0	142.0	159.0	177.0	197.0	218.0		
29.0	90.0	103.0	117.0	132.0	148.0	165.0	183.0	203.0		29.0	92.0	105.0	119.0	135.0	151.0	168.0	187.0	207.0		
29.5	86.0	98.0	111.0	126.0	141.0	157.0	174.0	193.0		29.5	87.0	100.0	113.0	128.0	143.0	160.0	177.0	196.0		
30.0	81.0	93.0	106.0	119.0	134.0	149.0	166.0	183.0		30.0	83.0	95.0	108.0	122.0	136.0	152.0	169.0	187.0		
30.5	77.0	89.0	101.0	114.0	127.0	142.0	158.0	174.0		30.5	79.0	90.0	103.0	116.0	130.0	145.0	161.0	178.0		
31.0	74.0	85.0	96.0	108.0	121.0	135.0	150.0	166.0		31.0	75.0	86.0	98.0	110.0	124.0	138.0	153.0	169.0		
31.5	70.0	81.0	92.0	103.0	116.0	129.0	143.0	158.0		31.5	72.0	82.0	93.0	105.0	118.0	131.0	146.0	161.0		
32.0	67.0	77.0	87.0	98.0	110.0	123.0	136.0	151.0		32.0	68.0	78.0	89.0	100.0	112.0	125.0	139.0	154.0		
32.5	64.0	73.0	83.0	94.0	105.0	117.0	130.0	144.0		32.5	65.0	75.0	85.0	96.0	107.0	120.0	133.0	147.0		
33.0	61.0	70.0	80.0	90.0	101.0	112.0	124.0	138.0		33.0	62.0	71.0	81.0	91.0	102.0	114.0	127.0	140.0		
33.5	58.0	67.0	76.0	86.0	96.0	107.0	119.0	131.0		33.5	60.0	68.0	77.0	87.0	98.0	109.0	121.0	134.0		
34.0	56.0	64.0	73.0	82.0	92.0	102.0	114.0	126.0		34.0	57.0	65.0	74.0	84.0	94.0	104.0	116.0	128.0		
34.5	54.0	61.0	70.0	79.0	88.0	98.0	109.0	120.0		34.5	55.0	62.0	71.0	80.0	90.0	100.0	111.0	123.0		
35.0	51.0	59.0	67.0	75.0	84.0	94.0	104.0	115.0		35.0	52.0	60.0	68.0	77.0	86.0	96.0	106.0	117.0		
35.5	49.0	56.0	64.0	72.0	81.0	90.0	100.0	110.0		35.5	50.0	57.0	65.0	73.0	82.0	92.0	102.0	113.0		
36.0	47.0	54.0	61.0	69.0	77.0	86.0	96.0	106.0		36.0	48.0	55.0	62.0	70.0	79.0	88.0	98.0	108.0		

Base Steel Thickness = 0.0495"										IMPERIAL UNITS									
# 11 Rebar										Area of Steel Deck Included									
										Light Weight Concrete = 110 lb/ft³									
SLAB WEIGHT (psf)	43.4	48.0	52.6	57.2	61.8	66.4	70.9	75.5		SLAB WEIGHT (psf)	43.0	47.6	52.2	56.8	61.4	66.0	70.5	75.1	
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	18.8	18.2	17.6	1															



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 2: CS210 NWC - #3 REBAR


Base Steel Thickness = 0.0375"		IMPERIAL UNITS						
# 3 Rebar		Area of Steel Deck Included						
		Normal Weight Concrete = 145 lb/ft³						
SLAB WEIGHT (psf)	52.1	58.1	64.1	70.2	76.2	82.3	88.3	94.4
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	12.2	11.7	11.2	10.8	10.4	10.1	9.8	9.5
MAX. UNSHORED TWO SPAN (ft)	9.1	8.4	7.7	7.2	6.7	6.3	6.0	5.6
MAX. UNSHORED THREE SPAN (ft)	10.3	9.5	8.8	8.2	7.7	7.2	6.8	6.3
I_u (in⁴)	54.6	62.5	70.9	80.0	89.9	100.6	112	125
I_c (in⁴)	19.1	21.2	23.5	26.0	28.6	31.3	34.3	37.3
DEFLECTION PARAMETER (SLDP)	579	658	743	834	932	1038	1153	1278
DEFLECTION PARAMETER (SWDP)	0.728	0.709	0.690	0.669	0.647	0.624	0.600	0.575
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
To be established by the designer.	14.0	175	185	195	204	214	223	243
	14.5	161	169	178	187	195	204	221
	15.0	148	155	163	171	179	187	194
	15.5	136	143	150	157	164	171	178
	16.0	125	131	138	144	150	157	163
	16.5	115	121	127	132	138	144	149
	17.0	106	111	116	122	127	132	142
	17.5	98	103	107	112	116	121	125
	18.0	91	95	99	103	107	111	115
	18.5	84	87	91	94	98	102	105
	19.0	77	80	84	87	90	93	96
	19.5	71	74	77	80	83	85	88
	20.0	66	68	71	73	76	78	80
	20.5	61	63	65	67	69	71	75
	21.0	56	58	60	62	63	65	67
	21.5	52	53	55	56	58	59	61
	22.0	48	49	50	51	53	54	55
	22.5	44	45	46	47	48	49	50
	23.0	40	41	42	43	43	44	45
	23.5							
	24.0							
	24.5							
	25.0							

TABLE 2: CS210 NWC - #3 REBAR

Base Steel Thickness = 0.0495"		IMPERIAL UNITS						
# 3 Rebar		Area of Steel Deck Included						
		Normal Weight Concrete = 145 lb/ft³						
SLAB WEIGHT (psf)	52.9	58.9	64.9	71.0	77.0	83.1	89.1	95.2
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	17.0	16.3	15.7	15.1	14.6	14.1	13.7	13.3
MAX. UNSHORED TWO SPAN (ft)	15.4	14.2	13.1	12.2	11.4	10.7	10.1	9.6
MAX. UNSHORED THREE SPAN (ft)	17.5	16.1	14.9	13.9	13.0	12.2	11.5	10.9
I_u (in⁴)	56.6	64.8	73.5	82.9	93.1	104.2	116	129
I_c (in⁴)	22.5	25.2	28.0	31.1	34.4	37.9	41.6	45.5
DEFLECTION PARAMETER (SLDP)	622	707	799	897	1003	1118	1242	1376
DEFLECTION PARAMETER (SWDP)	0.713	0.694	0.674	0.653	0.631	0.608	0.585	0.561
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
To be established by the designer.	14.0	232	247	262	277	292	307	322
	14.5	214	227	241	255	269	282	296
	15.0	197	210	222	235	247	260	272
	15.5	182	193	205	216	228	239	251
	16.0	168	179	189	200	210	221	231
	16.5	156	166	175	185	194	204	213
	17.0	145	153	162	171	180	188	197
	17.5	134	142	150	158	166	174	182
	18.0	125	132	139	147	154	161	169
	18.5	116	123	129	136	143	149	156
	19.0	108	114	120	126	132	138	145
	19.5	100	106	112	117	123	128	134
	20.0	93	99	104	109	114	119	124
	20.5	87	92	96	101	106	110	115
	21.0	81	85	89	94	98	102	106
	21.5	76	79	83	87	91	94	98
	22.0	70	74	77	81	84	87	91
	22.5	66	69	72	75	78	81	84
	23.0	61	64	66	69	72	75	77
	23.5	57	59	62	64	66	69	71
	24.0	53	55	57	59	61	63	66
	24.5	49	51	53	55	57	58	60
	25.0	46	47	49	50	52	54	55

TABLE 2: CS210 NWC - #3 REBAR

Base Steel Thickness = 0.0435"		IMPERIAL UNITS						
# 3 Rebar		Area of Steel Deck Included						
		Normal Weight Concrete = 145 lb/ft³						
SLAB WEIGHT (psf)	52.5	58.5	64.5	70.6	76.6	82.7	88.7	94.8
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	15.0	14.3	13.7	13.2	12.7	12.3	11.9	11.6
MAX. UNSHORED TWO SPAN (ft)	12.1	11.1	10.3	9.6	8.9	8.4	7.9	7.5
MAX. UNSHORED THREE SPAN (ft)	13.7	12.6	11.7	10.9	10.2	9.5	9.0	8.5
I_u (in⁴)	55.5	63.6	72.2	81.4	91.5	102.4	114	127
I_c (in⁴)	20.8	23.2	25.8	28.5	31.5	34.6	37.9	41.4
DEFLECTION PARAMETER (SLDP)	600	682	770	865	967	1078	1197	1327
DEFLECTION PARAMETER (SWDP)	0.721	0.702	0.682	0.661	0.639	0.616	0.592	0.568
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
To be established by the designer.	14.0	204	216	229	241	254	266	278
	14.5	188	199	210	221	233	244	255
	15.0	173	183	193	203	214	224	234
	15.5	159	169	178	187	196	206	214
	16.0	147	155	164	172	181	189	198
	16.5	136	144	151	159	167	174	182
	17.0	126	133	140	147	154	160	167
	17.5	116	123	129	135	142	148	154
	18.0	108	114	119	125	131	136	142
	18.5	100	105	110	116	121	126	131
	19.0	93	97	102	107	111	116	121
	19.5	86	90	95	99	103	107	111
	20.0	80	84	87	91	95	99	103
	20.5	74	78	81	84	88	91	94
	21.0	69	72	75	78	81	84	87
	21.5	64	67	69	72	74	77	80
	22.0	59	62	64	66	69	71	73
	22.5	55	57	59	61	63	65	67
	23.0	51	53	54	56	58	60	61
	23.5	47	49	50	51	53	54	56
	24.0	43	45	46	47	48	50	51
	24.5	40	41	42	43	44	45	46
	25.0				40	41	42	42

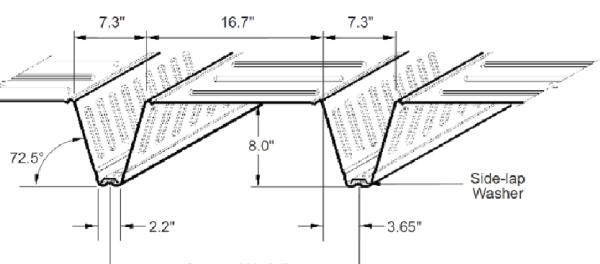



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 2: CS210 NWC - #4 REBAR


Base Steel Thickness = 0.0375"		IMPERIAL UNITS						
# 4 Rebar		Area of Steel Deck Included						
SLAB WEIGHT (psf)	52.2	58.3	64.3	70.3	76.4	82.4	88.5	94.5
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	12.2	11.7	11.2	10.8	10.4	10.1	9.8	9.5
MAX. UNSHORED TWO SPAN (ft)	9.1	8.4	7.7	7.2	6.7	6.3	6.0	5.6
MAX. UNSHORED THREE SPAN (ft)	10.3	9.5	8.8	8.2	7.6	7.2	6.8	6.3
I _u (in ⁴)	55.6	63.7	72.3	81.6	91.7	102.6	115	127
I _c (in ⁴)	21.0	23.4	26.0	28.7	31.6	34.7	38.0	41.4
DEFLECTION PARAMETER (SLDP)	603	685	773	868	970	1080	1199	1328
DEFLECTION PARAMETER (SWDP)	0.716	0.697	0.678	0.657	0.635	0.613	0.589	0.566
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
14.0	216	228	240	252	264	276	288	300
To be established by the designer.	14.5	198	209	220	231	242	253	275
15.0	183	193	203	213	223	232	242	252
15.5	169	178	187	196	205	214	223	232
16.0	156	164	172	180	189	197	205	213
16.5	144	152	159	167	174	181	189	196
17.0	134	140	147	154	161	167	174	181
17.5	124	130	136	142	148	154	161	167
18.0	115	120	126	132	137	143	148	154
18.5	107	112	117	122	127	132	137	142
19.0	99	104	108	113	117	122	126	131
19.5	92	96	100	104	108	112	116	120
20.0	86	89	93	97	100	104	107	111
20.5	80	83	86	89	93	96	99	102
21.0	74	77	80	83	85	88	91	94
21.5	69	71	74	76	79	81	84	86
22.0	64	66	68	71	73	75	77	79
22.5	59	61	63	65	67	69	71	73
23.0	55	57	58	60	62	63	65	67
23.5	51	53	54	55	57	58	59	61
24.0	48	49	50	51	52	53	54	55
24.5	44	45	46	47	48	49	49	50
25.0	41	41	42	43	43	44	45	45
25.5					40	41	41	
26.0								
26.5								
27.0								
27.5								
28.0								

TABLE 2: CS210 NWC - #4 REBAR

Base Steel Thickness = 0.0435"		IMPERIAL UNITS						
# 4 Rebar		Area of Steel Deck Included						
SLAB WEIGHT (psf)	52.6	58.7	64.7	70.7	76.8	82.8	88.9	94.9
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	15.0	14.3	13.7	13.2	12.7	12.3	11.9	11.6
MAX. UNSHORED TWO SPAN (ft)	12.0	11.1	10.3	9.5	8.9	8.4	7.9	7.5
MAX. UNSHORED THREE SPAN (ft)	13.7	12.6	11.6	10.8	10.1	9.5	9.0	8.5
I _u (in ⁴)	56.6	64.8	73.6	83.0	93.2	104.3	116	130
I _c (in ⁴)	22.7	25.3	28.1	31.2	34.4	37.9	41.5	45.4
DEFLECTION PARAMETER (SLDP)	623	709	800	898	1004	1119	1242	1376
DEFLECTION PARAMETER (SWDP)	0.709	0.690	0.671	0.650	0.628	0.606	0.582	0.559
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
14.0	244	259	274	289	303	318	333	348
To be established by the designer.	14.5	225	238	252	265	279	293	306
15.0	207	220	232	245	257	269	282	294
15.5	192	203	214	226	237	248	260	271
16.0	178	188	198	209	219	229	239	250
16.5	165	174	183	193	202	212	221	231
17.0	153	161	170	179	187	196	205	213
17.5	142	150	158	166	173	181	189	197
18.0	132	139	146	154	161	168	175	182
18.5	123	129	136	143	149	156	162	169
19.0	114	120	126	132	138	144	150	156
19.5	107	112	118	123	129	134	139	145
20.0	99	104	109	114	119	124	129	134
20.5	93	97	102	106	111	115	120	124
21.0	87	91	95	99	103	107	111	115
21.5	81	84	88	92	96	99	103	107
22.0	75	79	82	85	89	92	95	99
22.5	70	73	76	79	82	85	88	91
23.0	66	68	71	74	76	79	81	84
23.5	61	64	66	68	71	73	75	78
24.0	57	59	61	63	65	67	69	71
24.5	53	55	57	59	60	62	64	66
25.0	49	51	53	54	56	57	59	60
25.5	46	47	49	50	51	53	54	55
26.0	43	44	45	46	47	48	49	50
26.5	41	41	42	43	44	45	46	46
27.0							40	41
27.5								42
28.0								

TABLE 2: CS210 NWC - #4 REBAR

Base Steel Thickness = 0.0495"		IMPERIAL UNITS						
# 4 Rebar		Area of Steel Deck Included						
SLAB WEIGHT (psf)	53.0	59.1	65.1	71.1	77.2	83.2	89.3	95.3
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	17.0	16.3	15.7	15.1	14.6	14.1	13.7	13.3
MAX. UNSHORED TWO SPAN (ft)	15.4	14.1	13.1	12.2	11.4	10.7	10.1	9.6
MAX. UNSHORED THREE SPAN (ft)	17.5	16.1	14.9	13.9	13.0	12.2	11.5	10.9
I _u (in ⁴)	57.6	66.0	74.9	84.5	94.9	106.1	118	132
I _c (in ⁴)	24.4	27.2	30.3	33.7	37.2	41.0	45.1	49.3
DEFLECTION PARAMETER (SLDP)	645	733	828	929	1039	1158	1286	1424
DEFLECTION PARAMETER (SWDP)	0.702	0.683	0.663	0.642	0.621	0.598	0.575	0.552
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
14.0	272	289	307	324	342	359	377	394
To be established by the designer.	14.5	251	267	283	315	331	347	363
15.0	232	246	261	276	290	305	320	334
15.5	214	228	241	255	268	282	295	309
16.0	199	211	223	236	248	260	273	285
16.5	184	196	207	218	230	241	253	264
17.0	171	182	192	203	213	224	234	244
17.5	160	169	179	188	198	207	217	227
18.0	149	157	166	175	184	193	201	210
18.5	139	147	155	163	171	179	187	195
19.0	129	137	144	152	159	167	174	181
19.5	121	128	134	141	148	155	162	169
20.0	113	119	125	132	138	144	150	157
20.5	105	111	117	123	129	134	140	146
21.0	99	104	109	114	120	125	130	136
21.5	92	97	102	107	112	116	121	126
22.0	86	91	95	100	104	108	113	117
22.5	81	85	89	93	97	101	105	109
23.0	76	79	83	87	90	94	97	101
23.5	71	74	77	81	84	87	91	94
24.0	66	69	72	75	78	81	84	87
24.5	62	65	67	70	73	75	78	81
25.0	58	60	63	65	67	70	72	75
25.5	54	56	58	60	63	65	67	69
26.0	51	52	54	56	58	60	62	64
26.5	47	49	50	52	54	55	57	59
27.0	44	45	47	48	50	51	52	54
27.5	41	42	43	45	46	47	48	49
28.0				40	41	42	43	44

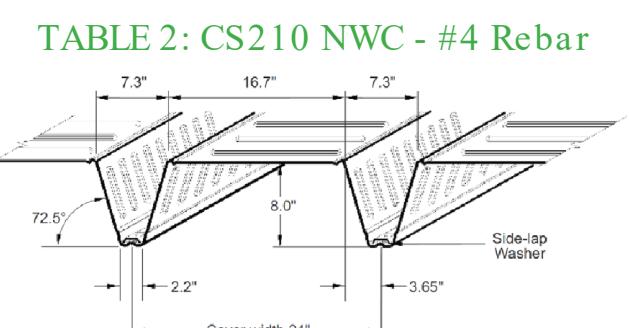



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 2: CS210 NWC - #5 REBAR


Base Steel Thickness = 0.0375"		IMPERIAL UNITS						
# 5 Rebar		Area of Steel Deck Included						
		Normal Weight Concrete = 145 lb/ft³						
SLAB WEIGHT (psf)	52.4	58.4	64.5	70.5	76.6	82.6	88.7	94.7
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	12.6	12.1	11.6	11.1	10.7	10.4	10.1	9.8
MAX. UNSHORED TWO SPAN (ft)	9.1	8.3	7.7	7.2	6.7	6.3	5.9	5.6
MAX. UNSHORED THREE SPAN (ft)	10.3	9.5	8.8	8.2	7.6	7.2	6.8	6.3
I _u (in⁴)	56.9	65.2	74.1	83.6	93.9	105.0	117	130
I _c (in⁴)	23.3	26.0	28.9	32.0	35.3	38.8	42.5	46.4
DEFLECTION PARAMETER (SLDP)	631	718	810	910	1016	1132	1256	1390
DEFLECTION PARAMETER (SWDP)	0.702	0.683	0.664	0.644	0.622	0.600	0.577	0.554
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
To be established by the designer.	14.0	276	292	307	323	339	355	371
	14.5	254	269	283	298	312	327	341
	15.0	235	248	262	275	288	301	315
	15.5	218	230	242	254	266	278	291
	16.0	202	213	224	235	246	257	269
	16.5	187	198	208	218	228	238	249
	17.0	174	184	193	202	212	221	230
	17.5	162	171	179	188	196	205	214
	18.0	151	159	167	175	183	190	198
	18.5	141	148	155	163	170	177	184
	19.0	132	138	145	151	158	165	171
	19.5	123	129	135	141	147	153	159
	20.0	115	121	126	131	137	142	148
	20.5	108	113	118	123	128	133	143
	21.0	101	105	110	114	119	123	133
	21.5	94	98	103	107	111	115	119
	22.0	88	92	96	99	103	107	111
	22.5	83	86	89	93	96	100	103
	23.0	77	80	83	87	90	93	96
	23.5	72	75	78	81	83	86	89
	24.0	68	70	73	75	78	80	82
	24.5	64	66	68	70	72	74	76
	25.0	59	61	63	65	67	69	71
	25.5	56	57	59	61	62	64	65
	26.0	52	53	55	56	58	59	60

TABLE 2: CS210 NWC - #5 REBAR

Base Steel Thickness = 0.0435"		IMPERIAL UNITS						
# 5 Rebar		Area of Steel Deck Included						
		Normal Weight Concrete = 145 lb/ft³						
SLAB WEIGHT (psf)	52.8	58.8	64.9	70.5	77.0	83.0	89.0	95.1
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	15.4	14.8	14.1	13.6	13.1	12.7	12.3	11.9
MAX. UNSHORED TWO SPAN (ft)	12.0	11.1	10.2	9.5	8.9	8.4	7.9	7.5
MAX. UNSHORED THREE SPAN (ft)	13.7	12.6	11.6	10.8	10.1	9.5	9.0	8.5
I _u (in⁴)	57.9	66.3	75.3	84.9	95.4	106.7	119	132
I _c (in⁴)	24.9	27.8	31.0	34.4	38.0	41.9	45.9	50.2
DEFLECTION PARAMETER (SLDP)	651	741	836	939	1050	1169	1298	1437
DEFLECTION PARAMETER (SWDP)	0.696	0.677	0.657	0.637	0.615	0.593	0.571	0.548
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
To be established by the designer.	14.0	305	324	343	362	381	400	418
	14.5	282	299	316	334	351	368	385
	15.0	261	277	293	308	324	340	356
	15.5	242	256	271	285	300	314	329
	16.0	224	238	251	265	278	291	305
	16.5	209	221	233	246	258	270	282
	17.0	194	206	217	228	240	251	262
	17.5	181	192	202	212	223	233	244
	18.0	169	179	188	198	207	217	227
	18.5	158	167	176	184	193	202	211
	19.0	148	156	164	172	180	188	197
	19.5	138	146	153	161	168	176	183
	20.0	129	136	143	150	157	164	171
	20.5	121	128	134	140	147	153	166
	21.0	114	120	125	131	137	143	149
	21.5	107	112	117	123	128	134	139
	22.0	100	105	110	115	120	125	130
	22.5	94	98	103	107	112	117	121
	23.0	88	92	96	101	105	109	113
	23.5	83	87	90	94	98	102	105
	24.0	78	81	85	88	91	95	98
	24.5	73	76	79	82	85	89	92
	25.0	69	71	74	77	80	83	85
	25.5	64	67	69	72	74	77	79
	26.0	60	63	65	67	69	72	74

TABLE 2: CS210 NWC - #5 REBAR

Base Steel Thickness = 0.0495"		IMPERIAL UNITS						
# 5 Rebar		Area of Steel Deck Included						
		Normal Weight Concrete = 145 lb/ft³						
SLAB WEIGHT (psf)	53.2	59.2	65.3	71.3	77.4	83.4	89.4	95.5
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	17.5	16.7	16.1	15.6	15.0	14.5	14.1	13.7
MAX. UNSHORED TWO SPAN (ft)	15.3	14.1	13.1	12.2	11.4	10.7	10.1	9.5
MAX. UNSHORED THREE SPAN (ft)	17.4	16.0	14.9	13.8	12.9	12.2	11.5	10.9
I _u (in⁴)	58.9	67.5	76.6	86.4	97.0	108.5	121	135
I _c (in⁴)	26.5	29.7	33.1	36.8	40.7	44.9	49.3	54.0
DEFLECTION PARAMETER (SLDP)	672	764	863	969	1084	1207	1340	1484
DEFLECTION PARAMETER (SWDP)	0.689	0.670	0.650	0.630	0.608	0.586	0.564	0.541
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
To be established by the designer.	14.0	334	356	377	399	421	442	464
	14.5	309	329	349	368	388	408	428
	15.0	286	304	323	341	359	377	396
	15.5	265	282	299	316	333	349	366
	16.0	246	262	278	293	309	324	355
	16.5	229	244	258	272	287	301	315
	17.0	214	227	240	253	267	280	293
	17.5	200	212	224	236	248	261	273
	18.0	186	198	209	220	232	243	254
	18.5	174	185	195	206	216	227	237
	19.0	163	173	183	192	202	211	231
	19.5	153	162	171	180	189	198	207
	20.0	143	152	160	168	177	185	193
	20.5	135	142	150	158	165	173	181
	21.0	126	133	141	148	155	162	169
	21.5	119	125	132	138	145	152	165
	22.0	112	118	124	130	136	142	154
	22.5	105	111	116	122	127	133	144
	23.0	99	104	109	114	119	125	130
	23.5	93	98	102	107	112	117	121
	24.0	87	92	96	101	105	109	118
	24.5	82	86	90	94	98	102	110
	25.0	77	81	85	88	92	96	100
	25.5	73	76	80	83	86	90	96
	26.0	69	72	75	78	81	84	87

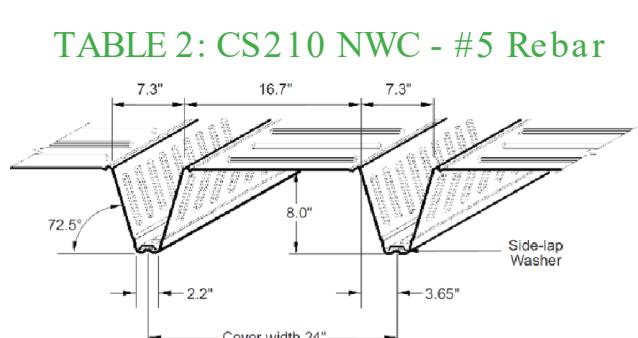



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024


TABLE 2: CS210 NWC - #6 REBAR

# 6 Rebar		IMPERIAL UNITS									
Base Steel Thickness = 0.0375"		Area of Steel Deck Included									
		Normal Weight Concrete = 145 lb/ft³									
SLAB WEIGHT (psf)		52.6	58.7	64.7	70.8	76.8	82.8	88.9	94.9		
CONCRETE VOLUME (yd³/100ft²)		1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)		12.6	12.0	11.5	11.1	10.7	10.4	10.1	9.8		
MAX. UNSHORED TWO SPAN (ft)		9.0	8.3	7.7	7.2	6.7	6.3	5.9	5.5		
MAX. UNSHORED THREE SPAN (ft)		10.3	9.5	8.8	8.2	7.6	7.2	6.7	6.3		
I _u (in⁴)		58.4	67.0	76.1	85.9	96.4	107.9	120	134		
I _c (in⁴)		26.0	29.0	32.3	35.9	39.6	43.6	47.7	52.2		
DEFLECTION PARAMETER (SLDP)		664	756	853	958	1070	1191	1322	1462		
DEFLECTION PARAMETER (SWDP)		0.687	0.668	0.649	0.628	0.607	0.586	0.564	0.541		
SLAB THICKNESS (in.)		10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.		14.0	336	356	376	396	415	435	455	475	
	14.5	311	329	347	365	383	401	420	438		
	15.0	288	304	321	338	354	371	388	404		
	15.5	267	282	298	313	328	344	359	374		
	16.0	248	262	276	290	304	319	333	347		
	16.5	231	244	257	270	283	296	309	322		
	17.0	215	227	239	251	263	275	287	299		
	17.5	201	212	223	234	245	256	267	278		
	18.0	188	198	208	218	228	239	249	259		
	18.5	176	185	194	204	213	223	232	241		
	19.0	165	173	182	191	199	208	217	225		
	19.5	154	162	170	178	186	194	202	210		
	20.0	145	152	159	167	174	182	189	196		
	20.5	136	143	149	156	163	170	177	183		
	21.0	128	134	140	146	153	159	165	171		
	21.5	120	126	131	137	143	149	154	160		
	22.0	113	118	123	129	134	139	145	150		
	22.5	106	111	116	121	125	130	135	140		
	23.0	100	104	109	113	118	122	127	131		
	23.5	94	98	102	106	110	114	118	123		
	24.0	88	92	96	100	103	107	111	115		
	24.5	83	87	90	93	97	100	104	107		
	25.0	78	81	85	88	91	94	97	100		
	25.5	74	77	79	82	85	88	91	93		
	26.0	69	72	74	77	80	82	85	87		
	26.5	65	68	70	72	74	77	79	81		
	27.0	62	64	66	68	70	72	74	76		
	27.5	58	60	61	63	65	67	69	70		
	28.0	54	56	58	59	61	62	64	65		
	28.5	51	53	54	55	57	58	59	61		
	29.0	48	49	50	51	53	54	55	56		

TABLE 2: CS210 NWC - #6 REBAR

# 6 Rebar		IMPERIAL UNITS									
Base Steel Thickness = 0.0435"		Area of Steel Deck Included									
		Normal Weight Concrete = 145 lb/ft³									
SLAB WEIGHT (psf)		53.0	59.1	65.1	71.2	77.2	83.2	89.3	95.3		
CONCRETE VOLUME (yd³/100ft²)		1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)		15.4	14.7	14.1	13.6	13.1	12.7	12.3	11.9		
MAX. UNSHORED TWO SPAN (ft)		12.0	11.0	10.2	9.5	8.9	8.4	7.9	7.5		
MAX. UNSHORED THREE SPAN (ft)		13.6	12.5	11.6	10.8	10.1	9.5	9.0	8.5		
I _u (in⁴)		59.3	68.0	77.3	87.2	97.9	109.5	122	136		
I _c (in⁴)		27.5	30.8	34.3	38.1	42.2	46.5	51.0	55.8		
DEFLECTION PARAMETER (SLDP)		683	777	878	986	1102	1227	1362	1507		
DEFLECTION PARAMETER (SWDP)		0.682	0.662	0.643	0.622	0.601	0.580	0.558	0.536		
SLAB THICKNESS (in.)		10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.		14.0	365	388	411	433	456	479	502	524	
	14.5	338	359	380	400	421	442	463	484		
	15.0	313	332	351	371	390	409	428	447		
	15.5	291	308	326	344	361	379	397	415		
	16.0	270	287	303	319	336	352	368	385		
	16.5	252	267	282	297	312	327	342	357		
	17.0	235	249	263	277	291	305	319	333		
	17.5	219	232	245	258	271	284	297	310		
	18.0	205	217	229	241	253	265	277	289		
	18.5	192	203	214	225	236	248	259	270		
	19.0	180	190	201	211	221	231	242	252		
	19.5	169	179	188	198	207	217	226	236		
	20.0	159	168	176	185	194	203	212	220		
	20.5	149	157	165	174	182	190	198	206		
	21.0	140	148	155	163	171	178	186	193		
	21.5	132	139	146	153	160	167	174	181		
	22.0	124	131	137	144	150	157	163	170		
	22.5	117	123	129	135	141	147	153	159		
	23.0	110	116	121	127	133	138	144	149		
	23.5	104	109	114	119	125	130	135	140		
	24.0	98	103	108	112	117	122	126	131		
	24.5	92	97	101	106	110	114	119	123		
	25.0	87	91	95	99	103	107	111	115		
	25.5	82	86	90	93	97	101	104	108		
	26.0	78	81	84	88	91	95	98	101		
	26.5	73	76	79	82	86	89	92	95		
	27.0	69	72	75	78	80	83	86	89		
	27.5	65	68	70	73	75	78	80	83		
	28.0	61	64	66	68	71	73	75	77		
	28.5	58	60	62	64	66	68	70	72		
	29.0	55	56	58	60	62	64	66	67		

TABLE 2: CS210 NWC - #6 Rebar

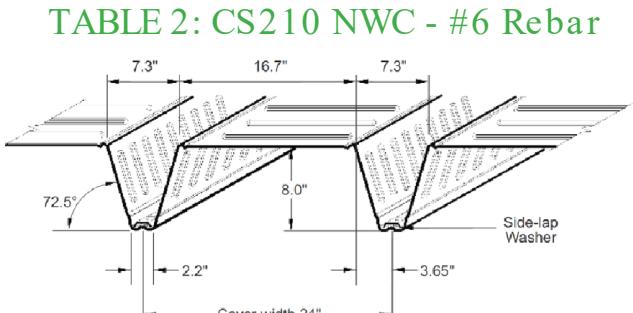



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 2: CS210 NWC - #7 REBAR

Base Steel Thickness = 0.0375"		IMPERIAL UNITS									
# 7 Rebar		Area of Steel Deck Included									
		Normal Weight Concrete = 145 lb/ft ³									
SLAB WEIGHT (psf)	52.9	58.9	65.0	71.0	77.1	83.1	89.2	95.2			
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	12.6	12.0	11.5	11.1	10.7	10.4	10.0	9.8			
MAX. UNSHORED TWO SPAN (ft)	9.0	8.3	7.7	7.2	6.7	6.3	5.9	5.5			
MAX. UNSHORED THREE SPAN (ft)	10.3	9.4	8.7	8.1	7.6	7.1	6.7	6.3			
I _u (in ⁴)	60.1	69.0	78.4	88.4	99.3	111.0	124	138			
I _c (in ⁴)	28.8	32.3	36.1	40.1	44.3	48.8	53.6	58.6			
DEFLECTION PARAMETER (SLDP)	700	797	900	1011	1130	1258	1395	1543			
DEFLECTION PARAMETER (SWDP)	0.672	0.652	0.633	0.613	0.592	0.571	0.549	0.528			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.		16.0	301	319	337	354	372	389	407	425	
		16.5	281	297	314	330	346	362	379	395	
		17.0	263	278	293	308	323	338	353	368	
		17.5	246	259	273	287	301	315	329	343	
		18.0	230	243	256	269	282	295	308	320	
		18.5	216	228	240	252	264	276	288	300	
		19.0	202	213	225	236	247	258	269	280	
		19.5	190	200	211	221	231	242	252	263	
		20.0	179	188	198	208	217	227	236	246	
		20.5	168	177	186	195	204	213	222	231	
		21.0	158	167	175	183	192	200	208	217	
		21.5	149	157	165	172	180	188	196	203	
		22.0	141	148	155	162	169	177	184	191	
		22.5	133	139	146	153	159	166	173	179	
		23.0	125	132	138	144	150	156	162	169	
		23.5	118	124	130	136	141	147	153	159	
		24.0	112	117	123	128	133	138	144	149	
		24.5	106	111	116	121	125	130	135	140	
		25.0	100	105	109	114	118	123	127	132	
		25.5	95	99	103	107	111	116	120	124	
		26.0	90	93	97	101	105	109	113	116	
		26.5	85	88	92	95	99	102	106	109	
		27.0	80	83	87	90	93	96	100	103	
		27.5	76	79	82	85	88	91	94	96	
		28.0	72	74	77	80	82	85	88	91	
		28.5	68	70	73	75	78	80	82	85	
		29.0	64	66	69	71	73	75	77	80	
		29.5	61	63	65	67	69	71	73	75	
		30.0	57	59	61	63	64	66	68	70	
		30.5	54	56	57	59	60	62	64	65	
		31.0	51	53	54	55	57	58	59	61	
		31.5	48	50	51	52	53	54	55	57	
		32.0	46	47	48	49	50	51	52	53	
		32.5	43	44	45	45	46	47	48	49	
		33.0	41	41	42	43	43	44	45	45	

TABLE 2: CS210 NWC - #7 REBAR

Base Steel Thickness = 0.0495"		IMPERIAL UNITS									
# 7 Rebar		Area of Steel Deck Included									
		Normal Weight Concrete = 145 lb/ft ³									
SLAB WEIGHT (psf)	53.7	59.7	65.8	71.8	77.9	83.9	89.9	96.0			
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	17.4	16.7	16.1	15.5	15.0	14.5	14.1	13.6			
MAX. UNSHORED TWO SPAN (ft)	15.3	14.0	13.0	12.1	11.3	10.7	10.1	9.5			
MAX. UNSHORED THREE SPAN (ft)	17.3	16.0	14.8	13.8	12.9	12.1	11.4	10.8			
I _u (in ⁴)	62.0	71.1	80.8	91.1	102.3	114.4	128	142			
I _c (in ⁴)	31.8	35.7	39.9	44.4	49.3	54.4	59.9	65.6			
DEFLECTION PARAMETER (SLDP)	738	840	949	1067	1193	1288	1474	1631			
DEFLECTION PARAMETER (SWDP)	0.661	0.641	0.621	0.601	0.580	0.559	0.538	0.517			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.		16.0	344	366	388	410	432	454	476	498	
		16.5	321	342	362	382	403	423	444	464	
		17.0	300	319	338	357	376	395	414	433	
		17.5	281	299	316	334	352	369	387	405	
		18.0	264	280	296	313	329	346	362	378	
		18.5	247	263	278	293	309	324	339	354	
		19.0	232	247	261	275	289	304	318	332	
		19.5	219	232	245	259	272	285	299	312	
		20.0	206	218	231	243	256	268	280	293	
		20.5	194	206	217	229	240	252	264	275	
		21.0	183	194	205	216	226	237	248	259	
		21.5	173	183	193	203	213	223	234	244	
		22.0	163	173	182	192	201	211	220	230	
		22.5	154	163	172	181	190	199	207	216	
		23.0	146	154	162	171	179	187	196	204	
		23.5	138	146	153	161	169	177	185	192	
		24.0	131	138	145	152	160	167	174	181	
		24.5	124	130	137	144	151	158	164	171	
		25.0	117	124	130	136	143	149	155	162	
		25.5	111	117	123	129	135	141	147	152	
		26.0	105	111	116	122	127	133	138	144	
		26.5	100	105	110	115	120	126	131	136	
		27.0	95	100	104	109	114	119	123	128	
		27.5	90	94	99	103	108	112	117	121	
		28.0	85	89	94	98	102	106	110	114	
		28.5	81	85	89	92	96	100	104	108	
		29.0	77	80	84	87	91	94	98	102	
		29.5	73	76	79	83	86	89	92	96	
		30.0	69	72	75	78	81	84	87	90	
		30.5	66	68	71	74	77	79	82	85	
		31.0	62	65	67	70	72	75	77	80	
		31.5	59	61	64	66	68	70	73	75	
		32.0	56	58	60	62	64	66	68	71	
		32.5	53	55	57	59	60	62	64	66	
		33.0	50	52	54	55	57	59	60	62	

TABLE 2: CS210 NWC - #7 REBAR

Base Steel Thickness = 0.0435"		IMPERIAL UNITS									
# 7 Rebar		Area of Steel Deck Included									
		Normal Weight Concrete = 145 lb/ft ³									
SLAB WEIGHT (psf)	53.3	59.3	65.4	71.4	77.5	83.5	89.6	95.6			
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.47	1.57	1.72	1.88	2.03	2.18			
MAX. UNSHORED ONE SPAN (ft)	15.4	14.7	14.1	13.6	13.6	13.1	12.6	11.9			
MAX. UNSHORED TWO SPAN (ft)	11.9	11.0	10.2	9.5	9.8	8.3	7.9	7.4			
MAX. UNSHORED THREE SPAN (ft)	13.6	12.5	11.6	10.8	10.1	9.5	8.9</td				



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 2: CS210 NWC - #8 REBAR

Base Steel Thickness = 0.0375"		IMPERIAL UNITS								
# 8 Rebar		Area of Steel Deck Included								
		Normal Weight Concrete = 145 lb/ft³								
SLAB WEIGHT (psf)	53.2	59.3	65.3	71.3	77.4	83.4	89.5	95.5		
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)	12.6	12.0	11.5	11.1	10.7	10.4	10.0	9.8		
MAX. UNSHORED TWO SPAN (ft)	9.0	8.3	7.7	7.1	6.7	6.3	5.9	5.5		
MAX. UNSHORED THREE SPAN (ft)	10.2	9.4	8.7	8.1	7.6	7.1	6.7	6.3		
I_u (in⁴)	61.9	71.1	80.8	91.2	102.4	114.6	128	142		
I_c (in⁴)	31.9	35.9	40.1	44.6	49.4	54.5	59.9	65.5		
DEFLECTION PARAMETER (SLDP)	738	841	951	1069	1195	1330	1475	1631		
DEFLECTION PARAMETER (SWDP)	0.656	0.636	0.616	0.596	0.576	0.555	0.535	0.514		
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)								
To be established by the designer.	16.0	361	383	404	426	448	469	491	513	
	16.5	337	357	377	397	418	438	458	478	
	17.0	315	334	353	371	390	409	427	446	
	17.5	295	313	330	347	365	382	399	417	
	18.0	277	293	309	325	342	358	374	390	
	18.5	260	275	290	305	320	335	350	365	
	19.0	245	259	273	287	301	315	329	343	
	19.5	230	243	256	269	282	296	309	322	
	20.0	217	229	241	253	266	278	290	302	
	20.5	204	216	227	239	250	261	273	284	
	21.0	193	204	214	225	236	246	257	268	
	21.5	182	192	202	212	222	232	242	252	
	22.0	172	182	191	200	209	219	228	237	
	22.5	163	172	180	189	198	206	215	224	
	23.0	154	162	170	179	187	195	203	211	
	23.5	146	154	161	169	176	184	192	199	
	24.0	138	145	153	160	167	174	181	188	
	24.5	131	138	144	151	158	164	171	178	
	25.0	124	131	137	143	149	155	161	168	
	25.5	118	124	130	135	141	147	153	158	
	26.0	112	117	123	128	133	139	144	150	
	26.5	106	111	116	121	126	131	136	141	
	27.0	101	106	110	115	120	124	129	134	
	27.5	96	100	105	109	113	117	122	126	
	28.0	91	95	99	103	107	111	115	119	
	28.5	87	90	94	98	101	105	109	113	
	29.0	82	86	89	92	96	99	103	106	
	29.5	78	81	84	88	91	94	97	100	
	30.0	74	77	80	83	86	89	92	95	
	30.5	70	73	76	78	81	84	86	89	
	31.0	67	69	72	74	77	79	82	84	
	31.5	64	66	68	70	72	75	77	79	
	32.0	60	62	64	66	68	70	72	74	
	32.5	57	59	61	63	65	66	68	70	
	33.0	54	56	58	59	61	62	64	66	

TABLE 2: CS210 NWC - #8 REBAR

Base Steel Thickness = 0.0495"		IMPERIAL UNITS								
# 8 Rebar		Area of Steel Deck Included								
		Normal Weight Concrete = 145 lb/ft³								
SLAB WEIGHT (psf)	54.0	60.1	66.1	72.1	78.2	84.2	90.3	96.3		
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)	17.4	16.7	16.1	15.5	15.0	14.5	14.0	13.6		
MAX. UNSHORED TWO SPAN (ft)	15.2	14.0	13.0	12.1	11.3	10.6	10.0	9.5		
MAX. UNSHORED THREE SPAN (ft)	17.3	15.9	14.7	13.7	12.9	12.1	11.4	10.8		
I_u (in⁴)	63.7	73.1	83.2	93.9	105.4	117.8	131	146		
I_c (in⁴)	34.7	39.1	43.7	48.8	54.1	59.8	65.9	72.3		
DEFLECTION PARAMETER (SLDP)	774	883	998	1122	1255	1398	1551	1716		
DEFLECTION PARAMETER (SWDP)	0.647	0.626	0.606	0.586	0.566	0.545	0.524	0.504		
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)								
To be established by the designer.	16.0	403	429	455	481	507	533	559	585	
	16.5	376	400	425	449	473	497	522	546	
	17.0	352	375	397	420	442	465	487	510	
	17.5	330	351	372	393	414	435	456	477	
	18.0	310	329	349	369	388	408	427	447	
	18.5	291	309	328	346	364	383	401	419	
	19.0	274	291	308	325	342	360	377	394	
	19.5	258	274	290	306	322	338	354	370	
	20.0	243	258	273	288	303	318	333	348	
	20.5	230	244	258	272	286	300	314	328	
	21.0	217	230	243	256	270	283	296	309	
	21.5	205	217	230	242	255	267	279	292	
	22.0	194	206	217	229	240	252	264	275	
	22.5	184	195	205	216	227	238	249	260	
	23.0	174	184	195	205	215	225	236	246	
	23.5	165	175	184	194	204	213	223	232	
	24.0	156.d	166	175	184	202	211	220		
	24.5	146.d	157	166	174	183	191	200	208	
	25.0	138.d	149	157	165	173	181	189	197	
	25.5	130.d	141	149	157	164	172	179	187	
	26.0	122.d	134	141	148	156	163	170	177	
	26.5	116.d	128	134	141	148	154	161	167	
	27.0	109.d	121	128	134	140	146	152	159	
	27.5	103.d	115	121	127	133	139	144	150	
	28.0	98.d	110	115	121	126	131	137	142	
	28.5	93.d	104	109	115	120	125	130	135	
	29.0	88.d	99	104	109	114	118	123	128	
	29.5	84.d	94	99	103	108	112	117	121	
	30.0	80.d	90	94	98	102	106	111	115	
	30.5	76.d	85	89	93	97	101	105	109	
	31.0	72.d	81	85	88	92	96	99	103	
	31.5	69.d	77	81	84	87	91	94	97	
	32.0	66.d	73	77	80	83	86	89	92	
	32.5	63.d	70	73	76	78	81	84	87	
	33.0	60.d	66	69	72	74	77	80	82	

TABLE 2: CS210 NWC - #8 REBAR

Base Steel Thickness = 0.0435"		IMPERIAL UNITS								
# 8 Rebar		Area of Steel Deck Included								
		Normal Weight Concrete = 145 lb/ft³								
SLAB WEIGHT (psf)	53.6	59.7	65.7	71.7	77.8	83.8	89.9	95.9		
CONCRETE VOLUME (yd³/100ft²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34		
MAX. UNSHORED ONE SPAN (ft)	15.3	14.7	14.1	13.5	13.1	12.6	12.2	11.9		
MAX. UNSHORED TWO SPAN (ft)	11.9	11.0	10.2	9.5	8.9	8.3	7.8	7.4		
MAX. UNSHORED THREE SPAN (ft)	13.5	12.5	11.5	10.8	10.1	9.5	8.9	8.4		
I_u (in⁴)	62.7	72.0	81.9	92.5	103.9	116.1	129	144		
I_c (in⁴)	33.3	37.4	41.9	46.7	51.7	57.1	62.9	68.9		
DEFLECTION PARAMETER (SLDP)	755	861	974	1095	1224	1363	1513	1673		
DEFLECTION PARAMETER (SWDP)	0.652	0.632	0.612	0.592	0.571	0.550	0.530	0.509		
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0		
SHORING	SPAN (ft)</td									



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 2: CS210 NWC - #9 REBAR

# 9 Rebar		IMPERIAL UNITS									
		Area of Steel Deck Included									
Base Steel Thickness = 0.0375"		Normal Weight Concrete = 145 lb/ft ³									
# 9 Rebar											
SLAB WEIGHT (psf)	53.6	59.6	65.7	71.7	77.7	83.8	89.8	95.9			
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	12.5	12.0	11.5	11.1	10.7	10.3	10.0	9.7			
MAX. UNSHORED TWO SPAN (ft)	9.0	8.2	7.6	7.1	6.7	6.3	5.9	5.5			
MAX. UNSHORED THREE SPAN (ft)	10.2	9.4	8.7	8.1	7.6	7.1	6.7	6.3			
I _w (in ⁴)	63.7	73.3	83.5	94.3	105.9	118.4	132	147			
I _c (in ⁴)	35.2	39.6	44.4	49.5	54.9	60.6	66.7	73.1			
DEFLECTION PARAMETER (SLDP)	778	888	1006	1131	1265	1408	1562	1728			
DEFLECTION PARAMETER (SWDP)	0.641	0.620	0.600	0.580	0.560	0.540	0.519	0.499			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.	18.0	330	350	370	390	409	429	449	469		
	18.5	310	329	347	366	384	403	422	440		
	19.0	292	309	327	344	361	379	396	414		
	19.5	275	292	308	324	340	356	373	389		
	20.0	260	275	290	305	321	336	351	366		
	20.5	245	260	274	288	302	317	331	345		
	21.0	232	245	259	272	285	299	312	325		
	21.5	217.d	232	244	257	270	282	295	307		
	22.0	203.d	219	231	243	255	267	278	290		
	22.5	190.d	208	219	230	241	252	263	274		
	23.0	178.d	197	207	218	228	239	249	259		
	23.5	167.d	187	197	206	216	226	236	245		
	24.0	156.d	177	186	196	205	214	223	232		
	24.5	147.d	168.d	177	186	194	203	211	220		
	25.0	138.d	158.d	168	176	184	192	200	208		
	25.5	130.d	149.d	160	167	175	182	190	198		
	26.0	123.d	140.d	152	159	166	173	180	187		
	26.5	116.d	133.d	144	151	157	164	171	178		
	27.0	110.d	125.d	137	143	150	156	162	168		
	27.5	104.d	119.d	130	136	142	148	154	160		
	28.0	98.d	112.d	124	129	135	141	146	152		
	28.5	93.d	107.d	118	123	128	133	139	144		
	29.0	89.d	101.d	112	117	122	127	132	136		
	29.5	84.d	96.d	107	111	116	120	125	129		
	30.0	80.d	91.d	102	106	110	114	119	123		
	30.5	76.d	87.d	97	101	105	109	113	116		
	31.0	73.d	83.d	92	96	99	103	107	110		
	31.5	69.d	79.d	88	91	94	98	101	105		
	32.0	66.d	75.d	83	87	90	93	96	99		
	32.5	63.d	72.d	79	82	85	88	91	94		
	33.0	60.d	69.d	75	78	81	84	86	89		
	33.5	57.d	66.d	72	74	77	79	82	84		
	34.0	55.d	63.d	68	70	73	75	77	80		
	34.5	53.d	60.d	65	67	69	71	73	75		
	35.0	50.d	58.d	62	63	65	67	69	71		

TABLE 2: CS210 NWC - #9 REBAR

# 9 Rebar		IMPERIAL UNITS									
		Area of Steel Deck Included									
Base Steel Thickness = 0.0495"		Normal Weight Concrete = 145 lb/ft ³									
# 9 Rebar											
SLAB WEIGHT (psf)	54.4	60.4	66.5	72.5	78.5	84.6	90.6	96.7			
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34			
MAX. UNSHORED ONE SPAN (ft)	17.3	16.6	16.0	15.5	15.0	14.5	14.0	13.6			
MAX. UNSHORED TWO SPAN (ft)	15.2	14.0	12.9	12.1	11.3	10.6	10.0	9.5			
I _w (in ⁴)	65.5	75.4	85.8	96.8	108.8	121.6	136	150			
I _c (in ⁴)	37.8	42.7	47.9	53.4	59.4	65.7	72.4	79.5			
DEFLECTION PARAMETER (SLDP)	813	928	1051	1182	1323	1473	1635	1809			
DEFLECTION PARAMETER (SWDP)	0.633	0.611	0.591	0.571	0.551	0.531	0.510	0.490			
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0			
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)									
To be established by the designer.	18.0	362	385	408	432	455	478	502	525		
	18.5	340	362	384	406	428	449	471	493		
	19.0	320	341	361	382	402	423	443	464		
	19.5	302	321	341	360	379	398	417	437		
	20.0	282.d	303	321	339	357	375	393	411		
	20.5	262.d	286	303	320	337	354	371	388		
	21.0	244.d	271	287	303	319	335	351	366		
	21.5	227.d	256	271	286	301	316	331	346		
	22.0	212.d	242.d	257	271	285	299	313	327		
	22.5	198.d	226.d	243	257	270	283	297	310		
	23.0	186.d	212.d	231	243	256	268	281	293		
	23.5	174.d	199.d	219	231	243	254	266	278		
	24.0	163.d	187.d	208	219	230	241	252	264		
	24.5	154.d	175.d	197	208	218	229	239	250		
	25.0	145.d	165.d	187.d	198	207	217	227	237		
	25.5	136.d	156.d	188	197	206	216	225			
	26.0	129.d	147.d	166.d	179	187	196	205	214		
	26.5	121.d	139.d	157.d	170	178	187	195	203		
	27.0	115.d	131.d	148.d	162	169	177	185	193		
	27.5	109.d	124.d	140.d	154	161	169	176	183		
	28.0	103.d	117.d	133.d	146	153	160	167	174		
	28.5	98.d	111.d	126.d	139	146	153	159	166		
	29.0	93.d	106.d	120.d	133	139	145	151	158		
	29.5	88.d	100.d	114.d	127	132	138	144	150		
	30.0	84.d	96.d	108.d	121	126	132	137	143		
	30.5	80.d	91.d	103.d	115	120	125	130	136		
	31.0	76.d	87.d	98.d	109	114	119	124	129		
	31.5	72.d	83.d	93.d	104	109	113	118	123		
	32.0	69.d	79.d	89.d	99	104	108	112	117		
	32.5	66.d	75.d	85.d	95	99	103	107	111		
	33.0	63.d	72.d	81.d	90	94	98	101	105		
	33.5	60.d	69.d	78.d	86	89	93	96	100		
	34.0	57.d	66.d	74.d	82	85	88	92	95		
	34.5	55.d	63.d	71.d	78	81	84	87	90		
	35.0	53.d	60.d	68.d	74	77	80	83	86		

TABLE 2: CS210 NWC - #9 REBAR

# 9 Rebar		IMPERIAL UNITS									
		Area of Steel Deck Included									
Base Steel Thickness = 0.0435"		Normal Weight Concrete = 145 lb/ft ³									
# 9 Rebar											
SLAB WEIGHT (psf)	54.0	60.0	66.1	72.1	78.1	84.2	90.2	96.3			
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1						



EVALUATION REPORT

Originally Issued: 06/10/2016

Revised: 06/02/2023

Number: 277

Valid Through: 06/30/2024

TABLE 2: CS210 NWC - #10 REBAR

TABLE C2: CS210 NWC - #10 REBAR							IMPERIAL UNITS	
Base Steel Thickness = 0.0375"							Area of Steel Deck Included	
# 10 Rebar							Normal Weight Concrete = 145 lb/ft ³	
SLAB WEIGHT (psf)							145 lb/ft ³	
CONCRETE VOLUME (yd ³ /100ft ²)	54.0	60.1	66.1	72.2	78.2	84.2	90.3	96.3
MAX. UNSHORED ONE SPAN (ft)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED TWO SPAN (ft)	12.5	12.0	11.5	11.0	10.7	10.3	10.0	9.7
MAX. UNSHORED THREE SPAN (ft)	8.9	8.2	7.6	7.1	6.6	6.2	5.9	5.5
I _x (in ⁴)	65.9	75.9	86.5	97.8	109.9	122.9	137	152
I _y (in ⁴)	38.9	43.9	49.3	55.1	61.2	67.7	74.6	81.9
DEFLECTION PARAMETER (SLDP)	824	943	1068	1203	1346	1500	1664	1840
DEFLECTION PARAMETER (SWDP)	0.625	0.603	0.583	0.563	0.543	0.523	0.503	0.483
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
To be established by the designer.	18.0	393.0	418	443	467	492	516	541
	18.5	362.0	393	416	439	462	485	508
	19.0	354.0	371	392	414	435	457	478
	19.5	309.0	350	370	390	410	430	451
	20.0	286.0	327	349	368	387	406	425
	20.5	266.0	304	330	348	366	383	401
	21.0	247.0	283	312	329	346	362	379
	21.5	230.0	263	295	311	327	343	359
	22.0	215.0	246	279	295	310	325	340
	22.5	201.0	230	261	280	294	308	322
	23.0	188.0	215	244	265	278	292	305
	23.5	176.0	202	229	252	264	277	289
	24.0	166.0	189	215	239	251	263	276
	24.5	156.0	178	202	227	238	250	261
	25.0	147.0	168	190	214	227	237	248
	25.5	138.0	158	179	201	216	225	235
	26.0	130.0	149	169	190	205	214	224
	26.5	123.0	141	159	180	195	204	213
	27.0	116.0	133	151	170	186	194	203
	27.5	110.0	126	143	161	177	185	193
	28.0	104.0	119	135	152	169	176	184
	28.5	99.0	113	128	144	161	168	175
	29.0	94.0	107	122	137	153	160	167
	29.5	89.0	102	116	130	146	153	165
	30.0	85.0	97	110	124	138	145	151
	30.5	81.0	92	105	118	132	139	144
	31.0	77.0	88	100	112	126	132	137
	31.5	73.0	84	95	107	120	126	131
	32.0	70.0	80	91	102	114	120	125
	32.5	67.0	76	86	97	109	115	123
	33.0	64.0	73	83	93	104	109	117
	33.5	61.0	70	79	89	99	104	112
	34.0	58.0	67	76	85	95	99	106
	34.5	56.0	64	72	81	91	95	101
	35.0	53.0	61	69	78	87	90	93
	35.5	51.0	59	66	75	83	86	92
	36.0	49.0	56	64	72	79	82	87

TABLE 2: CS210 NWC - #10 REBAR

TABLE 2: CS210 NWC - #10 REBAR										IMPERIAL UNITS			
Base Steel Thickness = 0.0495"										Area of Steel Deck Included			
# 10 Rebar										Normal Weight Concrete = 145 lb/ft ³			
SLAB WEIGHT (psf)										Normal Weight Concrete = 145 lb/ft ³			
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34					
MAX. UNSHORED ONE SPAN (ft)	17.3	16.6	16.0	15.4	14.9	14.4	14.0	13.6					
MAX. UNSHORED TWO SPAN (ft)	15.1	13.9	12.9	12.0	11.2	10.6	10.0	9.4					
MAX. UNSHORED THREE SPAN (ft)	17.1	15.8	14.6	13.6	12.8	12.0	11.3	10.7					
I _w (in ⁴)	67.7	77.9	88.8	100.3	112.7	126.0	140	156					
I _b (in ⁴)	41.4	46.8	52.6	58.8	65.4	72.5	80.0	87.9					
DEFLECTION PARAMETER (SLDP)	858	981	1112	1252	1401	1562	1734	1918					
DEFLECTION PARAMETER (SWDP)	0.618	0.596	0.575	0.555	0.535	0.515	0.495	0.475					
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0					
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)											
To be established by the designer.	18.0	409.0	452	480	508	536	564	592	620				
	18.5	376.0	425	452	478	504	530	557	583				
	19.0	347.0	397.0	426	450	475	499	524	549				
	19.5	321.0	367.0	401	425	448	471	494	517				
	20.0	298.0	341.0	379	401	423	445	466	488				
	20.5	277.0	316.0	358	379	400	420	441	461				
	21.0	257.0	294.0	333.0	359	378	397	417	436				
	21.5	240.0	274.0	311.0	340	358	376	394	413				
	22.0	224.0	256.0	290.0	322	339	356	374	391				
	22.5	209.0	239.0	271.0	305.0	322	338	354	370				
	23.0	196.0	224.0	254.0	286.0	305	321	336	351				
	23.5	184.0	210.0	238.0	268.0	290	304	319	334				
	24.0	172.0	197.0	223.0	252.0	275	289	303	317				
	24.5	162.0	185.0	210.0	236.0	262	275	288	301				
	25.0	153.0	174.0	198.0	223.0	249.0	262	274	286				
	25.5	144.0	164.0	186.0	210.0	235.0	249	261	272				
	26.0	136.0	155.0	176.0	198.0	221.0	237	248	259				
	26.5	128.0	146.0	166.0	187.0	209.0	226	236	247				
	27.0	121.0	138.0	157.0	177.0	198.0	215	225	235				
	27.5	115.0	131.0	149.0	167.0	187.0	205	214	224				
	28.0	109.0	124.0	141.0	158.0	177.0	196	204	213				
	28.5	103.0	118.0	133.0	150.0	168.0	187	195	203				
	29.0	98.0	112.0	127.0	143.0	160.0	178.0	186	194				
	29.5	93.0	106.0	120.0	135.0	152.0	169.0	177	185				
	30.0	88.0	101.0	114.0	129.0	144.0	161.0	169	177				
	30.5	84.0	96.0	109.0	123.0	137.0	153.0	162	168				
	31.0	80.0	91.0	104.0	117.0	131.0	146.0	154	161				
	31.5	76.0	87.0	99.0	111.0	125.0	139.0	147	153				
	32.0	73.0	83.0	94.0	106.0	119.0	132.0	141	146				
	32.5	69.0	79.0	90.0	101.0	113.0	126.0	134	140				
	33.0	66.0	76.0	86.0	97.0	108.0	121.0	128	133				
	33.5	63.0	72.0	82.0	92.0	104.0	115.0	122	127				
	34.0	61.0	69.0	79.0	88.0	99.0	110.0	117	121				
	34.5	58.0	66.0	75.0	85.0	95.0	106.0	111	116				
	35.0	56.0	64.0	72.0	81.0	91.0	101.0	106	110				
	35.5	53.0	61.0	69.0	78.0	87.0	97.0	101	105				
	36.0	51.0	58.0	66.0	75.0	83.0	93.0	97	100				


TABLE 2: CS210 NWC - #10 REBAR

TABLE 2: CS120 NWC - #10 REBAR							IMPERIAL UNITS	
Base Steel Thickness = 0.0435"							Area of Steel Deck Included	
# 10 Rebar							Normal Weight Concrete = 145 lb/ft ³	
SLAB WEIGHT (psf)	54.4	60.5	66.5	72.6	78.6	84.6	90.7	96.7
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34
MAX. UNSHORED ONE SPAN (ft)	15.3	14.6	14.0	13.5	13.0	12.6	12.2	11.8
MAX. UNSHORED TWO SPAN (ft)	11.8	10.9	10.1	9.4	8.8	8.3	7.8	7.4
MAX. UNSHORED THREE SPAN (ft)	13.4	12.4	11.5	10.7	10.0	9.4	8.9	8.4
I _w (in ⁴)	66.7	76.9	87.6	99.0	111.3	124.4	139	154
I _b (in ⁴)	40.1	45.3	50.9	56.9	63.3	70.1	77.3	84.9
DEFLECTION PARAMETER (SLDP)	840	961	1089	1226	1373	1530	1698	1879
DEFLECTION PARAMETER (SWDP)	0.622	0.600	0.579	0.559	0.539	0.519	0.499	0.479
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)						
To be established by the designer.	18.0	400	435	462	488	514	540	567
	18.5	369	410	434	459	484	508	533
	19.0	340	386	409	432	455	478	502
	19.5	315	360	386	408	429	451	473
	20.0	292	334	364	385	405	426	446
	20.5	271	310	344	364	383	402	421
	21.0	252	288	326	344	362	380	398
	21.5	235	269	304	326	343	360	377
	22.0	219	251	284	309	325	341	357
	22.5	205	234	266	293	308	323	338
	23.0	192	219	249	278	292	306	321
	23.5	180	206	233	263	277	291	304
	24.0	169	193	219	246	263	276	289
	24.5	159	182	206	232	250	262	275
	25.0	149	171	194	218	238	250	261
	25.5	141	161	183	205	227	237	248
	26.0	133	152	172	194	216	226	236
	26.5	125	143	163	183	205	215	225
	27.0	119	136	154	173	194	205	214
	27.5	112	128	146	164	183	195	204
	28.0	106	122	138	155	174	186	194
	28.5	101	115	131	147	165	177	185
	29.0	96	109	124	140	156	169	176
	29.5	91	104	118	133	149	161	168
	30.0	86	99	112	126	141	154	160
	30.5	82	94	107	120	134	147	153
	31.0	78	90	102	114	128	140	146
	31.5	75	85	97	109	122	134	139
	32.0	71	81	92	104	116	128	133
	32.5	68	78	88	99	111	122	127
	33.0	65	74	84	95	106	116	121
	33.5	62	71	80	91	101	111	115
	34.0	59	68	77	87	97	106	110
	34.5	57	65	74	83	93	101	105
	35.0	54	62	71	79	89	96	100
	35.5	52	60	68	76	85	92	95
	36.0	50	57	65	73	82	87	91

NOTES:

1. The “SLAB WEIGHT” is made up of the self-weight of the steel deck, the reinforcing bar, and the concrete slab, which has been accounted for in the strength values of the load table.
 2. See maximum unshored span conditions above to establish the number of shores required.
 3. “d” next to values in the Table indicates instantaneous deflection controls due to superimposed loads.
 4. “SLAB THICKNESS” is measured from the top of the concrete to the bottom of the steel deck.
 5. I_u is the uncracked moment of inertia based on equivalent steel
 6. I_c is the cracked moment of inertia based on equivalent steel
 7. An explanation of deflection parameters SLDP & SWDP is in the example on page 2.

TABLE 2: CS210 NWC - #10 Rebar

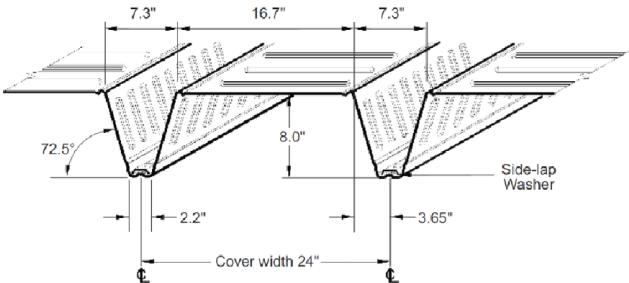



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 2: CS210 NWC - #11 REBAR

IMPERIAL UNITS									
Base Steel Thickness = 0.0375"									
# 11 Rebar	Area of Steel Deck Included								
Normal Weight Concrete = 145 lb/ft ³									
SLAB WEIGHT (psf)	54.5	60.6	66.6	72.7	78.7	84.7	90.8	96.8	
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	12.5	11.9	11.4	11.0	10.6	10.3	10.0	9.7	
MAX. UNSHORED TWO SPAN (ft)	8.9	8.2	7.6	7.1	6.6	6.2	5.8	5.5	
MAX. UNSHORED THREE SPAN (ft)	10.1	9.3	8.6	8.0	7.5	7.1	6.6	6.2	
I _y (in ⁴)	68.1	78.6	89.6	101.4	114.0	127.6	142	158	
I _c (in ⁴)	42.5	48.2	54.2	60.7	67.5	74.9	82.6	90.8	
DEFLECTION PARAMETER (SLDP)	870	997	1132	1275	1428	1593	1768	1956	
DEFLECTION PARAMETER (SWDP)	0.611	0.588	0.567	0.546	0.526	0.507	0.487	0.468	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	18.0	414.d	475.d	520	549	579	609	638	668
	18.5	382.d	437.d	490	517	545	573	601	628
	19.0	352.d	404.d	458.d	488	514	540	566	592
	19.5	326.d	373.d	424.d	460	485	509	534	558
	20.0	302.d	346.d	393.d	435	458	481	504	527
	20.5	280.d	321.d	365.d	411.d	433	455	477	498
	21.0	261.d	299.d	339.d	382.d	410	430	451	471
	21.5	243.d	279.d	316.d	356.d	388	408	427	446
	22.0	227.d	260.d	295.d	333.d	368	386	405	423
	22.5	212.d	243.d	276.d	311.d	348.d	367	384	401
	23.0	199.d	228.d	258.d	291.d	326.d	348	365	381
	23.5	186.d	213.d	242.d	273.d	306.d	331	346	362
	24.0	175.d	200.d	227.d	256.d	287.d	315	329	344
	24.5	164.d	188.d	214.d	241.d	270.d	299	313	327
	25.0	155.d	177.d	201.d	227.d	254.d	283.d	298	311
	25.5	146.d	167.d	190.d	214.d	239.d	267.d	284	296
	26.0	137.d	158.d	179.d	202.d	226.d	252.d	270	282
	26.5	130.d	149.d	169.d	190.d	213.d	238.d	258	269
	27.0	123.d	141.d	160.d	180.d	202.d	225.d	246	257
	27.5	116.d	133.d	151.d	170.d	191.d	213.d	235	245
	28.0	110.d	126.d	143.d	161.d	181.d	202.d	224.d	233
	28.5	104.d	120.d	136.d	153.d	171.d	191.d	212.d	223
	29.0	99.d	114.d	129.d	145.d	163.d	181.d	201.d	213
	29.5	94.d	108.d	122.d	138.d	155.d	172.d	191.d	203
	30.0	89.d	103.d	116.d	131.d	147.d	164.d	182.d	194
	30.5	85.d	98.d	111.d	125.d	140.d	156.d	173.d	185
	31.0	81.d	93.d	106.d	119.d	133.d	148.d	165.d	177
	31.5	77.d	89.d	101.d	113.d	127.d	142.d	157.d	169
	32.0	74.d	84.d	96.d	108.d	121.d	135.d	150.d	162
	32.5	70.d	81.d	92.d	103.d	116.d	129.d	143.d	155
	33.0	67.d	77.d	87.d	99.d	110.d	123.d	137.d	148
	33.5	64.d	74.d	84.d	94.d	106.d	118.d	131.d	141
	34.0	61.d	70.d	80.d	90.d	101.d	113.d	125.d	135
	34.5	59.d	67.d	77.d	86.d	97.d	108.d	120.d	129
	35.0	56.d	65.d	73.d	83.d	93.d	103.d	115.d	123
	35.5	54.d	62.d	70.d	79.d	89.d	99.d	110.d	118
	36.0	52.d	59.d	67.d	76.d	85.d	95.d	105.d	113

TABLE 2: CS210 NWC - #11 REBAR

IMPERIAL UNITS									
Base Steel Thickness = 0.0495"									
# 11 Rebar	Area of Steel Deck Included								
Normal Weight Concrete = 145 lb/ft ³									
SLAB WEIGHT (psf)	55.3	61.4	67.4	73.5	79.5	85.5	91.6	97.6	
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	17.3	16.6	16.0	15.4	14.9	14.4	14.0	13.6	
MAX. UNSHORED TWO SPAN (ft)	15.0	13.8	12.8	12.0	11.2	10.5	9.9	9.4	
MAX. UNSHORED THREE SPAN (ft)	17.0	15.7	14.6	13.6	12.7	12.0	11.3	10.7	
I _y (in ⁴)	69.8	80.5	91.8	103.9	116.8	130.6	146	162	
I _c (in ⁴)	44.9	50.9	57.3	64.2	71.5	79.4	87.7	96.5	
DEFLECTION PARAMETER (SLDP)	902	1033	1173	1322	1481	1652	1834	2030	
DEFLECTION PARAMETER (SWDP)	0.605	0.582	0.560	0.539	0.519	0.500	0.480	0.461	
SLAB THICKNESS (in.)	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	
SHORING	SPAN (ft)	MAXIMUM NOMINAL LOAD (psf)							
To be established by the designer.	18.0	430.d	492.d	556	589	622	655	688	721
	18.5	396.d	453.d	515.d	554	585	617	648	679
	19.0	365.d	419.d	475.d	523	552	581	610	640
	19.5	338.d	387.d	439.d	493	521	548	576	604
	20.0	313.d	359.d	407.d	459.d	492	518	544	570
	20.5	291.d	333.d	378.d	426.d	466	490	515	539
	21.0	271.d	310.d	352.d	396.d	441	464	487	510
	21.5	252.d	289.d	328.d	369.d	414.d	440	462	483
	22.0	235.d	270.d	306.d	345.d	386.d	417	438	458
	22.5	220.d	252.d	286.d	322.d	361.d	396	416	435
	23.0	206.d	236.d	268.d	302.d	338.d	376	395	413
	23.5	193.d	221.d	251.d	283.d	317.d	354.d	375	393
	24.0	181.d	208.d	236.d	266.d	298.d	332.d	357	374
	24.5	170.d	195.d	222.d	250.d	280.d	312.d	340	356
	25.0	160.d	184.d	209.d	235.d	263.d	294.d	324	339
	25.5	151.d	173.d	196.d	221.d	248.d	277.d	307.d	323
	26.0	143.d	163.d	185.d	209.d	234.d	261.d	290.d	307
	26.5	135.d	154.d	175.d	197.d	221.d	247.d	274.d	293
	27.0	127.d	146.d	166.d	187.d	209.d	233.d	259.d	280
	27.5	121.d	138.d	157.d	177.d	198.d	221.d	245.d	267
	28.0	114.d	131.d	148.d	167.d	187.d	209.d	232.d	255
	28.5	108.d	124.d	141.d	159.d	178.d	198.d	220.d	244.d
	29.0	103.d	118.d	134.d	151.d	169.d	188.d	209.d	231.d
	29.5	98.d	112.d	127.d	143.d	160.d	179.d	198.d	220.d
	30.0	93.d	106.d	121.d	136.d	152.d	170.d	189.d	209.d
	30.5	88.d	101.d	115.d	129.d	145.d	162.d	180.d	199.d
	31.0	84.d	96.d	109.d	123.d	138.d	154.d	171.d	189.d
	31.5	80.d	92.d	104.d	117.d	132.d	147.d	163.d	180.d
	32.0	76.d	88.d	99.d	112.d	126.d	140.d	156.d	172.d
	32.5	73.d	84.d	95.d	107.d	120.d	134.d	148.d	164.d
	33.0	70.d	80.d	91.d	102.d	114.d	128.d	142.d	157.d
	33.5	67.d	76.d	87.d	98.d	109.d	122.d	136.d	150.d
	34.0	64.d	73.d	83.d	93.d	105.d	117.d	130.d	143.d
	34.5	61.d	70.d	79.d	89.d	100.d	112.d	124.d	137.d
	35.0	58.d	67.d	76.d	86.d	96.d	107.d	119.d	131.d
	35.5	56.d	64.d	73.d	82.d	92.d	103.d	114.d	126.d
	36.0	54.d	62.d	70.d	79.d	88.d	98.d	109.d	121.d

TABLE 2: CS210 NWC - #11 REBAR

IMPERIAL UNITS									
Base Steel Thickness = 0.0435"									
# 11 Rebar	Area of Steel Deck Included								
Normal Weight Concrete = 145 lb/ft ³									
SLAB WEIGHT (psf)	54.9	61.0	67.0	73.1	79.1	85.1	91.2	97.2	
CONCRETE VOLUME (yd ³ /100ft ²)	1.26	1.41	1.57	1.72	1.88	2.03	2.18	2.34	
MAX. UNSHORED ONE SPAN (ft)	15.2	14.6	14.0	13.5	13.0	12.6	12.2	11.8	
MAX. UNSHORED TWO SPAN (ft)	11.7	10.8	10.0	9.4	8.8	8.2	7.8	7.4</td	



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

FIGURE 1 – ComSlab 210 Floor Deck




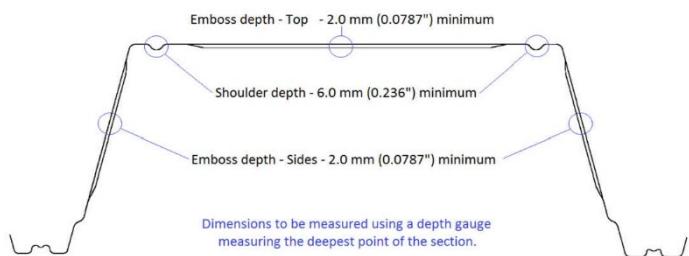


FIGURE 2 – ComSlab 120 Floor Deck

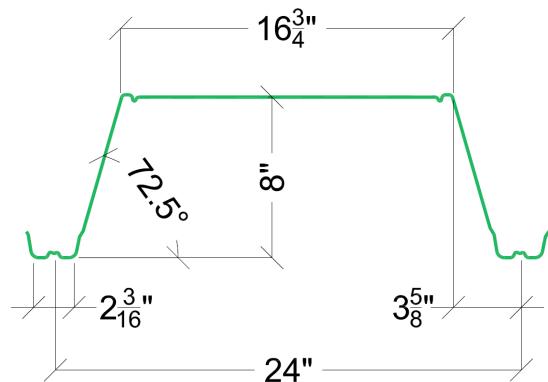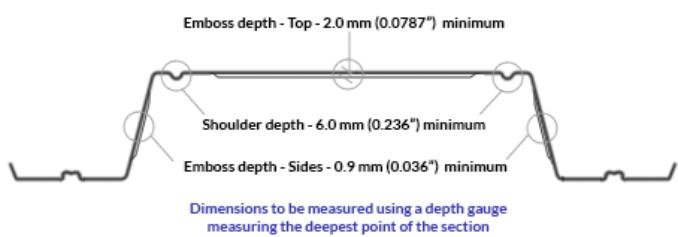

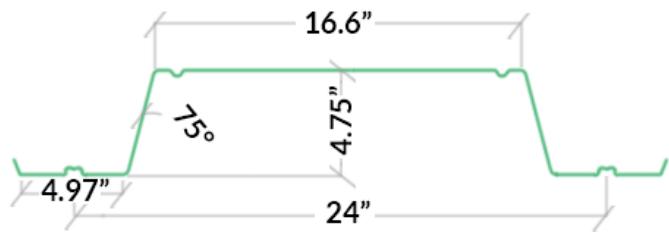

EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 3: CS120 LWC - #3 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0375 in.								Light Weight Concrete = 110 lb/ft³								
Rebar # 3																
SLAB WEIGHT (psf)	36.7	39.0	43.6	48.1	52.7	57.3	61.9	SLAB WEIGHT (psf)	37.1	39.4	43.9	48.5	53.1	57.7	62.3	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	12.6	12.3	11.7	11.3	10.9	10.5	10.2	MAX. UNSHORED 1 SPAN (ft)	13.5	13.2	12.6	12.1	11.7	11.3	10.9	
MAX. UNSHORED 2 SPAN (ft)	13.3	12.8	11.8	11.0	10.3	9.60	9.10	MAX. UNSHORED 2 SPAN (ft)	15.7	15.3	14.6	14.0	13.1	12.3	11.6	
MAX. UNSHORED 3 SPAN (ft)	14.8	14.4	13.4	12.5	11.6	10.9	10.3	MAX. UNSHORED 3 SPAN (ft)	15.9	15.5	14.8	14.2	13.6	13.2	12.7	
I _u in⁴	22.5	24.7	29.6	35.1	41.4	48.6	56.6	I _u in⁴	22.9	25.1	30.0	35.6	42.0	49.2	57.4	
I _c in⁴	9.40	10.1	11.7	13.5	15.4	17.4	19.6	I _c in⁴	10.0	10.8	12.5	14.4	16.5	18.7	21.1	
DEFL. PARAMETER (LLDP)	251	274	325	382	447	519	599	DEFL. PARAMETER (LLDP)	259	283	335	394	460	534	617	
DEFL. PARAMETER (SWDP)	1.24	1.20	1.12	1.05	0.971	0.900	0.834	DEFL. PARAMETER (SWDP)	1.24	1.20	1.12	1.04	0.964	0.894	0.828	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	118	126	140	155	170	185	14.0	135	143	160	178	195	212	229	
	15.0	99	106	118	131	143	156		15.0	114	121	135	150	165	179	194
	16.0	84	89	100	110	121	131		16.0	96	103	115	127	140	152	165
	17.0	71	76	85	94	103	112		17.0	82	88	98	109	119	130	141
	18.0	61	64	72	80	87	95		18.0	70	75	84	93	102	111	120
	19.0	52	55	61	68	74	81		19.0	60	64	72	80	88	95	103
	20.0	44	47	52	58	63	69		20.0	52	55	62	68	75	82	89
	21.0			44	49	54	58		21.0	44	47	53	59	65	70	76
	22.0				41	45	49		22.0		40	45	50	55	60	65
	23.0						41		23.0				43	47	51	56
	24.0								24.0				40	44	47	
	25.0								25.0							
	26.0								26.0							
	27.0								27.0							
	28.0								28.0							
	29.0								29.0							
	30.0								30.0							

TABLE 3: CS120 LWC - #3 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0435 in.								Light Weight Concrete = 110 lb/ft³								
Rebar # 3																
SLAB WEIGHT (psf)	37.1	39.4	43.9	48.5	53.1	57.7	62.3	SLAB WEIGHT (psf)	37.1	39.4	43.9	48.5	53.1	57.7	62.3	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	13.5	13.2	12.6	12.1	11.7	11.3	10.9	MAX. UNSHORED 1 SPAN (ft)	13.5	13.2	12.6	12.1	11.7	11.3	10.9	
MAX. UNSHORED 2 SPAN (ft)	15.7	15.3	14.6	14.0	13.1	12.3	11.6	MAX. UNSHORED 2 SPAN (ft)	15.7	15.3	14.6	14.0	13.1	12.3	11.6	
MAX. UNSHORED 3 SPAN (ft)	15.9	15.5	14.8	14.2	13.6	13.2	12.7	MAX. UNSHORED 3 SPAN (ft)	15.9	15.5	14.8	14.2	13.6	13.2	12.7	
I _u in⁴	22.9	25.1	30.0	35.6	42.0	49.2	57.4	I _u in⁴	22.9	25.1	30.0	35.6	42.0	49.2	57.4	
I _c in⁴	10.0	10.8	12.5	14.4	16.5	18.7	21.1	I _c in⁴	10.0	10.8	12.5	14.4	16.5	18.7	21.1	
DEFL. PARAMETER (LLDP)	259	283	335	394	460	534	617	DEFL. PARAMETER (LLDP)	259	283	335	394	460	534	617	
DEFL. PARAMETER (SWDP)	1.24	1.20	1.12	1.04	0.964	0.894	0.828	DEFL. PARAMETER (SWDP)	1.24	1.20	1.12	1.04	0.964	0.894	0.828	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	135	143	160	178	195	212	14.0	135	143	160	178	195	212	229	
	15.0	114	121	135	150	165	179		15.0	114	121	135	150	165	179	194
	16.0	96	103	115	127	140	152		16.0	96	103	115	127	140	152	165
	17.0	82	88	98	109	119	130		17.0	82	88	98	109	119	130	141
	18.0	70	75	84	93	102	111		18.0	70	75	84	93	102	111	120
	19.0	60	64	72	80	88	95		19.0	60	64	72	80	88	95	103
	20.0	52	55	62	68	75	82		20.0	52	55	62	68	75	82	89
	21.0	44	47	53	59	65	71		21.0	44	47	53	59	65	70	76
	22.0						41		22.0				40	45	50	55
	23.0								23.0				43	47	51	56
	24.0								24.0				40	44	47	
	25.0								25.0							
	26.0								26.0							
	27.0								27.0							
	28.0								28.0							
	29.0								29.0							
	30.0								30.0							

TABLE 3: CS120 LWC - #3 REBAR								IMPERIAL UNITS							
Base Steel Thickness = 0.0495 in.								Light Weight Concrete = 110 lb/ft³							
Rebar # 3															
SLAB WEIGHT (psf)	37.4	39.7	44.3	48.9	53.5	58.1	62.7	SLAB WEIGHT (psf)	37.4	39.7	44.3	48.9	53.5	58.1	62.7
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	14.4	14.1	13.4	12.9	12.4	12.0	11.6	MAX. UNSHORED 1 SPAN (ft)	14.4	14.1	13.4	12.9	12.4	12.0	11.6
MAX. UNSHORED 2 SPAN (ft)	16.5	16.2	15.5	14.9	14.3	13.8	13.4	MAX. UNSHORED 2 SPAN (ft)	16.5	16.2	15.5	14.9	14.3	13.8	13.4
MAX. UNSHORED 3 SPAN (ft)	16.7	16.4	15.7	15.1	14.5	14.0	13.5	MAX. UNSHORED 3 SPAN (ft)	16.7	16.4	15.7	15.1	14.5	14.0	13.5
I _u in⁴	23.3	25.6	30.6	36.3	42.7	50.0	58.2	I _u in⁴	23.3	25.6	30.6	36.3	42.7	50.0	58.2
I _c in⁴	10.7	11.5	13.4	15.4	17.7	20.1	22.6	I _c in⁴	10.7	11.5	13.4	15.4	17.7	20.1	22.6
DEFL. PARAMETER (LLDP)	267	292	346	407	475	551	636	DEFL. PARAMETER (LLDP)	267	292	346	407	475	551	636
DEFL. PARAMETER (SWDP)	1.23	1.19	1.11	1.03	0.955	0.886	0.821	DEFL. PARAMETER (SWDP)	1.23	1.19	1.11	1.03	0.955	0.886	0.821
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)</th													



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 3: CS120 LWC - #4 REBAR

Base Steel Thickness = 0.0375 in.

Rebar # 4		IMPERIAL UNITS					
		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	36.8	39.1	43.7	48.3	52.9	57.5	62.0
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	12.6	12.3	11.7	11.3	10.9	10.5	10.2
MAX. UNSHORED 2 SPAN (ft)	13.3	12.8	11.8	11.0	10.2	9.60	9.00
MAX. UNSHORED 3 SPAN (ft)	14.7	14.4	13.4	12.4	11.6	10.9	10.3
I _u in⁴	22.8	25.1	30.0	35.6	42.0	49.3	57.4
I _c in⁴	10.0	10.8	12.6	14.5	16.5	18.8	21.2
DEFL. PARAMETER (LLDP)	258	282	335	394	461	535	618
DEFL. PARAMETER (SWDP)	1.23	1.19	1.11	1.03	0.960	0.890	0.824
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	142	151	168	185	202	220
	15.0	120	127	142	157	171	186
	16.0	102	108	121	133	146	158
	17.0	87	93	103	114	125	135
	18.0	75	79	89	98	107	116
	19.0	64	68	76	84	92	100
	20.0	55	59	66	72	79	86
	21.0	48	51	56	62	68	74
	22.0	41	44	48	53	58	63
	23.0			42	46	50	54
	24.0				43	46	50
	25.0						42
	26.0						
	27.0						
	28.0						
	29.0						
	30.0						

TABLE 3: CS120 LWC - #4 REBAR

Base Steel Thickness = 0.0495 in.

Rebar # 4		IMPERIAL UNITS					
		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	37.6	39.9	44.5	49.1	53.6	58.2	62.8
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	14.4	14.0	13.4	12.9	12.4	12.0	11.6
MAX. UNSHORED 2 SPAN (ft)	16.5	16.2	15.5	14.9	14.3	13.8	13.4
MAX. UNSHORED 3 SPAN (ft)	16.7	16.4	15.7	15.1	14.5	14.0	13.5
I _u in⁴	23.6	25.9	31.0	36.8	43.3	50.7	59.0
I _c in⁴	11.3	12.2	14.2	16.4	18.8	21.4	24.2
DEFL. PARAMETER (LLDP)	274	300	355	418	488	567	654
DEFL. PARAMETER (SWDP)	1.22	1.17	1.09	1.02	0.945	0.876	0.812
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	174	185	207	229	251	273
	15.0	148	157	176	195	214	233
	16.0	126	135	151	167	183	199
	17.0	109	116	130	144	157	171
	18.0	94	100	112	124	136	148
	19.0	81	87	97	108	118	129
	20.0	71	75	84	94	103	112
	21.0	62	66	73	81	89	97
	22.0	54	57	64	71	78	85
	23.0	47	50	56	62	68	74
	24.0	41	43	48	54	59	64
	25.0			42	47	51	56
	26.0			40	44	48	52
	27.0				42	45	
	28.0						
	29.0						
	30.0						

TABLE 3: CS120 LWC - #4 REBAR


Base Steel Thickness = 0.0435 in.

Rebar # 4		IMPERIAL UNITS					
		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	37.2	39.5	44.1	48.7	53.3	57.8	62.4
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	13.5	13.2	12.6	12.1	11.7	11.3	10.9
MAX. UNSHORED 2 SPAN (ft)	15.7	15.3	14.6	14.0	13.1	12.3	11.6
MAX. UNSHORED 3 SPAN (ft)	15.8	15.4	14.8	14.2	13.6	13.2	12.7
I _u in⁴	23.2	25.5	30.5	36.2	42.6	49.9	58.2
I _c in⁴	10.6	11.5	13.3	15.4	17.6	20.0	22.6
DEFL. PARAMETER (LLDP)	266	290	344	405	474	550	635
DEFL. PARAMETER (SWDP)	1.23	1.18	1.10	1.03	0.953	0.884	0.819
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	158	168	188	207	227	247
	15.0	134	142	159	176	193	209
	16.0	114	122	136	150	164	179
	17.0	98	104	117	129	141	153
	18.0	85	90	100	111	122	132
	19.0	73	78	87	96	105	114
	20.0	63	67	75	83	91	99
	21.0	55	58	65	72	79	86
	22.0	47	50	56	62	68	74
	23.0	41	44	49	54	59	64
	24.0			42	46	51	55
	25.0				44	48	51
	26.0					41	44
	27.0						
	28.0						
	29.0						
	30.0						

NOTES:

- The "SLAB WEIGHT" is made up of the self-weight of the steel deck, the reinforcing bar, and the concrete slab, which has been accounted for in the strength values of the load table.
- See maximum unshored span conditions above to establish the number of shores required.
- "d" next to values in the Table indicates instantaneous deflection controls due to superimposed loads.
- "SLAB THICKNESS" is measured from the top of the concrete to the bottom of the steel deck.
- I_u is the uncracked moment of inertia based on equivalent steel
- I_c is the cracked moment of inertia based on equivalent steel
- An explanation of deflection parameters SLDP & SWDP is in the example on page 2.

TABLE 3: CS120 LWC - #4 Rebar

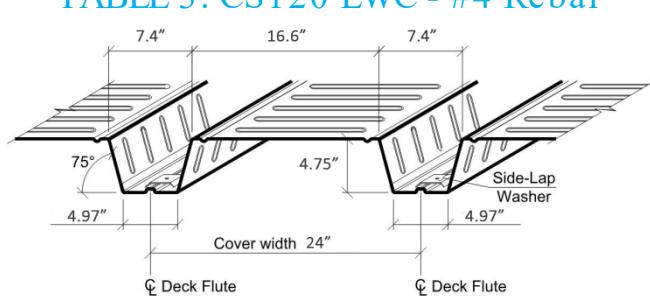



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016


Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 3: CS120 LWC - #5 REBAR								IMPERIAL UNITS						
Base Steel Thickness = 0.0375 in.								Light Weight Concrete = 110 lb/ft³						
Rebar # 5														
SLAB WEIGHT (psf)		37.0	39.3	43.9	48.5	53.1	57.6	62.2						
CONCRETE VOLUME (yd³/100ft²)		1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)		12.5	12.2	11.7	11.2	10.8	10.5	10.1						
MAX. UNSHORED 2 SPAN (ft)		13.3	12.7	11.8	10.9	10.2	9.60	9.00						
MAX. UNSHORED 3 SPAN (ft)		14.7	14.4	13.4	12.4	11.6	10.9	10.3						
I _u in⁴		23.2	25.5	30.5	36.2	42.7	50.1	58.4						
I _c in⁴		10.7	11.6	13.5	15.7	18.0	20.4	23.1						
DEFL. PARAMETER (LLDP)		267	292	347	408	478	555	641						
DEFL. PARAMETER (SWDP)		1.22	1.18	1.10	1.02	0.947	0.878	0.813						
SLAB THICKNESS (in.)		7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)												
To be established by the designer.	14.0	171	182	202	223	243	264	284						
	15.0	146	154	172	189	207	224	241						
	16.0	125	132	147	162	177	192	207						
	17.0	107	114	126	139	152	165	178						
	18.0	93	98	109	120	131	142	153						
	19.0	80	85	95	104	114	123	133						
	20.0	70	74	82	91	99	107	115						
	21.0	61	64	72	79	86	93	100						
	22.0	53	56	62	69	75	81	87						
	23.0	46	49	54	60	65	70	76						
	24.0	40	42	47	52	56	61	66						
	25.0			41	45	49	53	57						
	26.0					42	46	49						
	27.0							42						
	28.0													
	29.0													
	30.0													

TABLE 3: CS120 LWC - #5 REBAR								IMPERIAL UNITS						
Base Steel Thickness = 0.0435 in.								Light Weight Concrete = 110 lb/ft³						
Rebar # 5														
SLAB WEIGHT (psf)		37.4	39.7	44.3	48.9	53.4	58.0	62.6						
CONCRETE VOLUME (yd³/100ft²)		1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)		13.5	13.2	12.6	12.1	11.6	11.2	10.9						
MAX. UNSHORED 2 SPAN (ft)		15.6	15.2	14.6	14.0	13.1	12.3	11.6						
MAX. UNSHORED 3 SPAN (ft)		15.8	15.4	14.7	14.1	13.6	13.1	12.7						
I _u in⁴		23.5	25.8	31.0	36.8	43.3	50.8	59.1						
I _c in⁴		11.3	12.2	14.3	16.5	19.0	21.6	24.5						
DEFL. PARAMETER (LLDP)		274	300	356	419	490	569	658						
DEFL. PARAMETER (SWDP)		1.21	1.17	1.09	1.01	0.941	0.872	0.808						
SLAB THICKNESS (in.)		7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)												
To be established by the designer.	14.0	187	199	221	244	267	290	313						
	15.0	159	169	189	208	228	247	267						
	16.0	137	145	162	178	195	212	229						
	17.0	118	125	140	154	168	183	197						
	18.0	102	108	121	133	146	158	171						
	19.0	89	94	105	116	127	138	149						
	20.0	77	82	92	101	111	120	129						
	21.0	68	72	80	88	97	105	113						
	22.0	59	63	70	77	84	92	99						
	23.0	52	55	61	67	74	80	86						
	24.0	45	48	53	59	64	70	76						
	25.0			42	47	51	56	61						
	26.0					41	45	49	53					
	27.0							43	46	50				
	28.0													43
	29.0													
	30.0													

TABLE 3: CS120 LWC - #5 REBAR								IMPERIAL UNITS						
Base Steel Thickness = 0.0495 in.								Light Weight Concrete = 110 lb/ft³						
Rebar # 5														
SLAB WEIGHT (psf)		37.8	40.1	44.7	49.2	53.8	58.4	63.0						
CONCRETE VOLUME (yd³/100ft²)		1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)		14.4	14.0	13.4	12.9	12.4	12.0	11.6						
MAX. UNSHORED 2 SPAN (ft)		16.5	16.2	15.5	14.9	14.3	13.8	13.4						
MAX. UNSHORED 3 SPAN (ft)		16.7	16.3	15.7	15.0	14.5	14.0	13.5						
I _u in⁴		24.0	26.3	31.5	37.4	44.0	51.5	60.0						
I _c in⁴		11.9	12.9	15.1	17.5	20.1	22.9	26.0						
DEFL. PARAMETER (LLDP)		282	309	366	431	504	586	676						
DEFL. PARAMETER (SWDP)		1.20	1.16	1.08	1.01	0.933	0.865	0.801						
SLAB THICKNESS (in.)		7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)												
To be established by the designer.	14.0	203	215	240	266	291	316	342						
	15.0	173	184	205	227	248	270	292						
	16.0	148	158	176	195	213	232	251						
	17.0	128	136	152	168	184	201	217						
	18.0	111	118	132	146	160	174	188						
	19.0	97	103	115	127	140	152	164						
	20.0	85	90	101	111	122	133	143						
	21.0	74	79	88	98	107	116	126						
	22.0	65	69	77	86	94	102	110						
	23.0	57	61	68	75	82	90	97						
	24.0	50	53	60	66	72	79	85						
	25.0	44	47	52	58	64	69	75						
	26.0			41	46	51	56	61	66					
	27.0				40	44	49	53	57					
	28.0						43	46	50					
	29.0							40	43					
	30.0													

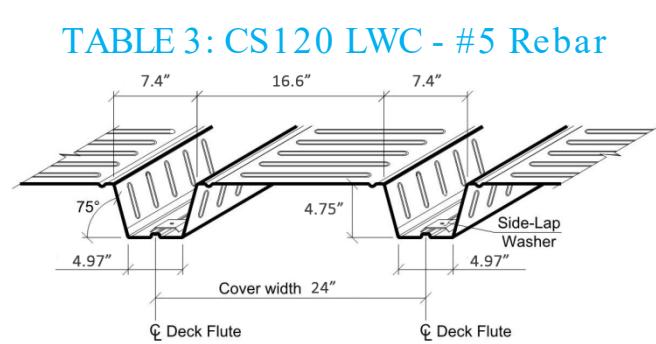



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 3: CS120 LWC - #6 REBAR							
IMPERIAL UNITS							
Base Steel Thickness = 0.0375 in.							
Rebar # 6		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	37.3	39.5	44.1	48.7	53.3	57.9	62.5
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	12.5	12.2	11.7	11.2	10.8	10.5	10.1
MAX. UNSHORED 2 SPAN (ft)	13.2	12.7	11.7	10.9	10.2	9.60	9.00
MAX. UNSHORED 3 SPAN (ft)	14.7	14.3	13.3	12.4	11.6	10.9	10.2
I _u in⁴	23.6	25.9	31.1	36.9	43.6	51.1	59.5
I _c in⁴	11.5	12.5	14.6	17.0	19.5	22.3	25.3
DEFL. PARAMETER (LLDP)	276	302	360	424	497	577	667
DEFL. PARAMETER (SWDP)	1.21	1.16	1.08	1.01	0.933	0.864	0.801
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	206	218	243	267	291	316
	15.0	176	186	207	228	249	269
	16.0	151	160	178	196	214	232
	17.0	131	138	154	169	185	200
	18.0	114	120	134	147	160	174
	19.0	99	105	117	128	140	152
	20.0	87	92	102	112	122	133
	21.0	76	81	89	98	107	116
	22.0	67	71	79	86	94	102
	23.0	59	62	69	76	83	90
	24.0	52	55	61	67	73	79
	25.0	45	48	53	59	64	69
	26.0		42	47	51	56	61
	27.0			41	45	49	53
	28.0					43	46
	29.0						40
	30.0						43


TABLE 3: CS120 LWC - #6 REBAR							
IMPERIAL UNITS							
Base Steel Thickness = 0.0435 in.							
Rebar # 6		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	37.6	39.9	44.5	49.1	53.7	58.3	62.8
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	13.5	13.1	12.6	12.1	11.6	11.2	10.9
MAX. UNSHORED 2 SPAN (ft)	15.6	15.2	14.5	14.0	13.1	12.3	11.6
MAX. UNSHORED 3 SPAN (ft)	15.8	15.4	14.7	14.1	13.6	13.1	12.7
I _u in⁴	23.9	26.3	31.5	37.4	44.1	51.7	60.2
I _c in⁴	12.0	13.1	15.3	17.8	20.5	23.5	26.6
DEFL. PARAMETER (LLDP)	283	310	369	435	509	591	683
DEFL. PARAMETER (SWDP)	1.20	1.16	1.08	1.00	0.927	0.859	0.796
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	221	235	261	288	315	342
	15.0	189	201	223	246	269	292
	16.0	163	173	192	212	232	251
	17.0	141	150	167	184	201	218
	18.0	123	130	145	160	175	189
	19.0	107	114	127	140	153	166
	20.0	94	100	111	122	134	145
	21.0	83	88	98	108	118	128
	22.0	73	77	86	95	104	112
	23.0	64	68	76	84	91	99
	24.0	57	60	67	74	81	87
	25.0	50	53	59	65	71	77
	26.0	44	47	52	57	63	68
	27.0		41	46	51	55	60
	28.0			40	44	49	53
	29.0					43	46
	30.0						40

TABLE 3: CS120 LWC - #6 REBAR							
IMPERIAL UNITS							
Base Steel Thickness = 0.0495 in.							
Rebar # 6		Light Weight Concrete = 110 lb/ft³					
SLAB WEIGHT (psf)	38.0	40.3	44.9	49.5	54.1	58.6	63.2
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	14.3	14.0	13.4	12.8	12.4	11.9	11.6
MAX. UNSHORED 2 SPAN (ft)	16.5	16.1	15.5	14.8	14.3	13.8	13.4
MAX. UNSHORED 3 SPAN (ft)	16.6	16.3	15.6	15.0	14.4	13.9	13.5
I _u in⁴	24.3	26.7	32.0	38.0	44.8	52.5	61.1
I _c in⁴	12.7	13.8	16.1	18.8	21.6	24.7	28.1
DEFL. PARAMETER (LLDP)	291	319	379	447	523	607	701
DEFL. PARAMETER (SWDP)	1.19	1.15	1.07	0.992	0.920	0.853	0.790
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	236	251	280	309	338	368
	15.0	202	215	240	265	290	315
	16.0	174	185	206	228	250	271
	17.0	151	160	179	198	216	235
	18.0	132	140	156	172	189	205
	19.0	115	122	137	151	165	179
	20.0	101.1	107	120	133	145	158
	21.0	87.1	95	106	117	128	139
	22.0	76.1	83.1	93	103	113	123
	23.0	66.1	73.1	83	91	100	109
	24.0	58.1	64.1	73	81	88	96
	25.0	52.1	57.1	65	71	78	85
	26.0	46.1	50.1	57	63	69	75
	27.0	41.1	45.1	51	56	61	67
	28.0		40	45	49	54	59
	29.0				44	48	52
	30.0					42	46

NOTES:

- The “SLAB WEIGHT” is made up of the self-weight of the steel deck, the reinforcing bar, and the concrete slab, which has been accounted for in the strength values of the load table.
- See maximum unshored span conditions above to establish the number of shores required.
- “d” next to values in the Table indicates instantaneous deflection controls due to superimposed loads.
- “SLAB THICKNESS” is measured from the top of the concrete to the bottom of the steel deck.
- I_u is the uncracked moment of inertia based on equivalent steel
- I_c is the cracked moment of inertia based on equivalent steel
- An explanation of deflection parameters SLDP & SWDP is in the example on page 2.

TABLE 3: CS120 LWC - #6 Rebar

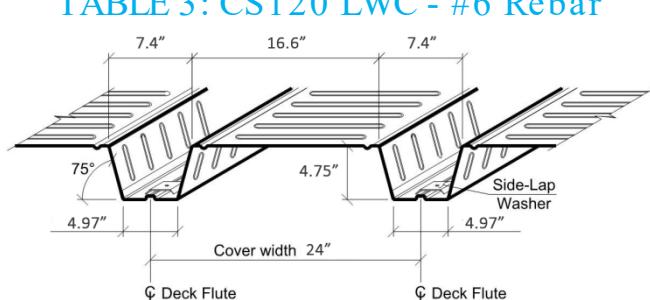



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016


Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 3: CS120 LWC - #7 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0375 in.													
Rebar # 7		Light Weight Concrete = 110 lb/ft³											
SLAB WEIGHT (psf)	37.5	39.8	44.4	49.0	53.6	58.1	62.7						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	12.5	12.2	11.7	11.2	10.8	10.4	10.1						
MAX. UNSHORED 2 SPAN (ft)	13.2	12.6	11.7	10.9	10.2	9.50	9.00						
MAX. UNSHORED 3 SPAN (ft)	14.7	14.3	13.3	12.4	11.5	10.8	10.2						
I _u in⁴	24.0	26.4	31.7	37.7	44.5	52.1	60.7						
I _c in⁴	12.3	13.4	15.8	18.4	21.3	24.4	27.7						
DEFL. PARAMETER (LLDP)	286	313	374	441	517	602	696						
DEFL. PARAMETER (SWDP)	1.19	1.15	1.07	0.991	0.919	0.851	0.788						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	245	260	289	318	346	375	404					
	15.0	210	222	247	272	297	321	346					
	16.0	181	192	213	234	256	277	299					
	17.0	157	166	185	204	222	241	259					
	18.0	136.0	145	161	178	194	210	226					
	19.0	116.0	127.0	141	156	170	184	198					
	20.0	99.0	109.0	124	137	149	162	174					
	21.0	86.0	94.0	110	121	132	143	154					
	22.0	75.0	82.0	97	107	116	126	136					
	23.0	65.0	72.0	85.0	95	103	112	120					
	24.0	57.0	63.0	75.0	84	91	99	107					
	25.0	51.0	56.0	66.0	74	81	88	94					
	26.0	45.0	50.0	59.0	66	72	78	84					
	27.0	40.0	44.0	53.0	59	64	69	74					
	28.0			47	52	56	61	66					
	29.0			42	46	50	54	58					
	30.0			40	44	48	51						

TABLE 3: CS120 LWC - #7 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0435 in.													
Rebar # 7		Light Weight Concrete = 110 lb/ft³											
SLAB WEIGHT (psf)	37.9	40.2	44.8	49.4	53.9	58.5	63.1						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	13.4	13.1	12.5	12.0	11.6	11.2	10.9						
MAX. UNSHORED 2 SPAN (ft)	15.6	15.2	14.5	13.9	13.0	12.2	11.5						
MAX. UNSHORED 3 SPAN (ft)	15.7	15.4	14.7	14.1	13.6	13.1	12.7						
I _u in⁴	24.3	26.8	32.1	38.2	45.0	52.8	61.4						
I _c in⁴	12.8	14.0	16.5	19.2	22.2	25.5	29.0						
DEFL. PARAMETER (LLDP)	292	321	382	451	529	615	711						
DEFL. PARAMETER (SWDP)	1.19	1.15	1.06	0.986	0.914	0.846	0.783						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	260	276	307	338	370	401	432					
	15.0	223	236	263	290	317	344	370					
	16.0	192	204	227	250	273	297	320					
	17.0	165.0	177	197	217	238	258	278					
	18.0	139.0	153.0	172	190	208	225	243					
	19.0	118.0	130.0	151	167	182	198	213					
	20.0	102.0	111.0	133.0	147	160	174	188					
	21.0	88.0	96.0	115.0	130	142	154	166					
	22.0	76.0	84.0	100.0	115	126	136	147					
	23.0	67.0	73.0	87.0	102	111	121	130					
	24.0	59.0	64.0	77.0	91	99	107	116					
	25.0	52.0	57.0	68.0	80.0	88	96	103					
	26.0	46.0	51.0	60.0	71.0	78	85	92					
	27.0	41.0	45.0	54.0	64.0	70	76	82					
	28.0		41.0	48.0	57	62	67	73					
	29.0			44.0	50	55	60	64					
	30.0			45	49	53	57						

TABLE 3: CS120 LWC - #7 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0495 in.													
Rebar # 7		Light Weight Concrete = 110 lb/ft³											
SLAB WEIGHT (psf)	38.3	40.6	45.2	49.7	54.3	58.9	63.5						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	14.3	14.0	13.4	12.8	12.3	11.9	11.6						
MAX. UNSHORED 2 SPAN (ft)	16.4	16.1	15.4	14.8	14.3	13.8	13.3						
MAX. UNSHORED 3 SPAN (ft)	16.6	16.3	15.6	15.0	14.4	13.9	13.5						
I _u in⁴	24.7	27.2	32.6	38.8	45.7	53.5	62.3						
I _c in⁴	13.4	14.6	17.2	20.1	23.2	26.7	30.3						
DEFL. PARAMETER (LLDP)	300	329	392	463	542	631	729						
DEFL. PARAMETER (SWDP)	1.18	1.14	1.06	0.979	0.907	0.840	0.778						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	274	291	325	359	392	426	460					
	15.0	235	250	279	308	337	366	395					
	16.0	203	216	241	266	291	316	341					
	17.0	170.0	186.0	209	231	253	275	297					
	18.0	143.0	157.0	183	202	221	240	259					
	19.0	122.0	133.0	159.0	178	194	211	228					
	20.0	104.0	114.0	136.0	157	171	186	201					
	21.0	90.0	99.0	118.0	139	152	165	178					
	22.0	78.0	86.0	102.0	121.0	135	146	158					
	23.0	69.0	75.0	90.0	106.0	120	130	140					
	24.0	60.0	66.0	79.0	93.0	107	116	125					
	25.0	53.0	59.0	70.0	82.0	95	103	112					
	26.0	47.0	52.0	62.0	73.0	85	92	100					
	27.0	42.0	46.0	55.0	65.0	76	82	89					
	28.0		42.0	50.0	59.0	68	73	79					
	29.0			45.0	53.0	60	65	71					
	30.0			40.0	48.0	54	58	63					

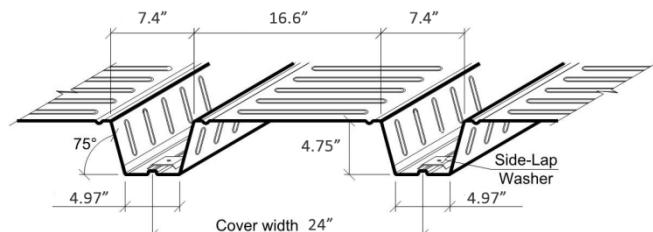



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 3: CS120 LWC - #8 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0375 in.							Light Weight Concrete = 110 lb/ft³						
Rebar # 8													
SLAB WEIGHT (psf)	37.8	40.1	44.7	49.3	53.9	58.5	63.0						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	12.5	12.2	11.6	11.2	10.8	10.4	10.1						
MAX. UNSHORED 2 SPAN (ft)	13.1	12.6	11.6	10.8	10.1	9.50	9.00						
MAX. UNSHORED 3 SPAN (ft)	14.6	14.3	13.2	12.3	11.5	10.8	10.2						
I _u in⁴	24.4	26.9	32.3	38.5	45.4	53.3	62.1						
I _c in⁴	13.2	14.4	17.0	19.9	23.1	26.5	30.2						
DEFL. PARAMETER (LLDP)	296	325	388	459	539	628	726						
DEFL. PARAMETER (SWDP)	1.18	1.14	1.06	0.977	0.904	0.837	0.775						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	288	305	339	374	408	442	476					
	15.0	243.0	262	291	321	350	379	409					
	16.0	200.0	220.0	252	277	303	328	353					
	17.0	167.0	184.0	219	241	264	286	308					
	18.0	141.0	155.0	185.0	211	231	250	269					
	19.0	120.0	131.0	157.0	186	203	220	237					
	20.0	103.0	113.0	135.0	159.0	179	194	209					
	21.0	89.0	97.0	116.0	138.0	159	172	185					
	22.0	77.0	85.0	101.0	120.0	141.0	153	165					
	23.0	67.0	74.0	89.0	105.0	123.0	136	147					
	24.0	59.0	65.0	78.0	92.0	108.0	121	131					
	25.0	53.0	58.0	69.0	82.0	96.0	109	117					
	26.0	47.0	51.0	61.0	73.0	85.0	97	104					
	27.0	42.0	46.0	55.0	65.0	76.0	87	93					
	28.0		41.0	49.0	58.0	68.0	78	84					
	29.0			44.0	52.0	61.0	69	75					
	30.0				47.0	55.0	62	67					

TABLE 3: CS120 LWC - #8 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0435 in.							Light Weight Concrete = 110 lb/ft³						
Rebar # 8													
SLAB WEIGHT (psf)	38.2	40.5	45.1	49.7	54.3	58.8	63.4						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	13.4	13.1	12.5	12.0	11.6	11.2	10.8						
MAX. UNSHORED 2 SPAN (ft)	15.5	15.2	14.5	13.9	13.0	12.2	11.5						
MAX. UNSHORED 3 SPAN (ft)	15.7	15.3	14.7	14.1	13.5	13.1	12.7						
I _u in⁴	24.7	27.2	32.7	39.0	46.0	53.9	62.8						
I _c in⁴	13.7	14.9	17.7	20.7	24.0	27.6	31.4						
DEFL. PARAMETER (LLDP)	302	332	396	469	550	641	741						
DEFL. PARAMETER (SWDP)	1.18	1.13	1.05	0.972	0.900	0.833	0.771						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	302	320	357	394	430	467	503					
	15.0	249.0	273.0	307	338	370	401	432					
	16.0	205.0	225.0	265	293	320	347	374					
	17.0	171.0	188.0	224.0	255	279	302	326					
	18.0	144.0	158.0	189.0	223	244	265	286					
	19.0	122.0	134.0	161.0	190.0	215	233	252					
	20.0	105.0	115.0	138.0	163.0	190	206	222					
	21.0	91.0	99.0	119.0	141.0	165.0	183	197					
	22.0	79.0	87.0	103.0	122.0	144.0	163	176					
	23.0	69.0	76.0	91.0	107.0	126.0	145	157					
	24.0	61.0	67.0	80.0	94.0	111.0	129.0	140					
	25.0	54.0	59.0	70.0	83.0	98.0	114.0	125					
	26.0	48.0	52.0	63.0	74.0	87.0	101.0	112					
	27.0	43.0	47.0	56.0	66.0	78.0	90.0	101					
	28.0		42.0	50.0	59.0	70.0	81.0	90					
	29.0			45.0	53.0	63.0	73.0	81					
	30.0			41.0	48.0	57.0	66.0	72					

TABLE 3: CS120 LWC - #8 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0495 in.							Light Weight Concrete = 110 lb/ft³						
Rebar # 8													
SLAB WEIGHT (psf)	38.6	40.9	45.5	50.1	54.6	59.2	63.8						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	14.3	13.9	13.3	12.8	12.3	11.9	11.5						
MAX. UNSHORED 2 SPAN (ft)	16.4	16.1	15.4	14.8	14.2	13.8	13.3						
MAX. UNSHORED 3 SPAN (ft)	16.6	16.2	15.6	15.0	14.4	13.9	13.5						
I _u in⁴	25.1	27.7	33.2	39.5	46.6	54.6	63.6						
I _c in⁴	14.2	15.5	18.4	21.5	25.0	28.7	32.8						
DEFL. PARAMETER (LLDP)	310	340	406	480	563	656	758						
DEFL. PARAMETER (SWDP)	1.17	1.13	1.04	0.966	0.894	0.827	0.765						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	314.0	335	374	413	452	491	530					
	15.0	255.0	280.0	322	355	389	422	456					
	16.0	210.0	231.0	275.0	308	337	366	395					
	17.0	175.0	192.0	230.0	268	294	319	344					
	18.0	148.0	162.0	193.0	229.0	257	280	302					
	19.0	125.0	138.0	164.0	195.0	227	247	266					
	20.0	108.0	118.0	141.0	167.0	196.0	218	236					
	21.0	93.0	102.0	122.0	144.0	169.0	194	209					
	22.0	81.0	89.0	106.0	125.0	147.0	171.0	186					
	23.0	71.0	78.0	93.0	110.0	129.0	150.0	166					
	24.0	62.0	68.0	82.0	97.0	113.0	132.0	149					
	25.0	55.0	60.0	72.0	85.0	100.0	117.0	134					
	26.0	49.0	54.0	64.0	76.0	89.0	104.0	120.0					
	27.0	44.0	48.0	57.0	68.0	79.0	93.0	107.0					
	28.0		43.0	51.0	61.0	71.0	83.0	96.0					
	29.0			46.0	55.0	64.0	75.0	86.0					
	30.0			42.0	49.0	58.0	67.0	78.0					



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016


Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 3: CS120 LWC - #9 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0375 in.							Light Weight Concrete = 110 lb/ft³						
Rebar # 9													
SLAB WEIGHT (psf)	38.2	40.5	45.1	49.7	54.2	58.8	63.4						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	12.4	12.1	11.6	11.2	10.8	10.4	10.1						
MAX. UNSHORED 2 SPAN (ft)	13.0	12.5	11.6	10.8	10.1	9.50	8.90						
MAX. UNSHORED 3 SPAN (ft)	14.6	14.2	13.2	12.3	11.5	10.8	10.1						
I _u in⁴	24.8	27.4	33.0	39.3	46.4	54.5	63.5						
I _c in⁴	14.0	15.4	18.3	21.5	25.0	28.8	32.9						
DEFL. PARAMETER (LLDP)	306	336	403	478	562	655	758						
DEFL. PARAMETER (SWDP)	1.17	1.13	1.04	0.963	0.891	0.824	0.762						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	309.d	340.d	395	436	476	516	557					
	15.0	252.d	277.d	332.d	375	409	444	479					
	16.0	207.d	228.d	273.d	324.d	355	385	415					
	17.0	173.d	190.d	228.d	270.d	310	336	362					
	18.0	146.d	160.d	192.d	228.d	268.d	295	318					
	19.0	124.d	136.d	163.d	194.d	228.d	260	281					
	20.0	106.d	117.d	140.d	166.d	195.d	227.d	249					
	21.0	92.d	101.d	121.d	143.d	169.d	196.d	221					
	22.0	80.d	88.d	105.d	125.d	147.d	171.d	197					
	23.0	70.d	77.d	92.d	109.d	128.d	150.d	173.d					
	24.0	61.d	68.d	81.d	96.d	113.d	132.d	152.d					
	25.0	54.d	60.d	72.d	85.d	100.d	116.d	135.d					
	26.0	48.d	53.d	64.d	76.d	89.d	104.d	120.d					
	27.0	43.d	47.d	57.d	67.d	79.d	92.d	107.d					
	28.0		43.d	51.d	60.d	71.d	83.d	96.d					
	29.0			46.d	54.d	64.d	75.d	86.d					
	30.0			41.d	49.d	58.d	67.d	78.d					

TABLE 3: CS120 LWC - #9 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0435 in.							Light Weight Concrete = 110 lb/ft³						
Rebar # 9													
SLAB WEIGHT (psf)	38.6	40.9	45.5	50.0	54.6	59.2	63.8						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	13.4	13.0	12.5	12.0	11.6	11.2	10.8						
MAX. UNSHORED 2 SPAN (ft)	15.5	15.1	14.5	13.8	12.9	12.2	11.5						
MAX. UNSHORED 3 SPAN (ft)	15.7	15.3	14.6	14.0	13.5	13.1	12.6						
I _u in⁴	25.2	27.7	33.4	39.8	47.0	55.1	64.2						
I _c in⁴	14.5	15.9	18.9	22.2	25.8	29.8	34.1						
DEFL. PARAMETER (LLDP)	312	343	411	487	573	668	773						
DEFL. PARAMETER (SWDP)	1.17	1.12	1.04	0.959	0.887	0.820	0.758						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	316.d	347.d	412	455	498	540	583					
	15.0	257.d	282.d	338.d	391	428	465	502					
	16.0	212.d	233.d	279.d	331.d	371	403	435					
	17.0	176.d	194.d	232.d	276.d	324.d	352	380					
	18.0	149.d	163.d	196.d	232.d	273.d	309	334					
	19.0	126.d	139.d	167.d	197.d	232.d	270.d	295					
	20.0	108.d	119.d	143.d	169.d	199.d	232.d	261					
	21.0	94.d	103.d	123.d	146.d	172.d	200.d	232.d					
	22.0	81.d	90.d	107.d	127.d	149.d	174.d	202.d					
	23.0	71.d	78.d	94.d	111.d	131.d	152.d	176.d					
	24.0	63.d	69.d	83.d	98.d	115.d	134.d	155.d					
	25.0	55.d	61.d	73.d	87.d	102.d	119.d	137.d					
	26.0	49.d	54.d	65.d	77.d	91.d	106.d	122.d					
	27.0	44.d	48.d	58.d	69.d	81.d	94.d	109.d					
	28.0		43.d	52.d	62.d	72.d	84.d	98.d					
	29.0			47.d	56.d	65.d	76.d	88.d					
	30.0			42.d	50.d	59.d	69.d	80.d					

TABLE 3: CS120 LWC - #9 REBAR							IMPERIAL UNITS						
Base Steel Thickness = 0.0495 in.							Light Weight Concrete = 110 lb/ft³						
Rebar # 9													
SLAB WEIGHT (psf)	39.0	41.3	45.8	50.4	55.0	59.6	64.2						
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99						
MAX. UNSHORED 1 SPAN (ft)	14.2	13.9	13.3	12.8	12.3	11.9	11.5						
MAX. UNSHORED 2 SPAN (ft)	16.4	16.0	15.4	14.8	14.2	13.7	13.3						
MAX. UNSHORED 3 SPAN (ft)	16.5	16.2	15.5	14.9	14.4	13.9	13.4						
I _u in⁴	25.6	28.2	33.9	40.3	47.6	55.8	65.0						
I _c in⁴	15.1	16.5	19.6	23.0	26.8	30.9	35.3						
DEFL. PARAMETER (LLDP)	320	351	421	498	585	682	789						
DEFL. PARAMETER (SWDP)	1.16	1.12	1.03	0.953	0.881	0.814	0.753						
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0						
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)											
To be established by the designer.	14.0	323.d	356.d	426.d	474	519	564	610					
	15.0	263.d	289.d	346.d	408	447	486	525					
	16.0	217.d	238.d	285.d	338.d	388	422	455					
	17.0	181.d	199.d	238.d	282.d	331.d	368	398					
	18.0	152.d	167.d	200.d	237.d	279.d	324	350					
	19.0	129.d	142.d	170.d	202.d	237.d	276.d	309					
	20.0	111.d	122.d	146.d	173.d	203.d	237.d	274.d					
	21.0	96.d	105.d	126.d	149.d	176.d	205.d	237.d					
	22.0	83.d	92.d	110.d	130.d	153.d	178.d	206.d					
	23.0	73.d	80.d	96.d	114.d	134.d	156.d	180.d					
	24.0	64.d	71.d	85.d	100.d	118.d	137.d	159.d					
	25.0	57.d	62.d	75.d	89.d	104.d	121.d	140.d					
	26.0	51.d	56.d	66.d	79.d	92.d	108.d	125.d					
	27.0	45.d	50.d	59.d	70.d	83.d	96.d	111.d					
	28.0	40.d	44.d	53.d	63.d	74.d	86.d	100.d					
	29.0	40.d	48.d	57.d	67.d	78.d	90.d	100.d					
	30.0			43.d	51.d	60.d	70.d	81.d					

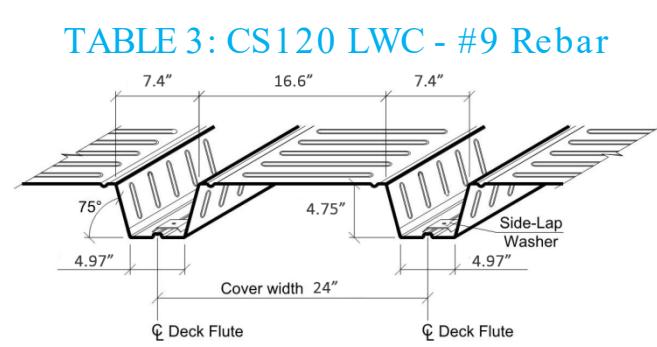



EVALUATION REPORT

Number: 277


Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 4: CS120 NWC - #3 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0375 in.								Normal Weight Concrete = 145 lb/ft³								
Rebar # 3																
SLAB WEIGHT (psf)	47.5	50.5	56.6	62.6	68.7	74.7	80.7	SLAB WEIGHT (psf)	47.9	50.9	57.0	63.0	69.0	75.1	81.1	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	11.3	11.1	10.6	10.1	9.70	9.40	9.10	MAX. UNSHORED 1 SPAN (ft)	12.2	11.9	11.3	10.9	10.4	10.1	9.70	
MAX. UNSHORED 2 SPAN (ft)	11.1	10.6	9.70	9.00	8.30	7.80	7.30	MAX. UNSHORED 2 SPAN (ft)	14.1	13.6	12.5	11.5	10.7	10.0	9.40	
MAX. UNSHORED 3 SPAN (ft)	12.6	12.0	11.0	10.2	9.50	8.90	8.30	MAX. UNSHORED 3 SPAN (ft)	14.2	13.9	13.2	12.7	12.2	11.4	10.7	
I _u in⁴	22.5	24.7	29.6	35.1	41.4	48.6	56.6	I _u in⁴	22.9	25.1	30.0	35.6	42.0	49.2	57.4	
I _c in⁴	9.40	10.1	11.7	13.5	15.4	17.4	19.6	I _c in⁴	10.0	10.8	12.5	14.4	16.5	18.7	21.1	
DEFL. PARAMETER (LLDP)	251	274	325	382	447	519	599	DEFL. PARAMETER (LLDP)	259	283	335	394	460	534	617	
DEFL. PARAMETER (SWDP)	1.61	1.56	1.46	1.36	1.26	1.17	1.09	DEFL. PARAMETER (SWDP)	1.60	1.55	1.45	1.35	1.25	1.16	1.08	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	110	117	131	144	158	172	186	14.0	126	134	151	167	183	199	215
	15.0	91	97	108	120	131	142	154	15.0	105	112	126	139	153	166	180
	16.0	76	81	90	100	109	118	128	16.0	88	94	105	117	128	139	151
	17.0	63	67	75	83	91	99	106	17.0	74	79	88	98	107	117	126
	18.0	52	56	62	69	75	82	88	18.0	62	66	74	82	90	98	106
	19.0	43	46	52	57	62	68	73	19.0	52	56	62	69	76	82	89
	20.0			42	47	51	56	60	20.0	44	46	52	58	63	69	74
	21.0				42	45	49		21.0		43	48	53	57	62	
	22.0								22.0				43	47	51	
	23.0								23.0							41
	24.0								24.0							
	25.0								25.0							
	26.0								26.0							
	27.0								27.0							
	28.0								28.0							
	29.0								29.0							
	30.0								30.0							

TABLE 4: CS120 NWC - #3 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0435 in.								Normal Weight Concrete = 145 lb/ft³								
Rebar # 3																
SLAB WEIGHT (psf)	47.9	50.9	57.0	63.0	69.0	75.1	81.1	SLAB WEIGHT (psf)	47.9	50.9	57.0	63.0	69.0	75.1	81.1	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	12.2	11.9	11.3	10.9	10.4	10.1	9.70	MAX. UNSHORED 1 SPAN (ft)	12.2	11.9	11.3	10.9	10.4	10.1	9.70	
MAX. UNSHORED 2 SPAN (ft)	14.1	13.6	12.5	11.5	10.7	10.0	9.40	MAX. UNSHORED 2 SPAN (ft)	14.1	13.6	12.5	11.5	10.7	10.0	9.40	
MAX. UNSHORED 3 SPAN (ft)	14.2	13.9	13.2	12.7	12.2	11.4	10.6	MAX. UNSHORED 3 SPAN (ft)	14.2	13.9	13.2	12.7	12.2	11.4	10.7	
I _u in⁴	22.9	25.1	30.0	35.6	42.0	49.2	57.4	I _u in⁴	22.9	25.1	30.0	35.6	42.0	49.2	57.4	
I _c in⁴	10.0	10.8	12.5	14.4	16.5	18.7	21.1	I _c in⁴	10.0	10.8	12.5	14.4	16.5	18.7	21.1	
DEFL. PARAMETER (LLDP)	259	283	335	394	460	534	617	DEFL. PARAMETER (LLDP)	259	283	335	394	460	534	617	
DEFL. PARAMETER (SWDP)	1.60	1.55	1.45	1.35	1.25	1.16	1.08	DEFL. PARAMETER (SWDP)	1.60	1.55	1.45	1.35	1.25	1.16	1.08	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	126	134	151	167	183	199	14.0	126	134	151	167	183	199	215	
	15.0	105	112	126	139	153	166	15.0	105	112	126	139	153	166	180	
	16.0	88	94	105	117	128	139	16.0	88	94	105	117	128	139	151	
	17.0	74	79	88	98	107	117	17.0	74	79	88	98	107	117	126	
	18.0	62	66	74	82	90	98	18.0	62	66	74	82	90	98	106	
	19.0	52	56	62	69	76	82	19.0	52	56	62	69	76	82	89	
	20.0	44	46	52	58	63	69	20.0	44	46	52	58	63	69	74	
	21.0			42	48	53	58	21.0			43	48	53	57	62	
	22.0				43	48	53	58	22.0				43	47	51	
	23.0					40	44	48	23.0							41
	24.0							24.0								
	25.0							25.0								
	26.0							26.0								
	27.0							27.0								
	28.0							28.0								
	29.0							29.0								
	30.0							30.0								

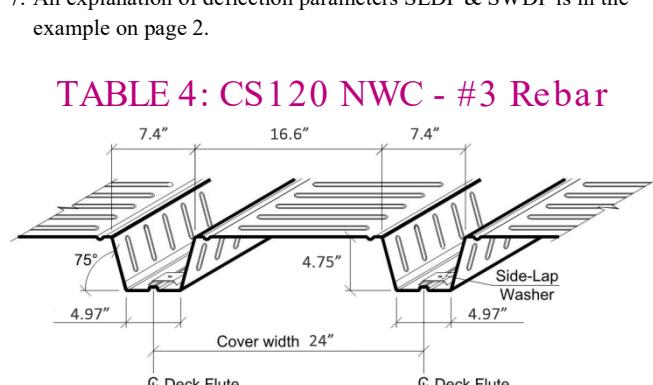



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 4: CS120 NWC - #4 REBAR								IMPERIAL UNITS							
Base Steel Thickness = 0.0375 in.								Normal Weight Concrete = 145 lb/ft³							
Rebar # 4								Normal Weight Concrete = 145 lb/ft³							
SLAB WEIGHT (psf)	47.7	50.7	56.7	62.8	68.8	74.8	80.9	SLAB WEIGHT (psf)	48.0	51.1	57.1	63.1	69.2	75.2	81.3
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	11.3	11.0	10.5	10.1	9.70	9.40	9.10	MAX. UNSHORED 1 SPAN (ft)	12.2	11.9	11.3	10.9	10.4	10.1	9.70
MAX. UNSHORED 2 SPAN (ft)	11.1	10.6	9.70	9.00	8.30	7.80	7.30	MAX. UNSHORED 2 SPAN (ft)	14.1	13.6	12.4	11.5	10.7	10.0	9.40
MAX. UNSHORED 3 SPAN (ft)	12.6	12.0	11.0	10.2	9.50	8.80	8.30	MAX. UNSHORED 3 SPAN (ft)	14.2	13.9	13.2	12.7	12.1	11.4	10.7
I _u in⁴	22.8	25.1	30.0	35.6	42.0	49.3	57.4	I _u in⁴	23.2	25.5	30.5	36.2	42.6	49.9	58.2
I _c in⁴	10.0	10.8	12.6	14.5	16.5	18.8	21.2	I _c in⁴	10.6	11.5	13.3	15.4	17.6	20.0	22.6
DEFL. PARAMETER (LLDP)	258	282	335	394	461	535	618	DEFL. PARAMETER (LLDP)	266	290	344	405	474	550	635
DEFL. PARAMETER (SWDP)	1.59	1.54	1.44	1.34	1.25	1.16	1.08	DEFL. PARAMETER (SWDP)	1.58	1.53	1.43	1.33	1.24	1.15	1.07
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	134	142	158	174	191	207	14.0	150	159	178	196	215	234	252
	15.0	112	119	132	146	159	173	15.0	126	134	149	165	181	196	212
	16.0	94	100	111	122	134	145	16.0	106	113	126	139	153	166	179
	17.0	79	84	94	103	113	122	17.0	90	96	107	118	129	140	152
	18.0	67	71	79	87	95	103	19.0	65	69	77	85	93	101	109
	19.0	56	60	66	73	80	87	20.0	55	58	65	72	79	86	93
	20.0	47	50	56	61	67	73	21.0	47	49	55	61	67	73	78
	21.0		42	47	51	56	61	22.0		42	47	51	56	61	66
	22.0			43	46	50	54	23.0				43	47	51	55
	23.0					41	44	24.0					42	46	
	24.0							25.0							
	25.0							26.0							
	26.0							27.0							
	27.0							28.0							
	28.0							29.0							
	29.0							30.0							

TABLE 4: CS120 NWC - #4 REBAR								IMPERIAL UNITS							
Base Steel Thickness = 0.0435 in.								Normal Weight Concrete = 145 lb/ft³							
Rebar # 4								Normal Weight Concrete = 145 lb/ft³							
SLAB WEIGHT (psf)	48.0	51.1	57.1	63.1	69.2	75.2	81.3	SLAB WEIGHT (psf)	48.0	51.1	57.1	63.1	69.2	75.2	81.3
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	12.2	11.9	11.3	10.9	10.4	10.1	9.70	MAX. UNSHORED 1 SPAN (ft)	12.2	11.9	11.3	10.9	10.4	10.1	9.70
MAX. UNSHORED 2 SPAN (ft)	14.1	13.6	12.4	11.5	10.7	10.0	9.10	MAX. UNSHORED 2 SPAN (ft)	14.1	13.6	12.4	11.5	10.7	10.0	9.10
MAX. UNSHORED 3 SPAN (ft)	14.2	13.9	13.2	12.7	12.1	11.4	10.7	MAX. UNSHORED 3 SPAN (ft)	14.2	13.9	13.2	12.7	12.1	11.4	10.7
I _u in⁴	23.2	25.5	30.5	36.2	42.6	49.9	58.2	I _u in⁴	23.2	25.5	30.5	36.2	42.6	49.9	58.2
I _c in⁴	10.6	11.5	13.3	15.4	17.6	20.0	22.6	I _c in⁴	10.6	11.5	13.3	15.4	17.6	20.0	22.6
DEFL. PARAMETER (LLDP)	266	290	344	405	474	550	635	DEFL. PARAMETER (LLDP)	266	290	344	405	474	550	635
DEFL. PARAMETER (SWDP)	1.58	1.53	1.43	1.33	1.24	1.15	1.07	DEFL. PARAMETER (SWDP)	1.58	1.53	1.43	1.33	1.24	1.15	1.07
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	150	159	178	196	215	234	14.0	150	159	178	196	215	234	252
	15.0	126	134	149	165	181	196	15.0	126	134	149	165	181	196	212
	16.0	106	113	126	139	153	166	16.0	106	113	126	139	153	166	179
	17.0	90	96	107	118	129	140	17.0	90	96	107	118	129	140	152
	18.0	76	81	91	100	110	119	18.0	76	81	91	100	110	119	129
	19.0	65	69	77	85	93	101	19.0	65	69	77	85	93	101	109
	20.0	55	58	65	72	79	86	20.0	55	58	65	72	79	86	93
	21.0	47	49	55	61	67	73	21.0	47	49	55	61	67	73	78
	22.0		42	47	51	56	61	22.0		42	47	51	56	61	66
	23.0			43	47	51	55	23.0			43	47	51	55	
	24.0				43	47	51	24.0				42	46		
	25.0					43	46	25.0							
	26.0							26.0							
	27.0							27.0							
	28.0							28.0							
	29.0							29.0							
	30.0							30.0							

TABLE 4: CS120 NWC - #4 REBAR								IMPERIAL UNITS							
Base Steel Thickness = 0.0495 in.								Normal Weight Concrete = 145 lb/ft³							
Rebar # 4								Normal Weight Concrete = 145 lb/ft³							
SLAB WEIGHT (psf)	48.4	51.4	57.5	63.5	69.6	75.6	81.6	SLAB WEIGHT (psf)	48.4	51.4	57.5	63.5	69.6	75.6	81.6
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	12.9	12.6	12.0	11.5	11.1	10.7	10.3	MAX. UNSHORED 1 SPAN (ft)	12.9	12.6	12.0	11.5	11.1	10.7	10.3
MAX. UNSHORED 2 SPAN (ft)	15.0	14.6	13.9	13.3	12.8	12.3	11.7	MAX. UNSHORED 2 SPAN (ft)	15.0	14.6	13.9	13.3	12.8	12.3	11.7
MAX. UNSHORED 3 SPAN (ft)	15.1	14.7	14.1	13.5	12.9	12.5	12.1	MAX. UNSHORED 3 SPAN (ft)	15.1	14.7	14.1	13.5	12.9	12.5	12.1
I _u in⁴	23.6	25.9	31.0	36.8	43.3	50.7	59.0	I _u in⁴	23.6	25.9	31.0	36.8	43.3	50.7	59.0
I _c in⁴	11.3	12.2	14.2	16.4	18.8	21.4	24.2	I _c in⁴	11.3	12.2	14.2	16.4	18.8	21.4	24.2
DEFL. PARAMETER (LLDP)	274	300	355	418	488	567	654	DEFL. PARAMETER (LLDP)	274	300	355	418	488	567	654
DEFL. PARAMETER (SWDP)	1.56	1.51	1.42	1.32	1.23	1.14	1.06	DEFL. PARAMETER (SWDP)	1.56	1.51	1.42	1.32	1.23	1.14	1.06
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	166	176	197	218	239	260	14.0	166	176	197	218	239	260</td	



EVALUATION REPORT

Number: 277


Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 4: CS120 NWC - #5 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0375 in.								Normal Weight Concrete = 145 lb/ft³								
Rebar # 5																
SLAB WEIGHT (psf)	47.8	50.9	56.9	62.9	69.0	75.0	81.1	SLAB WEIGHT (psf)	48.2	51.2	57.3	63.3	69.4	75.4	81.5	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	11.3	11.0	10.5	10.1	9.70	9.40	9.10	MAX. UNSHORED 1 SPAN (ft)	12.2	11.9	11.3	10.8	10.4	10.1	9.70	
MAX. UNSHORED 2 SPAN (ft)	11.0	10.5	9.70	8.90	8.30	7.80	7.30	MAX. UNSHORED 2 SPAN (ft)	14.1	13.5	12.4	11.5	10.7	10.0	9.40	
MAX. UNSHORED 3 SPAN (ft)	12.5	12.0	11.0	10.2	9.50	8.80	8.30	MAX. UNSHORED 3 SPAN (ft)	14.2	13.9	13.2	12.7	12.1	11.3	10.6	
I _u in⁴	23.2	25.5	30.5	36.2	42.7	50.1	58.4	I _u in⁴	23.5	25.8	31.0	36.8	43.3	50.8	59.1	
I _c in⁴	10.7	11.6	13.5	15.7	18.0	20.4	23.1	I _c in⁴	11.3	12.2	14.3	16.5	19.0	21.6	24.5	
DEFL. PARAMETER (LLDP)	267	292	347	408	478	555	641	DEFL. PARAMETER (LLDP)	274	300	356	419	490	569	658	
DEFL. PARAMETER (SWDP)	1.58	1.52	1.42	1.33	1.23	1.14	1.06	DEFL. PARAMETER (SWDP)	1.56	1.51	1.41	1.31	1.22	1.13	1.05	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	163	173	192	212	231	251	270	14.0	179	190	212	234	255	277	299
	15.0	138	146	162	178	195	211	227	15.0	151	160	179	197	216	234	253
	16.0	117	123	137	151	165	179	192	16.0	129	136	152	168	183	199	215
	17.0	99	105	117	128	140	152	163	17.0	110	116	130	143	156	170	183
	18.0	85	90	100	109	119	129	139	18.0	94	100	111	122	134	145	157
	19.0	72	76	85	93	102	110	119	19.0	81	86	95	105	115	125	134
	20.0	62	65	72	80	87	94	101	20.0	69	73	82	90	99	107	115
	21.0	53	56	62	68	74	80	86	21.0	59	63	70	77	85	92	99
	22.0	45	47	53	58	63	68	73	22.0	51	54	60	66	72	79	85
	23.0		40	44	49	53	57	62	23.0	44	46	51	57	62	67	72
	24.0			41	45	48	52		24.0		44	48	53	57	61	
	25.0							43	25.0			41	44	48	52	
	26.0								26.0						40	43
	27.0								27.0							
	28.0								28.0							
	29.0								29.0							
	30.0								30.0							

TABLE 4: CS120 NWC - #5 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0435 in.								Normal Weight Concrete = 145 lb/ft³								
Rebar # 5																
SLAB WEIGHT (psf)	48.6	51.6	57.7	63.7	69.8	75.8	81.8	SLAB WEIGHT (psf)	48.2	51.2	57.3	63.3	69.4	75.4	81.5	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	12.9	12.6	12.0	11.5	11.1	10.7	10.3	MAX. UNSHORED 1 SPAN (ft)	12.2	11.9	11.3	10.8	10.4	10.1	9.70	
MAX. UNSHORED 2 SPAN (ft)	14.9	14.6	13.9	13.3	12.8	12.3	11.6	MAX. UNSHORED 2 SPAN (ft)	14.1	13.5	12.4	11.5	10.7	10.0	9.40	
MAX. UNSHORED 3 SPAN (ft)	15.1	14.7	14.0	13.5	12.9	12.5	12.1	MAX. UNSHORED 3 SPAN (ft)	14.2	13.9	13.2	12.7	12.1	11.3	10.6	
I _u in⁴	24.0	26.3	31.5	37.4	44.0	51.5	60.0	I _u in⁴	23.5	25.8	31.0	36.8	43.3	50.8	59.1	
I _c in⁴	11.9	12.9	15.1	17.5	20.1	22.9	26.0	I _c in⁴	11.3	12.2	14.3	16.5	19.0	21.6	24.5	
DEFL. PARAMETER (LLDP)	282	309	366	431	504	586	676	DEFL. PARAMETER (LLDP)	274	300	356	419	490	569	658	
DEFL. PARAMETER (SWDP)	1.55	1.50	1.40	1.30	1.21	1.12	1.04	DEFL. PARAMETER (SWDP)	1.56	1.51	1.41	1.31	1.22	1.13	1.05	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	194	207	231	255	279	303	328	14.0	179	190	212	234	255	277	299
	15.0	165	175	195	216	236	257	277	15.0	151	160	179	197	216	234	253
	16.0	140	149	167	184	201	219	236	16.0	129	136	152	168	183	199	215
	17.0	120	128	143	158	173	187	202	17.0	110	116	130	143	156	170	183
	18.0	103	110	122	135	148	161	174	18.0	94	106	117	128	139	150	
	19.0	89	94	106	117	128	139	150	19.0	77	81	91	101	110	120	129
	20.0	66	70	79	87	95	103	112	20.0	66	70	79	87	95	103	112
	21.0	57	61	68	75	82	89	96	21.0	57	61	68	75	82	89	96
	22.0	49	52	58	64	71	77	83	22.0	49	52	58	64	71	77	83
	23.0	42	45	50	55	60	66	71	23.0	42	45	43	47	52	56	61
	24.0			40	44	44	48	51	24.0			43	47	52	56	61
	25.0								25.0							
	26.0								26.0							
	27.0								27.0							
	28.0								28.0							
	29.0								29.0							
	30.0								30.0							

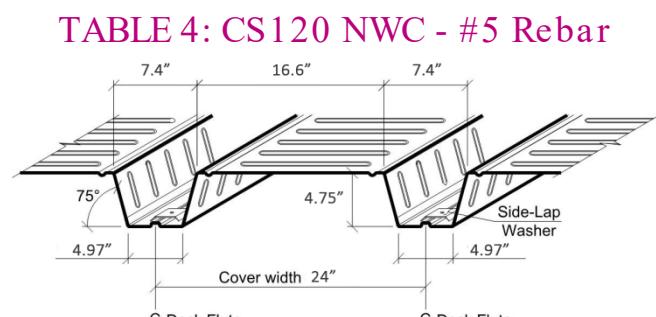



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 4: CS120 NWC - #6 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0375 in.								Normal Weight Concrete = 145 lb/ft³								
Rebar # 6																
SLAB WEIGHT (psf)	48.1	51.1	57.1	63.2	69.2	75.3	81.3	SLAB WEIGHT (psf)	48.5	51.5	57.5	63.6	69.6	75.6	81.7	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	11.3	11.0	10.5	10.1	9.70	9.40	9.10	MAX. UNSHORED 1 SPAN (ft)	12.1	11.8	11.3	10.8	10.4	10.1	9.70	
MAX. UNSHORED 2 SPAN (ft)	11.0	10.5	9.70	8.90	8.30	7.80	7.30	MAX. UNSHORED 2 SPAN (ft)	14.0	13.5	12.4	11.5	10.7	10.0	9.30	
MAX. UNSHORED 3 SPAN (ft)	12.5	12.0	11.0	10.1	9.40	8.80	8.30	MAX. UNSHORED 3 SPAN (ft)	14.2	13.8	13.2	12.6	12.1	11.3	10.6	
I _u in⁴	23.6	25.9	31.1	36.9	43.6	51.1	59.5	I _u in⁴	23.9	26.3	31.5	37.4	44.1	51.7	60.2	
I _c in⁴	11.5	12.5	14.6	17.0	19.5	22.3	25.3	I _c in⁴	12.0	13.1	15.3	17.8	20.5	23.5	26.6	
DEFL. PARAMETER (LLDP)	276	302	360	424	497	577	667	DEFL. PARAMETER (LLDP)	283	310	369	435	509	591	683	
DEFL. PARAMETER (SWDP)	1.56	1.50	1.40	1.31	1.21	1.12	1.04	DEFL. PARAMETER (SWDP)	1.55	1.49	1.39	1.30	1.20	1.12	1.03	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	198	210	233	256	279	303	326	14.0	213	226	252	277	303	329	354
	15.0	168	178	197	217	237	256	276	15.0	181	192	214	235	257	279	301
	16.0	143	151	168	185	202	218	235	16.0	155	164	183	201	220	238	257
	17.0	123	130	144	158	173	187	201	17.0	133	141	157	173	189	205	221
	18.0	106	112	124	136	148	161	173	18.0	115	121	135	149	163	176	190
	19.0	91	96	107	117	128	139	149	19.0	99	105	117	129	141	153	164
	20.0	79	83	92	101	110	119	129	20.0	86	91	101	112	122	132	142
	21.0	68	72	80	87	95	103	111	21.0	75	79	88	97	106	115	123
	22.0	59	62	69	76	82	89	96	22.0	65	69	76	84	92	99	107
	23.0	51	54	59	65	71	77	82	23.0	56	59	66	73	79	86	93
	24.0	44	46	51	56	61	66	71	24.0	49	51	57	63	69	74	80
	25.0			44	48	52	56	60	25.0	42	44	49	54	59	64	69
	26.0				41	44	48	51	26.0			42	47	51	55	59
	27.0						40	43	27.0				43	47	50	
	28.0								28.0						43	
	29.0								29.0							
	30.0								30.0							

TABLE 4: CS120 NWC - #6 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0435 in.								Normal Weight Concrete = 145 lb/ft³								
Rebar # 6																
SLAB WEIGHT (psf)	48.5	51.5	57.5	63.6	69.6	75.6	81.7	SLAB WEIGHT (psf)	48.5	51.5	57.5	63.6	69.6	75.6	81.7	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	12.1	11.8	11.3	10.8	10.4	10.1	9.70	MAX. UNSHORED 1 SPAN (ft)	12.1	11.8	11.3	10.8	10.4	10.1	9.70	
MAX. UNSHORED 2 SPAN (ft)	14.0	13.5	12.4	11.5	10.7	10.0	9.10	MAX. UNSHORED 2 SPAN (ft)	14.0	13.5	12.4	11.5	10.7	10.0	9.30	
MAX. UNSHORED 3 SPAN (ft)	14.2	13.8	13.2	12.6	12.1	11.3	10.6	MAX. UNSHORED 3 SPAN (ft)	14.2	13.8	13.2	12.6	12.1	11.3	10.6	
I _u in⁴	23.9	26.3	31.5	37.4	44.1	51.7	60.2	I _u in⁴	23.9	26.3	31.5	37.4	44.1	51.7	60.2	
I _c in⁴	12.0	13.1	15.3	17.8	20.5	23.5	26.6	I _c in⁴	12.0	13.1	15.3	17.8	20.5	23.5	26.6	
DEFL. PARAMETER (LLDP)	283	310	369	435	509	591	683	DEFL. PARAMETER (LLDP)	283	310	369	435	509	591	683	
DEFL. PARAMETER (SWDP)	1.55	1.49	1.39	1.30	1.20	1.12	1.03	DEFL. PARAMETER (SWDP)	1.55	1.49	1.39	1.30	1.20	1.12	1.03	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	213	226	252	277	303	329	354	14.0	213	226	252	277	303	329	354
	15.0	181	192	214	235	257	279	301	15.0	181	192	214	235	257	279	301
	16.0	155	164	183	201	220	238	257	16.0	155	164	183	201	220	238	257
	17.0	133	141	157	173	189	205	221	17.0	133	141	157	173	189	205	221
	18.0	115	121	135	149	163	176	190	18.0	115	121	135	149	163	176	190
	19.0	99	105	117	129	141	153	164	19.0	99	105	117	129	141	153	164
	20.0	86	91	101	112	122	132	142	20.0	86	91	101	112	122	132	142
	21.0	75	79	88	97	106	115	123	21.0	75	79	88	97	106	115	123
	22.0	65	69	76	84	92	100	107	22.0	65	69	76	84	92	99	107
	23.0	56	59	66	73	79	86	93	23.0	56	59	66	73	79	86	93
	24.0	49	51	57	63	69	74	80	24.0	49	51	57	63	69	74	80
	25.0	42	44	49	55	61	66	72	25.0	42	44	49	55	61	66	72
	26.0	40	43	48	52	57	62	67	26.0	40	43	48	52	57	62	67
	27.0			41	45	49	54	58	27.0			41	45	49	54	58
	28.0					42	46	49	28.0			42	46	49	42	
	29.0								29.0							
	30.0								30.0							

TABLE 4: CS120 NWC - #6 REBAR								IMPERIAL UNITS							
Base Steel Thickness = 0.0495 in.								Normal Weight Concrete = 145 lb/ft³							
Rebar # 6															
SLAB WEIGHT (psf)	48.8	51.9	57.9	63.9	70.0	76.0	82.1	SLAB WEIGHT (psf)	48.8	51.9	57.9	63.9	70.0	76.0	82.1
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	12.9	12.6	12.0	11.5	11.1	10.7	10.3	MAX. UNSHORED 1 SPAN (ft)	12.9	12.6	12.0	11.5	11.1	10.7	10.3
MAX. UNSHORED 2 SPAN (ft)	14.9	14.5	13.9	13.3	12.8	12.3	11.6	MAX. UNSHORED 2 SPAN (ft)	14.9	14.5	13.9	13.3	12.8	12.3	11.6
MAX. UNSHORED 3 SPAN (ft)	15.1	14.7	14.0	13.4	12.9	12.5	12.0	MAX. UNSHORED 3 SPAN (ft)	15.1	14.7	14.0	13.4	12.9	12.5	12.0
I _u in⁴	24.3	26.7	32.0	38.0	44.8	52.5	61.1	I _u in⁴	24.3	26.7	32.0	38.0	44.8	52.5	61.1
I _c in⁴	12.7	13.8	16.1	18.8	21.6	24.7	28.1	I _c in⁴	12.7	13.8	16.1				



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 4: CS120 NWC - #7 REBAR								IMPERIAL UNITS							
Base Steel Thickness = 0.0375 in.								Normal Weight Concrete = 145 lb/ft³							
Rebar # 7															
SLAB WEIGHT (psf)		48.3	51.4	57.4	63.5	69.5	75.5	81.6							
CONCRETE VOLUME (yd³/100ft²)		1.15	1.22	1.38	1.53	1.69	1.84	1.99							
MAX. UNSHORED 1 SPAN (ft)		11.3	11.0	10.5	10.1	9.70	9.40	9.10							
MAX. UNSHORED 2 SPAN (ft)		11.0	10.5	9.60	8.90	8.30	7.70	7.30							
MAX. UNSHORED 3 SPAN (ft)		12.5	11.9	10.9	10.1	9.40	8.80	8.30							
I_u in⁴		24.0	26.4	31.7	37.7	44.5	52.1	60.7							
I_c in⁴		12.3	13.4	15.8	18.4	21.3	24.4	27.7							
DEFL. PARAMETER (LLDP)		286	313	374	441	517	602	696							
DEFL. PARAMETER (SWDP)		1.54	1.48	1.38	1.28	1.19	1.11	1.03							
SLAB THICKNESS (in.)		7.25	7.50	8.0	8.50	9.0	9.50	10.0							
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)													
To be established by the designer.	14.0	237	251	279	307	334	362	390							
	15.0	202	214	237	261	285	308	332							
	16.0	173	183	203	224	244	264	284							
	17.0	149	158	175	193	210	228	245							
	18.0	129	137	152	167	182	197	212							
	19.0	112	119	132	145	158	171	184							
	20.0	98	103	115	126	137	149	160							
	21.0	85	90	100	110	120	130	139							
	22.0	74	79	87	96	104	113	122							
	23.0	65	69	76	84	91	99	106							
	24.0	57	60	66	73	79	86	92							
	25.0	49	52	58	64	69	75	80							
	26.0	43	45	50	55	60	65	70							
	27.0			43	48	52	56	60							
	28.0				41	45	48	52							
	29.0						41	44							
	30.0														

TABLE 4: CS120 NWC - #7 REBAR								IMPERIAL UNITS							
Base Steel Thickness = 0.0435 in.								Normal Weight Concrete = 145 lb/ft³							
Rebar # 7															
SLAB WEIGHT (psf)		48.7	51.7	57.8	63.8	69.9	75.9	82.0							
CONCRETE VOLUME (yd³/100ft²)		1.15	1.22	1.38	1.53	1.69	1.84	1.99							
MAX. UNSHORED 1 SPAN (ft)		12.1	11.8	11.3	10.8	10.4	10.0	9.70							
MAX. UNSHORED 2 SPAN (ft)		14.0	13.4	12.4	11.4	10.6	9.90	9.30							
MAX. UNSHORED 3 SPAN (ft)		14.2	13.8	13.2	12.6	12.1	11.3	10.6							
I_u in⁴		24.3	26.8	32.1	38.2	45.0	52.8	61.4							
I_c in⁴		12.8	14.0	16.5	19.2	22.2	25.5	29.0							
DEFL. PARAMETER (LLDP)		292	321	382	451	529	615	711							
DEFL. PARAMETER (SWDP)		1.53	1.48	1.37	1.28	1.18	1.10	1.02							
SLAB THICKNESS (in.)		7.25	7.50	8.0	8.50	9.0	9.50	10.0							
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)													
To be established by the designer.	14.0	252	267	297	327	358	388	418							
	15.0	215	227	253	279	305	331	356							
	16.0	184	195	217	239	262	284	306							
	17.0	159	168	188	207	226	245	264							
	18.0	138	146	163	179	196	212	229							
	19.0	118.d	127	141	156	170	185	199							
	20.0	102.d	111	123	136	149	161	174							
	21.0	88.d	96.d	108	119	130	141	152							
	22.0	76.d	84.d	95	104	114	123	133							
	23.0	67.d	73.d	83	91	100	108	116							
	24.0	59.d	64.d	73	80	87	94	102							
	25.0	52.d	57.d	63	70	76	83	89							
	26.0	46.d	50	55	61	66	72	78							
	27.0	41	43	48	53	58	63	67							
	28.0			42	46	50	54	58							
	29.0					43	47	50							
	30.0							43							

TABLE 4: CS120 NWC - #7 REBAR								IMPERIAL UNITS							
Base Steel Thickness = 0.0495 in.								Normal Weight Concrete = 145 lb/ft³							
Rebar # 7															
SLAB WEIGHT (psf)		49.1	52.1	58.2	64.2	70.3	76.3	82.3							
CONCRETE VOLUME (yd³/100ft²)		1.15	1.22	1.38	1.53	1.69	1.84	1.99							
MAX. UNSHORED 1 SPAN (ft)		12.9	12.6	12.0	11.5	11.1	10.7	10.3							
MAX. UNSHORED 2 SPAN (ft)		14.9	14.5	13.8	13.3	12.8	12.3	11.6							
MAX. UNSHORED 3 SPAN (ft)		15.1	14.7	14.0	13.4	12.9	12.4	12.0							
I_u in⁴		24.7	27.2	32.6	38.8	45.7	53.5	62.3							
I_c in⁴		13.4	14.6	17.2	20.1	23.2	26.7	30.3							
DEFL. PARAMETER (LLDP)		300	329	392	463	542	631	729							
DEFL. PARAMETER (SWDP)		1.51	1.46	1.36	1.26	1.17	1.09	1.01							
SLAB THICKNESS (in.)		7.25	7.50	8.0	8.50	9.0	9.50	10.0							
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)													
To be established by the designer.	14.0	266	282	315	348	380	413	446							
	15.0	227	241	269	297	325	352	380							
	16.0	195	207	231	255	279	303	327							
	17.0	169	179	200	220	241	262	282							
	18.0	143.d	155	173	191	209	227	245							
	19.0	122.d	133.d	151	167	182	198	214							
	20.0	104.d	114.d	132	146	160	173	187							
	21.0	90.d	99.d	116	128	140	152	164							
	22.0	78.d	86.d	102	112	123	133	144	</td						



EVALUATION REPORT

Number: 277


Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 4: CS120 NWC - #8 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0375 in.								Normal Weight Concrete = 145 lb/ft³								
Rebar # 8																
SLAB WEIGHT (psf)	48.7	51.7	57.7	63.8	69.8	75.8	81.9	SLAB WEIGHT (psf)	49.0	52.1	58.1	64.1	70.2	76.2	82.3	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	11.3	11.0	10.5	10.1	9.70	9.30	9.00	MAX. UNSHORED 1 SPAN (ft)	12.1	11.8	11.3	10.8	10.4	10.0	9.70	
MAX. UNSHORED 2 SPAN (ft)	10.9	10.5	9.60	8.90	8.30	7.70	7.20	MAX. UNSHORED 2 SPAN (ft)	14.0	13.4	12.3	11.4	10.6	9.90	9.30	
MAX. UNSHORED 3 SPAN (ft)	12.4	11.9	10.9	10.1	9.40	8.80	8.20	MAX. UNSHORED 3 SPAN (ft)	14.1	13.8	13.2	12.6	12.0	11.3	10.6	
I _u in⁴	24.4	26.9	32.3	38.5	45.4	53.3	62.1	I _u in⁴	24.7	27.2	32.7	39.0	46.0	53.9	62.8	
I _c in⁴	13.2	14.4	17.0	19.9	23.1	26.5	30.2	I _c in⁴	13.7	14.9	17.7	20.7	24.0	27.6	31.4	
DEFL. PARAMETER (LLDP)	296	325	388	459	539	628	726	DEFL. PARAMETER (LLDP)	302	332	396	469	550	641	741	
DEFL. PARAMETER (SWDP)	1.52	1.47	1.36	1.26	1.17	1.09	1.01	DEFL. PARAMETER (SWDP)	1.51	1.46	1.35	1.26	1.16	1.08	1.00	
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	280	296	330	363	396	429	14.0	294	312	347	383	418	454	489	
	15.0	239	253	281	310	338	366		15.0	249.d	266	297	327	358	388	418
	16.0	200.d	218	242	266	291	315		16.0	205.d	225.d	256	282	308	334	360
	17.0	167.d	184.d	210	231	252	273		17.0	171.d	188.d	221	244	267	289	312
	18.0	141.d	155.d	182	201	219	237		18.0	144.d	158.d	189.d	213	232	252	272
	19.0	120.d	131.d	157.d	175	191	207		19.0	122.d	134.d	161.d	186	203	220	237
	20.0	103.d	113.d	135.d	153	167	181		20.0	105.d	115.d	138.d	163.d	178	193	208
	21.0	89.d	97.d	116.d	135	147	159		21.0	91.d	99.d	119.d	141.d	157	170	183
	22.0	77.d	85.d	101.d	118	129	140		22.0	79.d	87.d	103.d	122.d	138	150	161
	23.0	67.d	74.d	89.d	104	114	123		23.0	69.d	76.d	91.d	107.d	122	132	142
	24.0	59.d	65.d	78.d	92	100	108		24.0	61.d	67.d	80.d	94.d	108	117	126
	25.0	53.d	58.d	69.d	81	88	95		25.0	54.d	59.d	70.d	83.d	95	103	111
	26.0	47.d	51.d	61.d	71	78	84		26.0	48.d	52.d	63.d	74.d	84	91	98
	27.0	42.d	46.d	55.d	63	68	74		27.0	43.d	47.d	56.d	66.d	74	80	86
	28.0		41.d	49.d	55	60	65		28.0		42.d	50.d	59.d	65	71	76
	29.0			44	48	52	56		29.0		45.d	52	57	62	67	
	30.0			42	45	49	53		30.0		41.d	46	50	54	58	

TABLE 4: CS120 NWC - #8 REBAR								IMPERIAL UNITS								
Base Steel Thickness = 0.0435 in.								Normal Weight Concrete = 145 lb/ft³								
Rebar # 8																
SLAB WEIGHT (psf)	49.4	52.4	58.5	64.5	70.6	76.6	82.7	SLAB WEIGHT (psf)	49.0	52.1	58.1	64.1	70.2	76.2	82.3	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	
MAX. UNSHORED 1 SPAN (ft)	12.9	12.5	12.0	11.5	11.0	10.7	10.3	MAX. UNSHORED 1 SPAN (ft)	12.1	11.8	11.3	10.8	10.4	10.0	9.70	
MAX. UNSHORED 2 SPAN (ft)	14.9	14.5	13.8	13.2	12.7	12.3	11.6	MAX. UNSHORED 2 SPAN (ft)	14.1	13.8	13.2	12.6	12.0	11.3	10.6	
MAX. UNSHORED 3 SPAN (ft)	15.0	14.7	14.0	13.4	12.9	12.4	12.0	MAX. UNSHORED 3 SPAN (ft)	15.1	27.7	33.2	39.5	46.6	54.6	63.6	
I _u in⁴	25.1	27.7	33.2	39.5	46.6	54.6	63.6	I _u in⁴	14.2	15.5	18.4	21.5	25.0	28.7	32.8	
I _c in⁴	14.2	15.5	18.4	21.5	25.0	28.7	32.8	I _c in⁴	310	340	406	480	563	656	758	
DEFL. PARAMETER (LLDP)	1.50	1.45	1.34	1.25	1.15	1.07	0.992	DEFL. PARAMETER (LLDP)	1.51	1.46	1.35	1.26	1.16	1.08	1.00	
DEFL. PARAMETER (SWDP)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	DEFL. PARAMETER (SWDP)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						
To be established by the designer.	14.0	308	327	365	402	440	478	14.0	294	312	347	383	418	454	489	
	15.0	255.d	279	312	344	377	409		15.0	249.d	266	297	327	358	388	418
	16.0	210.d	231.d	269	297	325	353		16.0	205.d	225.d	256	282	308	334	360
	17.0	175.d	192.d	230.d	257	282	306		17.0	171.d	188.d	221	244	267	289	312
	18.0	148.d	162.d	193.d	224	246	267		18.0	125.d	138.d	164.d	195.d	215	233	252
	19.0	108.d	118.d	141.d	167.d	189	205		19.0	108.d	118.d	141.d	167.d	189	205	221
	20.0	93.d	102.d	122.d	144.d	166	181		20.0	93.d	102.d	122.d	144.d	166	181	195
	21.0	81.d	89.d	106.d	125.d	147	160		21.0	71.d	78.d	93.d	110.d	129.d	141	152
	22.0	62.d	68.d	82.d	97.d	113.d	125		22.0	62.d	68.d	82.d	97.d	113.d	125	135
	23.0	55.d	60.d	72.d	85.d	100.d	111		23.0	55.d	60.d	72.d	85.d	100.d	111	119
	24.0	49.d	54.d	64.d	76.d	89.d	98		24.0	49.d	54.d	64.d	76.d	89.d	98	106
	25.0	44.d	48.d	57.d	68.d	79.d	87		25.0	44.d	48.d	57.d	68.d	79.d	87	94
	26.0	43.d	51.d	61.d	70	77	83		26.0	43.d	51.d	61.d	70	77	83	
	27.0			46.d	55.d	62	67		27.0			46.d	55.d	62	67	
	28.0			42.d	49.d	55	59		28.0			42.d	49.d	55	59	
	29.0								29.0							
	30.0								30.0							

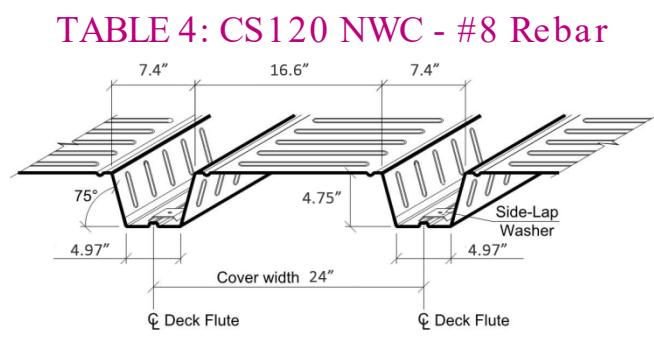



EVALUATION REPORT

Number: 277


Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

TABLE 4: CS120 NWC - #9 REBAR							IMPERIAL UNITS								
Base Steel Thickness = 0.0375 in.							Normal Weight Concrete = 145 lb/ft³								
Rebar # 9															
SLAB WEIGHT (psf)	49.0	52.0	58.1	64.1	70.2	76.2	82.3	SLAB WEIGHT (psf)	49.4	52.4	58.5	64.5	70.6		
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	11.2	11.0	10.5	10.0	9.70	9.30	9.00	MAX. UNSHORED 1 SPAN (ft)	12.1	11.8	11.2	10.8	10.4	10.0	9.70
MAX. UNSHORED 2 SPAN (ft)	10.9	10.4	9.60	8.80	8.20	7.70	7.20	MAX. UNSHORED 2 SPAN (ft)	14.0	13.3	12.3	11.4	10.6	9.90	9.30
MAX. UNSHORED 3 SPAN (ft)	12.4	11.8	10.9	10.1	9.40	8.70	8.20	MAX. UNSHORED 3 SPAN (ft)	14.1	13.8	13.1	12.6	12.0	11.2	10.5
I _u in⁴	24.8	27.4	33.0	39.3	46.4	54.5	63.5	I _u in⁴	25.2	27.7	33.4	39.8	47.0	55.1	64.2
I _c in⁴	14.0	15.4	18.3	21.5	25.0	28.8	32.9	I _c in⁴	14.5	15.9	18.9	22.2	25.8	29.8	34.1
DEFL. PARAMETER (LLDP)	306	336	403	478	562	655	758	DEFL. PARAMETER (LLDP)	312	343	411	487	573	668	773
DEFL. PARAMETER (SWDP)	1.51	1.45	1.34	1.24	1.15	1.07	0.988	DEFL. PARAMETER (SWDP)	1.50	1.44	1.34	1.24	1.15	1.06	0.982
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	309.d	340.d	386	425	464	503	14.0	316.d	347.d	402	444	486	527	569
	15.0	252.d	277.d	330	364	397	431	15.0	257.d	282.d	338.d	381	416	452	488
	16.0	207.d	228.d	273.d	314	343	372	16.0	212.d	233.d	279.d	329	360	390	421
	17.0	173.d	190.d	228.d	270.d	298	323	17.0	176.d	194.d	232.d	276.d	312	339	366
	18.0	146.d	160.d	192.d	228.d	260	282	18.0	149.d	163.d	196.d	232.d	273.d	296	320
	19.0	124.d	136.d	163.d	194.d	228.d	247	19.0	126.d	139.d	167.d	197.d	232.d	260	281
	20.0	106.d	117.d	140.d	166.d	195.d	217	20.0	108.d	119.d	143.d	169.d	199.d	229	247
	21.0	92.d	101.d	121.d	143.d	169.d	192	21.0	94.d	103.d	123.d	146.d	172.d	200.d	219
	22.0	80.d	88.d	105.d	125.d	147.d	170	22.0	81.d	90.d	107.d	127.d	149.d	174.d	194
	23.0	70.d	77.d	92.d	109.d	128.d	150.d	23.0	71.d	78.d	94.d	111.d	131.d	152.d	172
	24.0	61.d	68.d	81.d	96.d	113.d	132.d	24.0	63.d	69.d	83.d	98.d	115.d	134.d	153
	25.0	54.d	60.d	72.d	85.d	100.d	116.d	25.0	55.d	61.d	73.d	87.d	102.d	119.d	136
	26.0	48.d	53.d	64.d	76.d	89.d	104.d	26.0	49.d	54.d	65.d	77.d	91.d	106.d	121
	27.0	43.d	47.d	57.d	67.d	79.d	92.d	27.0	44.d	48.d	58.d	69.d	81.d	94.d	108
	28.0		43.d	51.d	60.d	71.d	83.d	28.0		43.d	52.d	62.d	72.d	84.d	96
	29.0			46.d	54.d	64.d	73	29.0			47.d	56.d	65.d	76.d	85
	30.0			41.d	49.d	58.d	65	30.0			42.d	50.d	59.d	69.d	75

TABLE 4: CS120 NWC - #9 REBAR							IMPERIAL UNITS								
Base Steel Thickness = 0.0435 in.							Normal Weight Concrete = 145 lb/ft³								
Rebar # 9															
SLAB WEIGHT (psf)	49.4	52.4	58.5	64.5	70.6	76.6	82.6	SLAB WEIGHT (psf)	49.4	52.4	58.5	64.5	70.6	76.6	
CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99	CONCRETE VOLUME (yd³/100ft²)	1.15	1.22	1.38	1.53	1.69	1.84	1.99
MAX. UNSHORED 1 SPAN (ft)	12.1	11.8	11.2	10.8	10.4	10.0	9.70	MAX. UNSHORED 1 SPAN (ft)	12.1	11.8	11.2	10.8	10.4	10.0	9.70
MAX. UNSHORED 2 SPAN (ft)	14.0	13.3	12.3	11.4	10.6	9.90	10.3	MAX. UNSHORED 2 SPAN (ft)	14.0	13.3	12.3	11.4	10.6	9.90	10.3
MAX. UNSHORED 3 SPAN (ft)	14.1	13.8	13.1	12.6	12.0	11.2	10.5	MAX. UNSHORED 3 SPAN (ft)	14.1	13.8	13.1	12.6	12.0	11.2	10.5
I _u in⁴	25.2	27.7	33.4	39.8	47.0	55.1	64.2	I _u in⁴	25.2	27.7	33.4	39.8	47.0	55.1	64.2
I _c in⁴	14.5	15.9	18.9	22.2	25.8	29.8	34.1	I _c in⁴	14.5	15.9	18.9	22.2	25.8	29.8	34.1
DEFL. PARAMETER (LLDP)	312	343	411	487	573	668	773	DEFL. PARAMETER (LLDP)	312	343	411	487	573	668	773
DEFL. PARAMETER (SWDP)	1.50	1.44	1.34	1.24	1.15	1.06	0.982	DEFL. PARAMETER (SWDP)	1.50	1.44	1.34	1.24	1.15	1.06	0.982
SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0	SLAB THICKNESS (in.)	7.25	7.50	8.0	8.50	9.0	9.50	10.0
SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)						SHORING	SPAN (ft)	MAXIMUM SPECIFIED LOADS (psf)					
To be established by the designer.	14.0	316.d	347.d	402	444	486	527	14.0	316.d	347.d	402	444	486	527	569
	15.0	257.d	282.d	338.d	381	416	452	15.0	257.d	282.d	338.d	381	416	452	488
	16.0	212.d	233.d	279.d	329	360	390	16.0	212.d	233.d	279.d	329	360	390	421
	17.0	176.d	194.d	232.d	276.d	312	339	17.0	176.d	194.d	232.d	276.d	312	339	366
	18.0	149.d	163.d	196.d	232.d	273.d	296	18.0	149.d	163.d	196.d	232.d	273.d	296	320
	19.0	126.d	139.d	167.d	197.d	232.d	260	19.0	126.d	139.d	167.d	197.d	232.d	260	281
	20.0	108.d	119.d	143.d	169.d	199.d	227	20.0	108.d	119.d	143.d	169.d	199.d	227	247
	21.0	94.d	103.d	123.d	146.d	172.d	200.d	21.0	94.d	103.d	123.d	146.d	172.d	200.d	219
	22.0	81.d	90.d	107.d	127.d	149.d	174.d	22.0	81.d	90.d	107.d	127.d	149.d	174.d	194
	23.0	71.d	78.d	94.d	111.d	131.d	152.d	23.0	71.d	78.d	94.d	111.d	131.d	152.d	172
	24.0	63.d	69.d	83.d	98.d	115.d	134.d	24.0	63.d	69.d	83.d	98.d	115.d	134.d	153
	25.0	55.d	61.d	73.d	87.d	102.d	119.d	25.0	55.d	61.d	73.d	87.d	102.d	119.d	136
	26.0	49.d	54.d	65.d	77.d	91.d	106.d	26.0	49.d	54.d	65.d	77.d	91.d	106.d	121
	27.0	44.d	48.d	58.d	69.d	81.d	94.d	27.0	44.d	48.d	58.d	69.d	81.d	94.d	108
	28.0		43.d	52.d	62.d	72.d	84.d	28.0		43.d	52.d	62.d	72.d	84.d	96
	29.0			47.d	56.d	65.d	76.d	29.0			47.d	56.d	65.d	76.d	85
	30.0			42.d	50.d	59.d	69.d	30.0			42.d	50.d	59.d	69.d	75

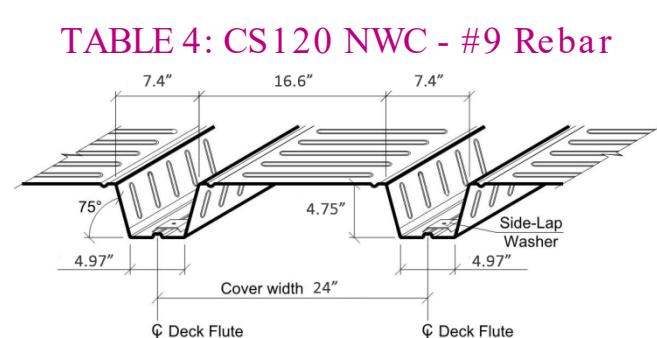



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

CALIFORNIA SUPPLEMENT

BAILEY METAL PRODUCTS LIMITED
1 Caldari Road
Concord, ON L4K 3Z9
CANADA
(905) 738-9267
www.bmp-group.com

COMSLAB FLOOR SYSTEM

CSI Sections:

- 05 00 00 Metals
- 05 31 00 Steel Decking
- 05 31 13 Steel Floor Decking

1.0 RECOGNITION

The ComSlab Floor System evaluated in IAPMO UES ER-277 and this supplement, complies with the following codes, subject to the additional requirements in Section 2.0 of this supplement:

- 2019 California Building Code (CBC), Title 24 Part 2.

2.0 LIMITATIONS

Use of the ComSlab Floor System recognized in ER-277 and this report supplement is subject to the following limitations:

2.1 The design and installation of the ComSlab Floor System shall be in accordance with the 2018 International Building Code, as noted in ER-277.

2.2 Special Inspections are required in accordance with CBC Sections 1705.2 and 1705A.2, Steel Construction, and Sections 1705.3 and 1705A.3, Concrete Construction.

2.3 Structural Observation is required in accordance with CBC Sections 1704.6 and 1704A.6.

2.4 Concrete materials shall comply with CBC Sections 1909.2 and 1903A, and 2016 CBC Section 1910A.

2.5 This supplement expires concurrently with ER-277.

For additional information about this evaluation report please visit

www.uniform-es.org or email us at info@uniform-es.org



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

FLORIDA SUPPLEMENT

BAILEY METAL PRODUCTS LIMITED

1 Caldari Road
Concord, ON L4K 3Z9
CANADA
(905) 738-9267
www.bmp-group.com

COMSLAB FLOOR SYSTEM

CSI Sections:

05 00 00 Metals
05 31 00 Steel Decking
05 31 13 Steel Floor Decking

1.0 RECOGNITION

The ComSlab Floor System evaluated in IAPMO UES ER-277 and this supplement, complies with the following code, subject to the additional requirements in Section 2.0 of this supplement:

- 2020 Florida Building Code, Building (FBC, Building)

2.0 LIMITATIONS

Use of the ComSlab Floor System recognized in ER-277 and this report supplement is subject to the following limitations:

2.1 The design and installation of the ComSlab Floor System shall be in accordance with the 2018 International Building Code, as noted in ER-277.

2.2 Special Inspections are required for threshold buildings in accordance with FBC, Building Section 110.8.

2.3 Installations in high-velocity hurricane zones (HVHZ) are subject to applicable provisions in the FBC, Building Section 2222.

2.4 Verification shall be provided that a quality assurance agency audits the manufacturer's quality assurance program and audits the production quality of products, in accordance with Section (5)(d) of Florida Rule 61G20-3.008. The quality assurance agency shall be approved by the Commission (or the building official when the report holder does not possess an approval from the Commission).

2.5 This supplement expires concurrently with ER-277.

For additional information about this evaluation report please visit
www.uniform-es.org or email us at info@uniform-es.org



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

CITY OF NEW YORK SUPPLEMENT

BAILEY METAL PRODUCTS LIMITED

1 Caldari Road
Concord, ON L4K 3Z9
Canada
(905) 738-9267
www.bmp-group.com

COMSLAB FLOOR SYSTEM

CSI Sections:

05 00 00 Metals
05 31 00 Steel Decking
05 31 13 Steel Floor Decking

1.0 RECOGNITION

The ComSlab Floor System evaluated in IAPMO UES ER-277 and this supplement, complies with the following code, subject to the additional requirements in Section 2.0 of this supplement:

- 2014 New York City Building Code (NYCBC)
Section 2209.2

2.0 LIMITATIONS

Use of the ComSlab Floor System recognized in ER-277 and this report supplement is subject to the following limitations:

2.1 The design, installation, and inspection of the ComSlab Floor System shall be in accordance with the 2012 International Building Code, as noted in ER-277.

2.2 Special Inspections are required in accordance with NYCBC Sections 1704.1, Sections 1704.3, Steel Construction, and 1704.4 Concrete Construction.

2.3 This supplement expires concurrently with ER-277.

For additional information about this evaluation report please visit
www.uniform-es.org or email us at info@uniform-es.org



EVALUATION REPORT

Number: 277

Originally Issued: 06/10/2016

Revised: 06/02/2023

Valid Through: 06/30/2024

CITY OF CHICAGO SUPPLEMENT

BAILEY METAL PRODUCTS LIMITED

1 Caldari Road
Concord, ON L4K 3Z9
Canada
(905) 738-9267
www.bmp-group.com

COMSLAB FLOOR SYSTEM

CSI Sections:

05 00 00 Metals
05 31 00 Steel Decking
05 31 13 Steel Floor Decking

1.0 RECOGNITION

The ComSlab Floor System evaluated in IAPMO UES ER-277 and this supplement, complies with the following code, subject to the additional requirements in Section 2.0 of this supplement:

- 2019 Chicago Building Code (Title 14B)

2.0 LIMITATIONS

Use of the ComSlab Floor System recognized in ER-277 and this report supplement is subject to the following limitations:

2.1 The design, installation, and inspection of the ComSlab Floor System shall be in accordance with the 2018 International Building Code, as noted in ER-277.

2.2 A statement of special inspections shall be prepared by the registered design professional in responsible charge and submitted to the building official as set forth in Sections 1704.2.3 and 1704.3 of the Chicago Building Code.

2.3 Structural observations shall be provided where required by Sections 1706.1 or 1706.2 of the Chicago Building Code.

2.4 This supplement expires concurrently with ER-277.

For additional information about this evaluation report please visit
www.uniform-es.org or email us at info@uniform-es.org